

1 Q. Re: IC-NLH-16, Attachment 1. Please provide similar graphs to Figure 5-1, Figure 7-1  
2 and Figure 7-2 for capacity, based on either MW or LOLH (hr/yr).

3

4

5 A. Table 1 (Revised) and Table 2 (Revised) are similar graphs to Figure 5-1 and 7-1, for  
6 capacity, based on MW (Net Capacity versus Peak Demand). Table 1 indicates Net  
7 Capacity with no future changes in the system and Table 2 indicates Net Capacity  
8 with a preliminary expansion plan. As a current peak forecast is not available, the  
9 demand forecast was not updated in Table 1 and Table 2.

10

11 With sanction of the Muskrat Falls Project and Labrador-Island Link in 2012, Figure  
12 7-2 is no longer relevant.

Table 1 (Revised)

Interconnected Island Net Capacity vs. Load forecast

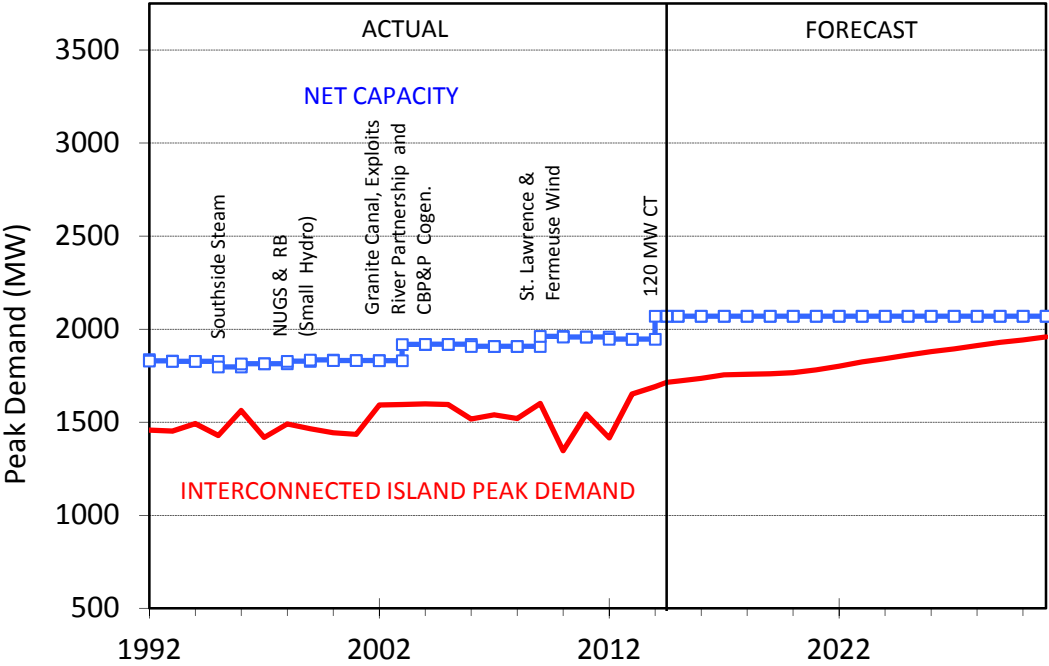


Table 2 (Revised)

Preliminary Interconnected Island Expansion Plan vs. Load Forecast

