


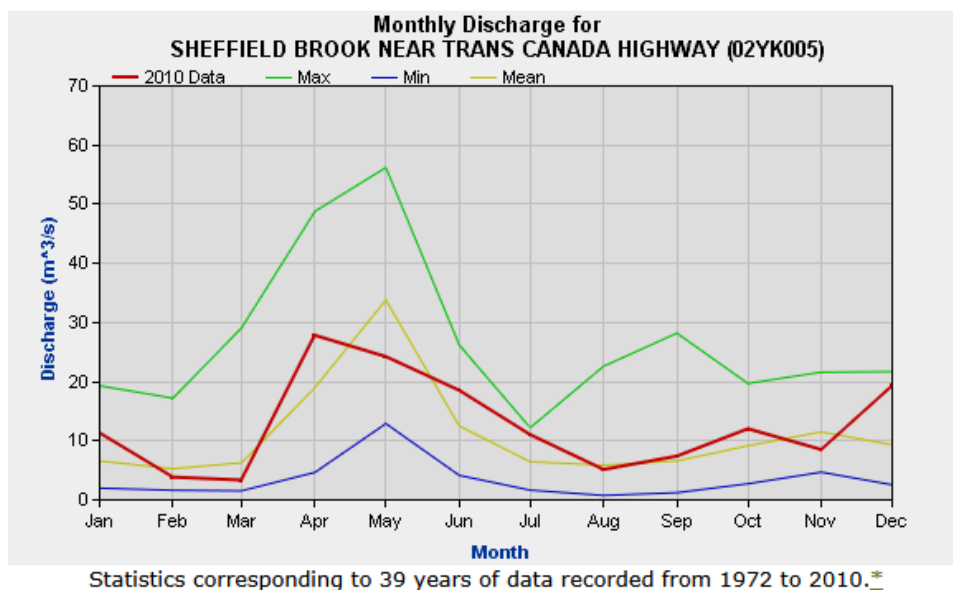


- 1 Q. Please show the typical anticipated monthly generation profile from run-of-river
2 and wind power sources in Newfoundland.
3
4 A. Following are discharge profiles for four different areas of Newfoundland:

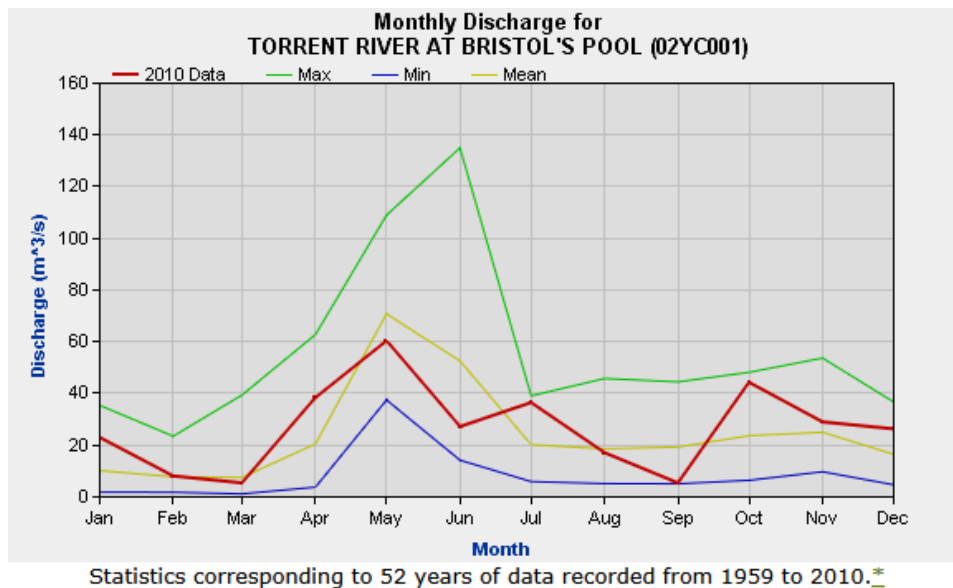

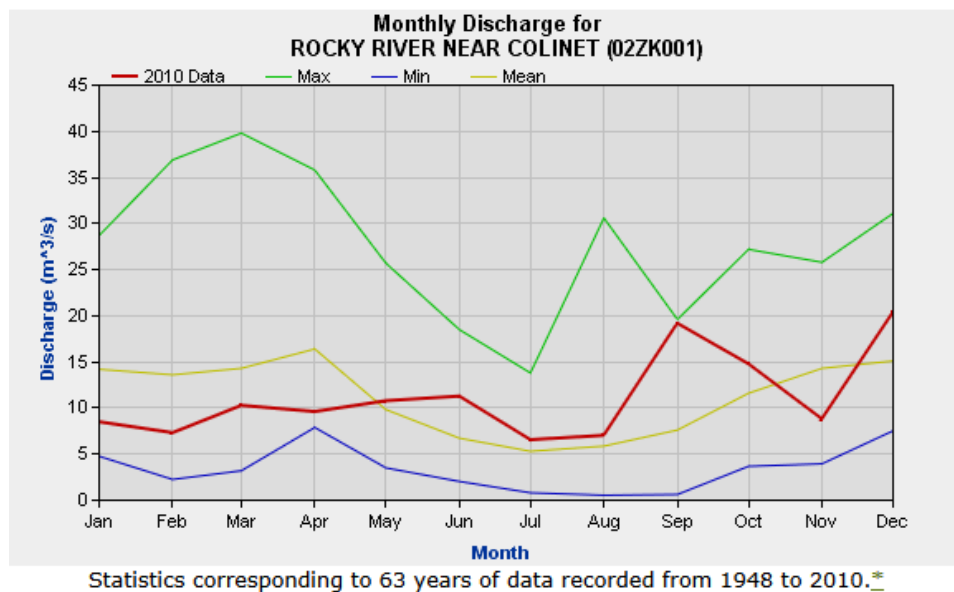

- 1 Following is an an expected monthly generation profile for a 25 MW wind farm with
2 a 40% annual capacity factor. Please refer to Nalcor's response to MHI-Nalcor-87
3 for the rationale for using a 40% capacity factor.

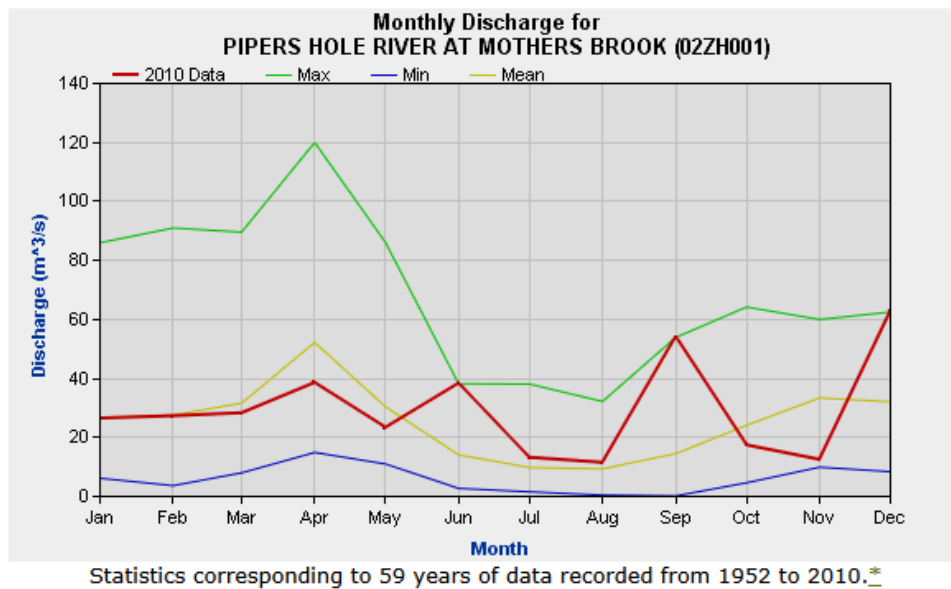