


**Newfoundland and Labrador Hydro
NLH System Supply and Demand
January 11, 2014**

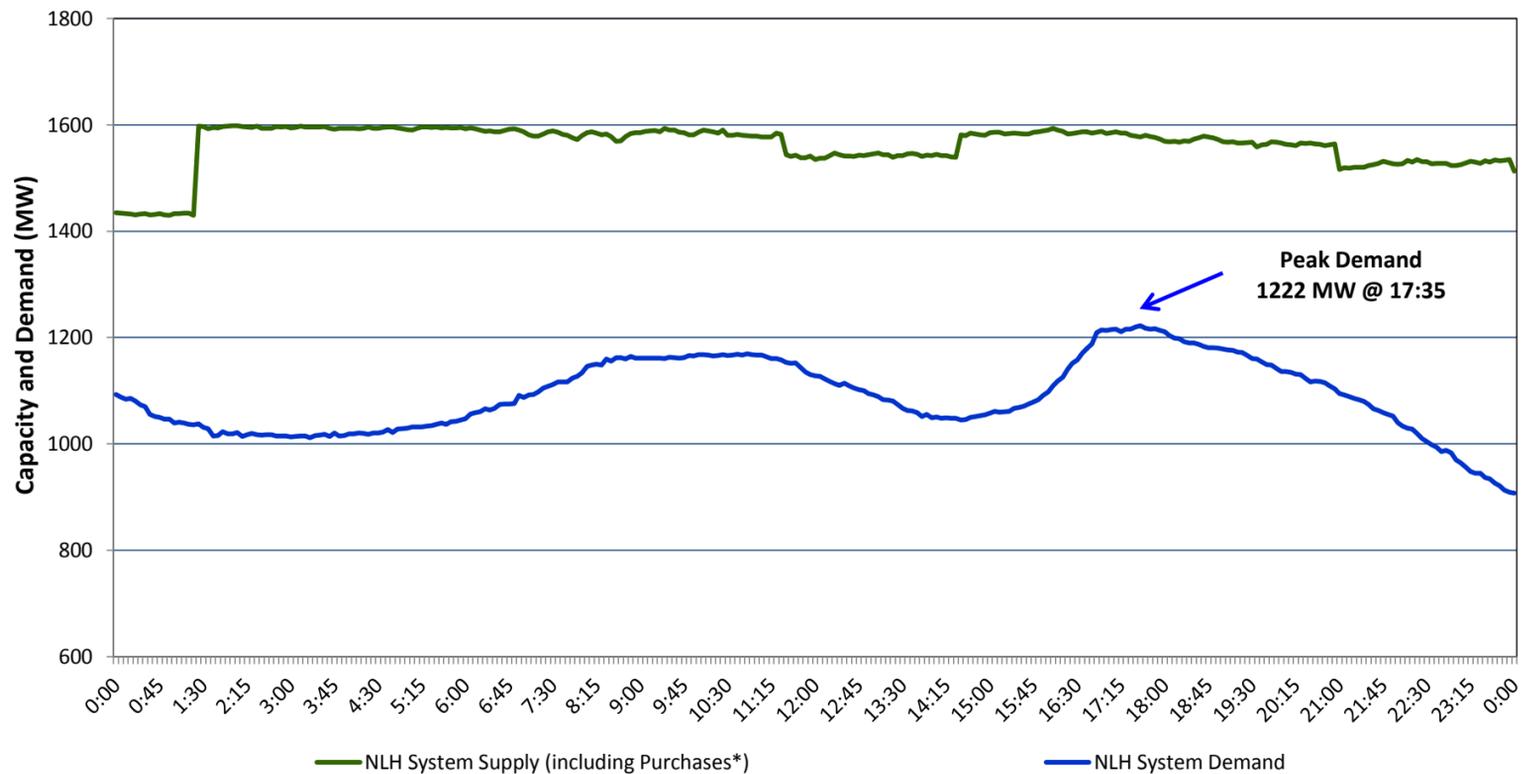

* Purchases include Nalcor Exploits and Star Lake, Rattle Brook, CBPP Co-Gen, Wind Generation, and CBPP Curtailable Load (60 MW)

Previous Day's NLH System Supply Notes^{1,2}:

- Holyrood Unit 2 restarted at 0122 hours following the trip on the previous day.
- At 1126 hours the unit at Granite Canal tripped at 40 MW. The unit was restored at 1422 hours. The cause of the trip is under investigation.
- At 2059 hours the Hardwoods unit tripped at 47 MW during testing and is currently unavailable. There are items that require addressing before the unit can be released for normal service.

12-Jan-2014	NLH System Outlook ³	Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)	
			Morning	Evening	Morning	Evening
Available NLH System Supply: ⁴	1,500 MW	Sunday, January 12, 2014	5	7	1,070	1,025
Current St. John's Temperature:	9 °C	Monday, January 13, 2014	0	-1	1,250	1,200
Current St. John's Windchill:	N/A °C	Tuesday, January 14, 2014	-2	1	1,270	1,200
NLH System Peak Demand Forecast:	1,070 MW	Wednesday, January 15, 2014	6	4	1,125	1,075
		Thursday, January 16, 2014	-1	1	1,250	1,175

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes CBPP Curtailable Load (60 MW). Excludes wind generation.

12-Jan-2014 Island Demand¹

Island Peak Demand Forecast:	1,270 MW	Previous Day's Island Peak Demand:	1,387 MW @	17:10
------------------------------	----------	------------------------------------	------------	-------

- Note: 1. The Island supply includes generation owned by NLH, purchased by NLH and generation owned by Newfoundland Power (NP) and Corner Brook Pulp and Paper (CBPP) to supply their needs. The total power produced and purchased by NLH is referred to as the NLH System Supply.