


Newfoundland and Labrador Hydro

NLH System Supply and Demand

March 01, 2014

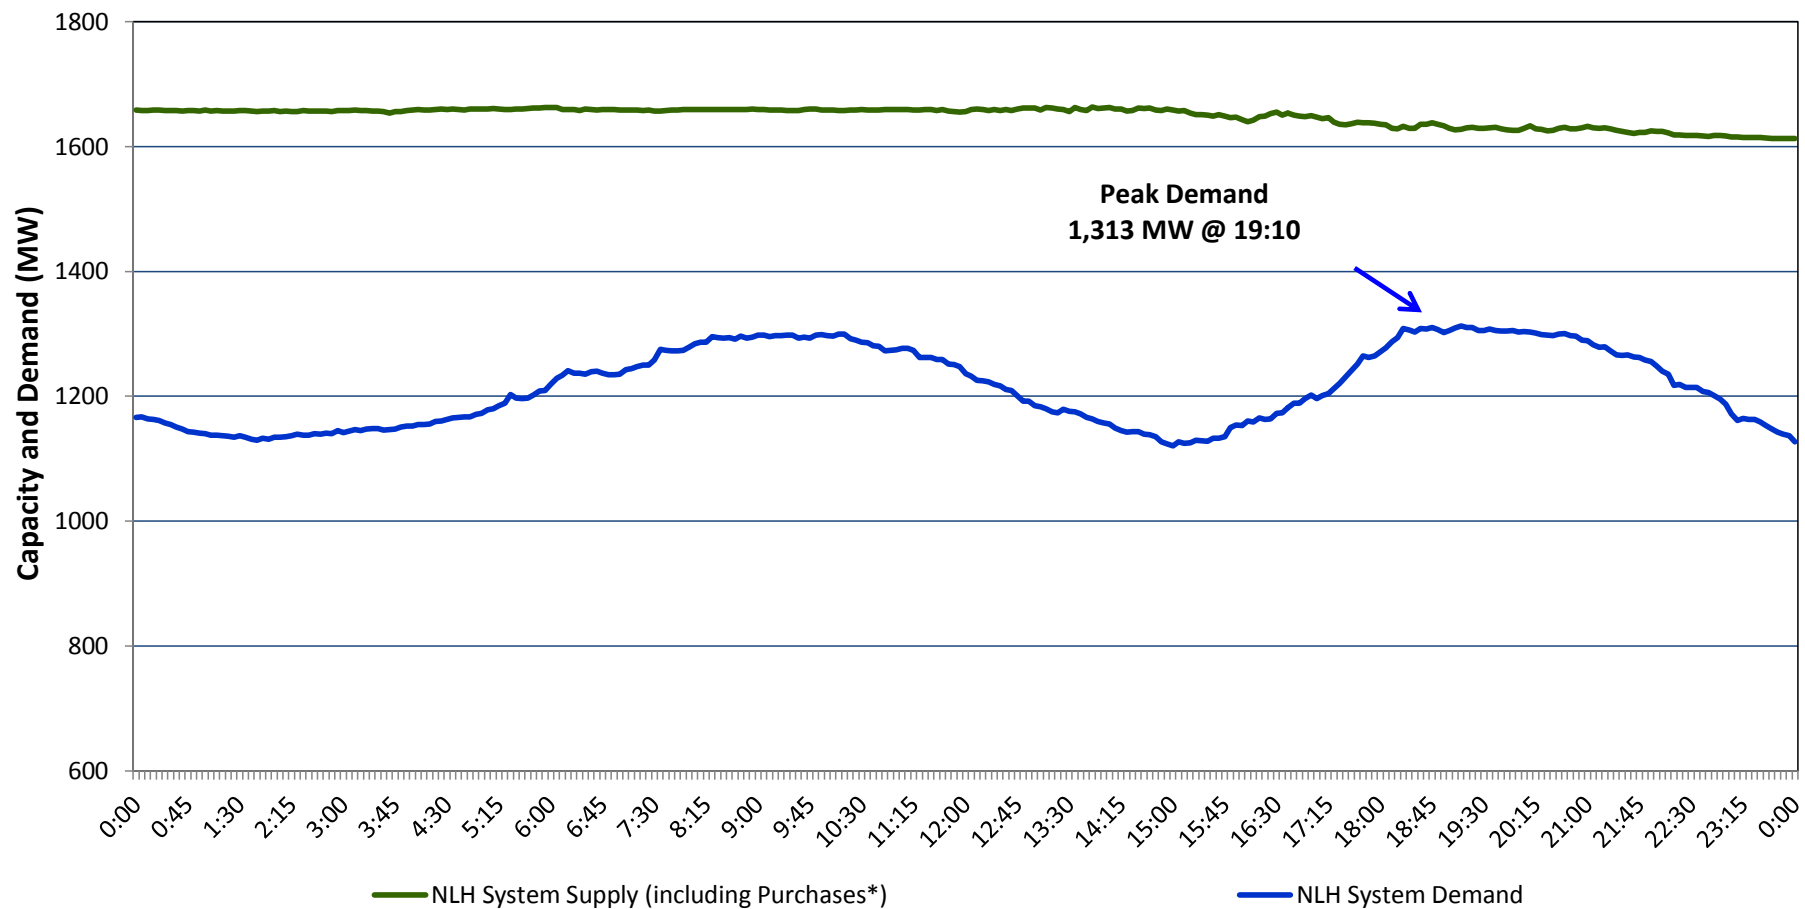

* Purchases include Nalcor Exploits and Star Lake, Rattle Brook, CBPP Co-Gen, Wind Generation, and CBPP Curtailable Load (60 MW)

Previous Day's NLH System Supply Notes^{1,2}:

- Ongoing derating for Holyrood Unit 1 (to 140 MW).
- Bay d'Espoir Unit 6 (75 MW) is unavailable for service.
- Stephenville unit derated to 38 MW due to the capacity of the replacement engine and Hydro's latest run up test.
- Hardwoods unit derated to 25 MW (End B not available) due to a fuel valve issue with End B.

2-Mar-2014 NLH System Outlook ³			Five-Day Forecast		Temperature (°C)		NLH System Demand (MW)	
					Morning	Evening	Morning	Evening
Available NLH System Supply: ⁴	1,575	MW	Sunday, March 02, 2014		-10	-4	1,275	1,200
Current St. John's Temperature:	-7	°C	Monday, March 03, 2014		-8	-10	1,375	1,450
Current St. John's Windchill:	-14	°C	Tuesday, March 04, 2014		-16	-16	1,475	1,475
NLH System Peak Demand Forecast:	1,275	MW	Wednesday, March 05, 2014		-17	-13	1,450	1,475
			Thursday, March 06, 2014		-18	-11	1,500	1,425

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes CBPP Curtailable Load (60 MW). Excludes wind generation.

2-Mar-2014 Island Demand¹

Island Peak Demand Forecast:	1,425	MW	Previous Day's Island Peak Demand:	1,499	MW @	19:15
------------------------------	-------	----	------------------------------------	-------	------	-------

- Note:
1. The Island supply includes generation owned by NLH, purchased by NLH and generation owned by Newfoundland Power (NP) and Corner Brook Pulp and Paper (CBPP) to supply their needs. The total power produced and purchased by NLH is referred to as the NLH System Supply.