


**Newfoundland and Labrador Hydro
NLH System Supply and Demand
March 05, 2014**

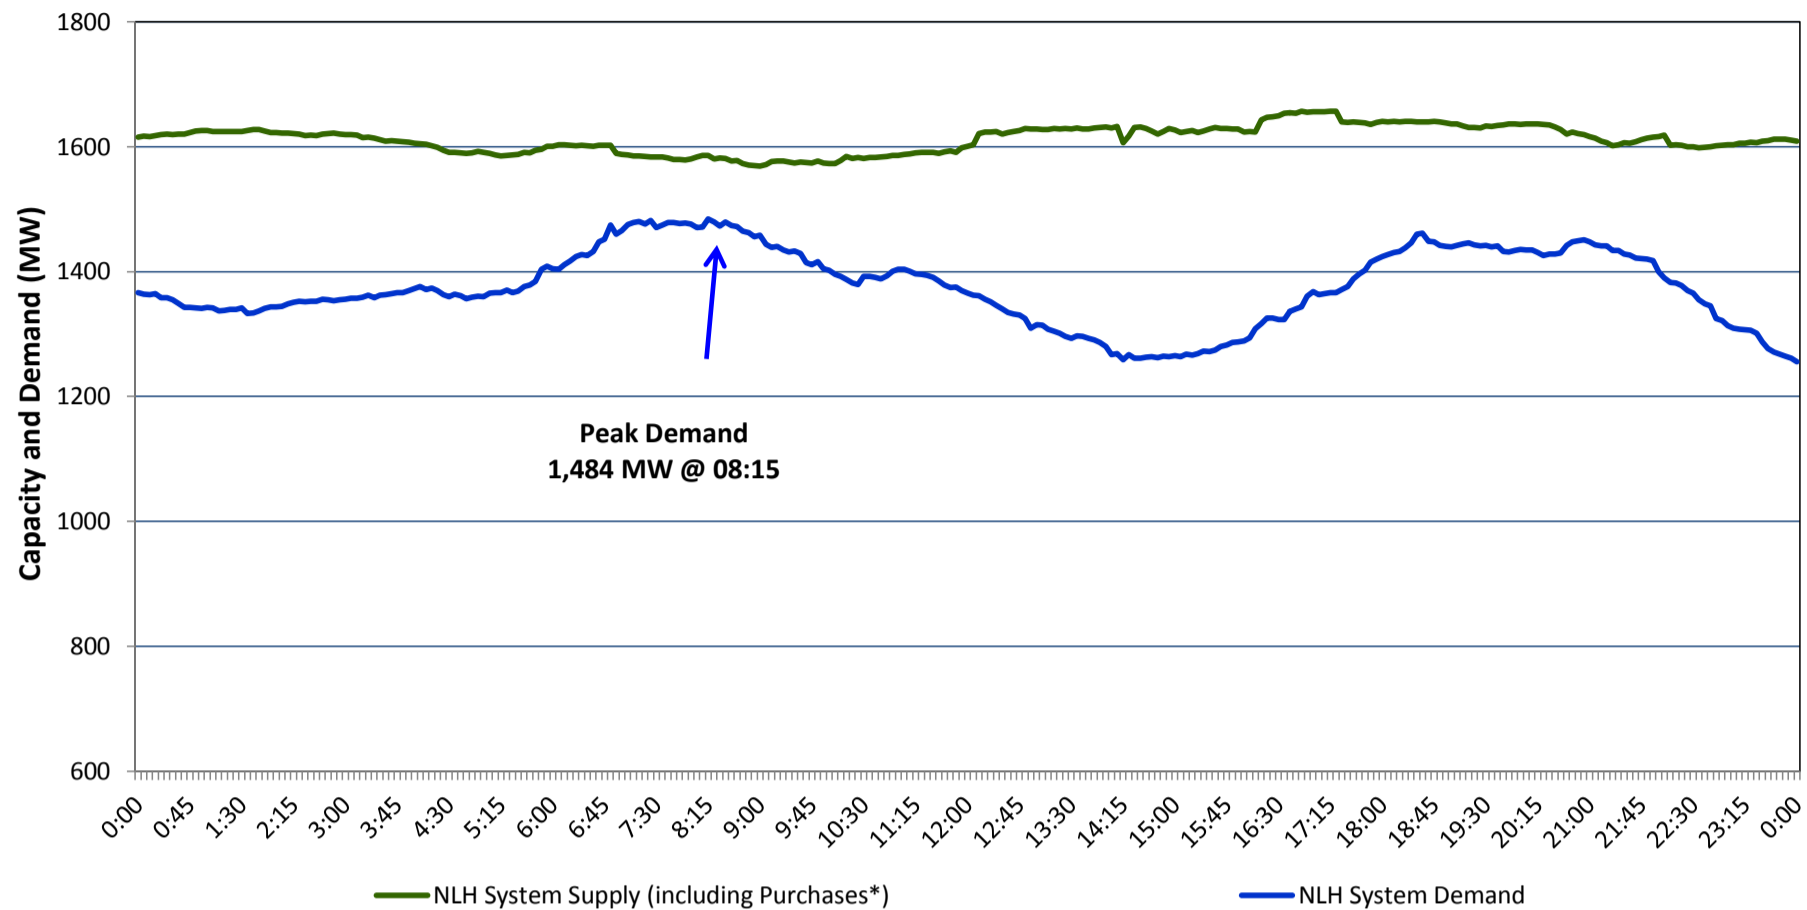

* Purchases include Nalcor Exploits and Star Lake, Rattle Brook, CBPP Co-Gen, Wind Generation, and CBPP Curtailable Load (60 MW)

Previous Day's NLH System Supply Notes^{1,2}:

- Ongoing derating for Holyrood Unit 1 to 140 MW from 170 MW.
- Bay d'Espoir Unit 6 (75 MW) is unavailable for service.
- Stephenville Gas Turbine End B returned to service at 1400 hours. Combined capacity 40 MW.
- Hardwoods Gas Turbine End B returned to service at 1140 hours. Combined capacity 50 MW.
- Holyrood Unit 3 derated to 130 MW from 150 MW. Hydro is investigating, an advisory will be reported.

6-Mar-2014	NLH System Outlook ³		Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)	
				Morning	Evening	Morning	Evening
Available NLH System Supply: ⁴	1,580	MW	Thursday, March 06, 2014	-15	-15	1,450	1,475
Current St. John's Temperature:	-15	°C	Friday, March 07, 2014	-14	-6	1,450	1,300
Current St. John's Windchill:	-25	°C	Saturday, March 08, 2014	-9	-3	1,200	1,175
NLH System Peak Demand Forecast:	1,475	MW	Sunday, March 09, 2014	-4	-8	1,175	1,250
			Monday, March 10, 2014	-11	-10	1,350	1,325

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes CBPP Curtailable Load (60 MW). Excludes wind generation.

6-Mar-2014 Island Demand¹

Island Peak Demand Forecast:	1,650	MW	Previous Day's Island Peak Demand:	1,616	MW @	7:20
------------------------------	-------	----	------------------------------------	-------	------	------

- Note: 1. The Island supply includes generation owned by NLH, purchased by NLH and generation owned by Newfoundland Power (NP) and Corner Brook Pulp and Paper (CBPP) to supply their needs. The total power produced and purchased by NLH is referred to as the NLH System Supply.