
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed March 11, 2014

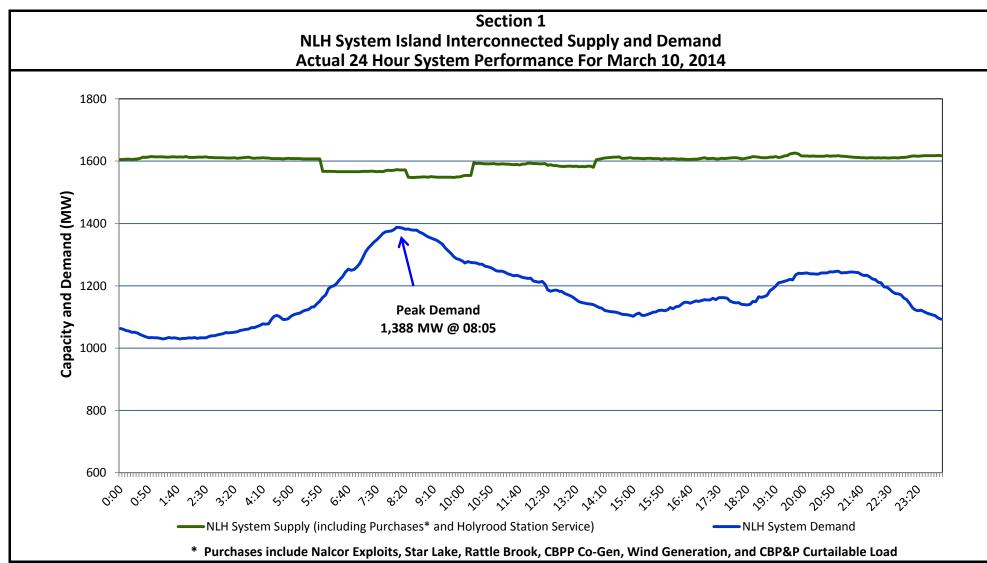

Supply Notes for March 10, 2014

- As of 1750 hours, Feb. 13, 2014, Holyrood Unit 1 (170 MW) derated to 140 MW.
- As of 0422 hours, Feb. 17, 2014, Bay d'Espoir Unit 6 (75 MW) unavailable for service.
- Stephenville Unit tripped while in synchronous conderser operation at 0554 hours. Hydro investigated and returned the unit to service at 1015 hours. Derated to 40 MW from 50 MW.
- Hardwoods Unit End B unavailable (25 MW) at 0824 hours due to a fuel leak. Hydro made the necessary repairs and returned End B to service at 1350 hours. Full capacity 50 MW available.

Section 2 NLH System Island Interconnected Supply and Demand									
March 11, 2014 NLH System Outlook ³		Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)				
				Morning	Evening	Morning	Evening		
Available NLH System Supply: ⁴	1,530	MW	Tuesday, March 11, 2014	-13	-8	1,425	1,275		
Current St. John's Temperature:	-15	°C	Wednesday, March 12, 2014	-2	-1	1,150	1,100		
Current St. John's Windchill:	-22	°C	Thursday, March 13, 2014	-2	5	1,125	1,000		
NLH System Peak Demand Forecast:	1,425	MW	Friday, March 14, 2014	-4	-2	1,150	1,175		
			Saturday, March 15, 2014	-8	-9	1,225	1,225		

Supply Notes for March 11, 2014

- Hardwoods Unit End A tripped at 0637 hours, Mar. 11. Hardwoods derated to 25 MW from 50 MW. Hydro is investigating.
- As of 0440 hours, Mar. 11 Holyrood Unit 1 (170 MW) derated to 100 MW due to an alarm on a Forced Draft Fan. Hydro is investigating.

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. 3. As of 0800 Hours.
 - 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen, and CBPP Curtailable Load (60 MW). Excludes wind generation.

Section 3 Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
March 10, 2014	Actual NLH System Island Interconnected Peak Demand ¹	8:05	1,388 MW				
March 11, 2014	Forecast NLH System Island Interconnected Peak Demand		1,425 MW				
March 10, 2014	Actual Total Island Peak Demand ²	8:30	1,517 MW				
March 11, 2014	Forecast Total Island Peak Demand		1,575 MW				

Notes: 1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.

2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.