


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed March 24, 2014

Section 1 NLH System Island Interconnected Supply and Demand Actual 24 Hour System Performance For March 21, 2014

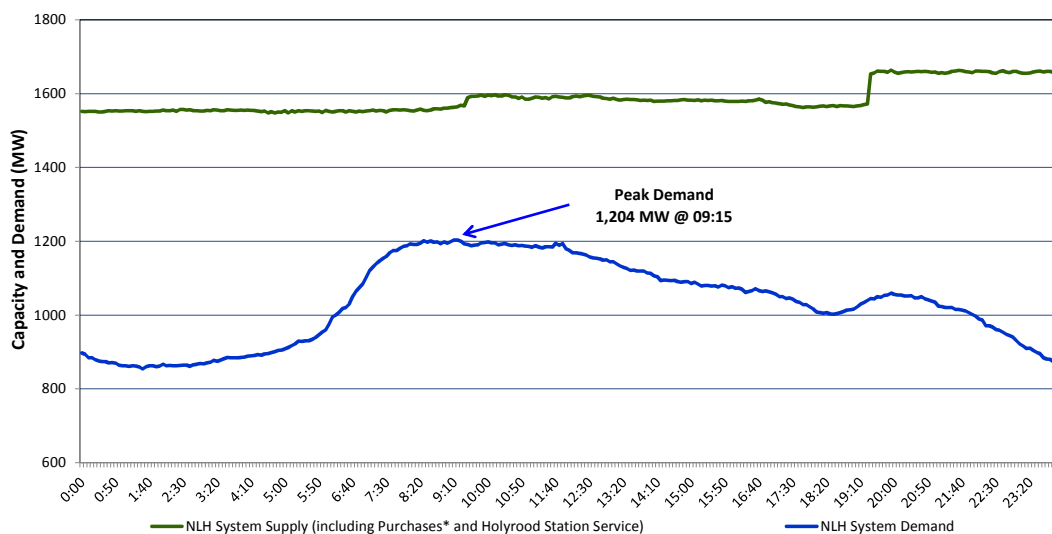

* Purchases include Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen, Wind Generation, and CBP&P Curtailable Load

Supply Notes for March 21, 2014

- As of 0422 hours, Feb. 17, 2014, Bay d'Espoir Unit 6 (77 MW) unavailable for service.
- As of 0627 hours, March 17, 2014, Holyrood Unit 1 derated to 150 MW from 170 MW.
- As of 0930 hours, Hardwoods End B (25 MW) available for service. Full capacity available (50 MW).
- As of 1916 hours, Bay d'Espoir Unit 4 (77 MW) available for service.

Section 2 NLH System Island Interconnected Supply and Demand

March 22, 2014 NLH System Outlook ³			Five-Day Forecast		Temperature (°C)		NLH System Demand (MW)	
					Morning	Evening	Morning	Evening
Available NLH System Supply: ⁴	1,620	MW	Saturday, March 22, 2014		-1	-2	1,150	1,100
Current St. John's Temperature:	-1	°C	Sunday, March 23, 2014		-5	-2	1,150	1,100
Current St. John's Windchill:	-7	°C	Monday, March 24, 2014		-5	-2	1,225	1,200
NLH System Peak Demand Forecast:	1,150	MW	Tuesday, March 25, 2014		-11	-9	1,375	1,250
			Wednesday, March 26, 2014		-10	-2	1,325	1,200

Supply Notes for March 22, 2014³

→

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen, and CBPP Curtailable Load (60 MW). Excludes wind generation.

Section 3 Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

March 21, 2014	Actual NLH System Island Interconnected Peak Demand ¹	9:15	1,204 MW
March 22, 2014	Forecast NLH System Island Interconnected Peak Demand		1,150 MW
March 21, 2014	Actual Total Island Peak Demand ²	11:40	1,364 MW
March 22, 2014	Forecast Total Island Peak Demand		1,300 MW

- Notes:
1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.
 2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.