


Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed May 26, 2014

Section 1  
NLH System Island Interconnected Supply and Demand  
Actual 24 Hour System Performance For May 24, 2014

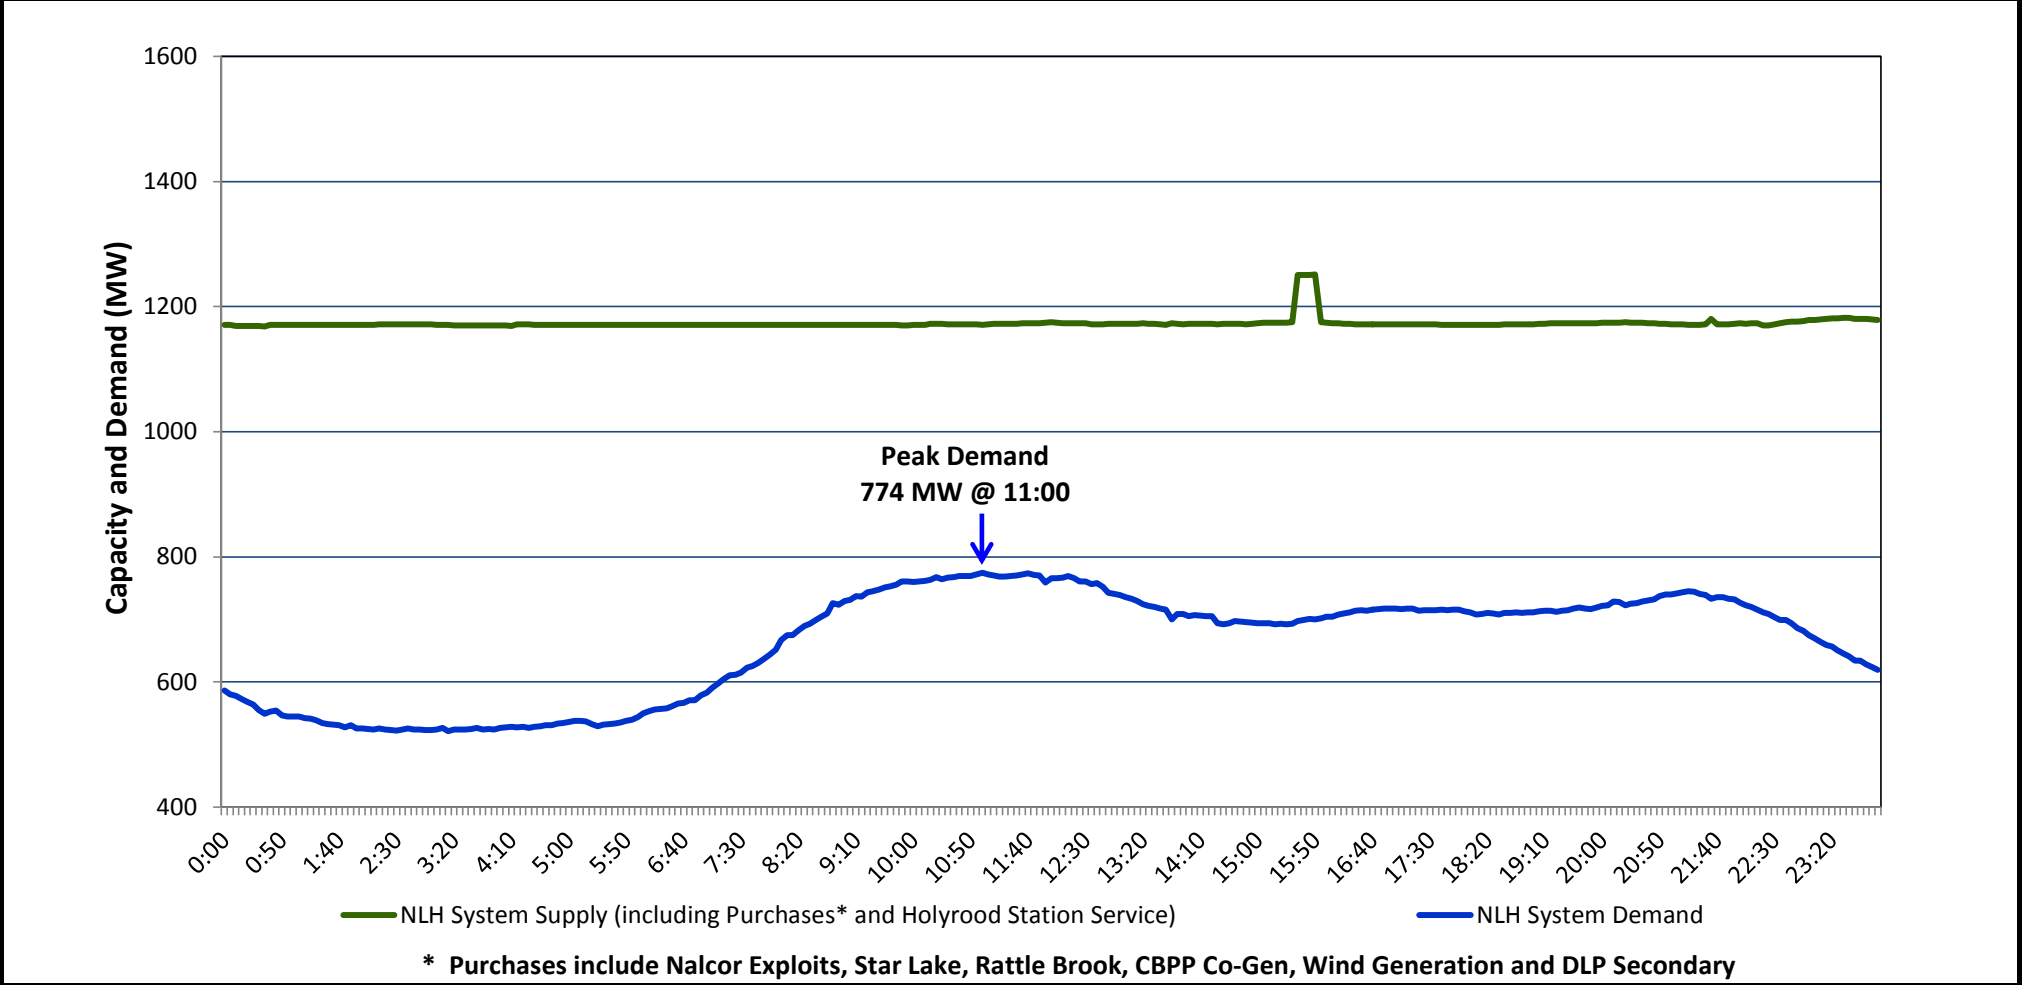

**Supply Notes for May 24, 2014**

→ As of 0422 hours, Feb. 17, 2014, Bay d'Espoir Unit 6 (77 MW) unavailable for service.

→ As of 1717 hours, April 10, 2014, Holyrood Unit 3 removed from service for annual maintenance (150 MW).

→ As of 0800 hours, May 21, 2014, Holyrood Unit 2 removed from service for annual maintenance (165 MW).

→ At 1527 hours, May 24, 2014, Bay d'Espoir Unit 1 was returned to service (76.5 MW).

→ At 1554 hours, May 24, 2014, Bay d'Espoir Unit 3 removed from service for annual maintenance (76.5 MW).

Section 2  
NLH System Island Interconnected Supply and Demand

May 25, 2014 NLH System Outlook <sup>3</sup>			Five-Day Forecast		Temperature (°C)		NLH System Demand (MW)	
					Morning	Evening	Morning	Evening
Available NLH System Supply: <sup>4</sup>	1,170	MW	Sunday, May 25, 2014		3	3	850	775
Current St. John's Temperature:	3	°C	Monday, May 26, 2014		4	4	900	900
Current St. John's Windchill:	N/A	°C	Tuesday, May 27, 2014		3	3	825	850
NLH System Peak Demand Forecast:	850	MW	Wednesday, May 28, 2014		4	4	875	875
			Thursday, May 29, 2014		1	4	875	775

**Supply Notes for May 25, 2014<sup>3</sup>**

→

Notes:

1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
3. As of 0800 Hours.
4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen. Excludes wind generation and DLP Secondary.

Section 3  
Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak

May 24, 2014	Actual NLH System Island Interconnected Peak Demand <sup>1</sup>	11:00	774 MW
May 25, 2014	Forecast NLH System Island Interconnected Peak Demand		850 MW
May 24, 2014	Actual Total Island Peak Demand <sup>2</sup>	10:55	913 MW
May 25, 2014	Forecast Total Island Peak Demand		1,000 MW

Notes:

1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.
2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.