


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed June 03, 2014**

**Section 1  
NLH System Island Interconnected Supply and Demand  
Actual 24 Hour System Performance For June 02, 2014**

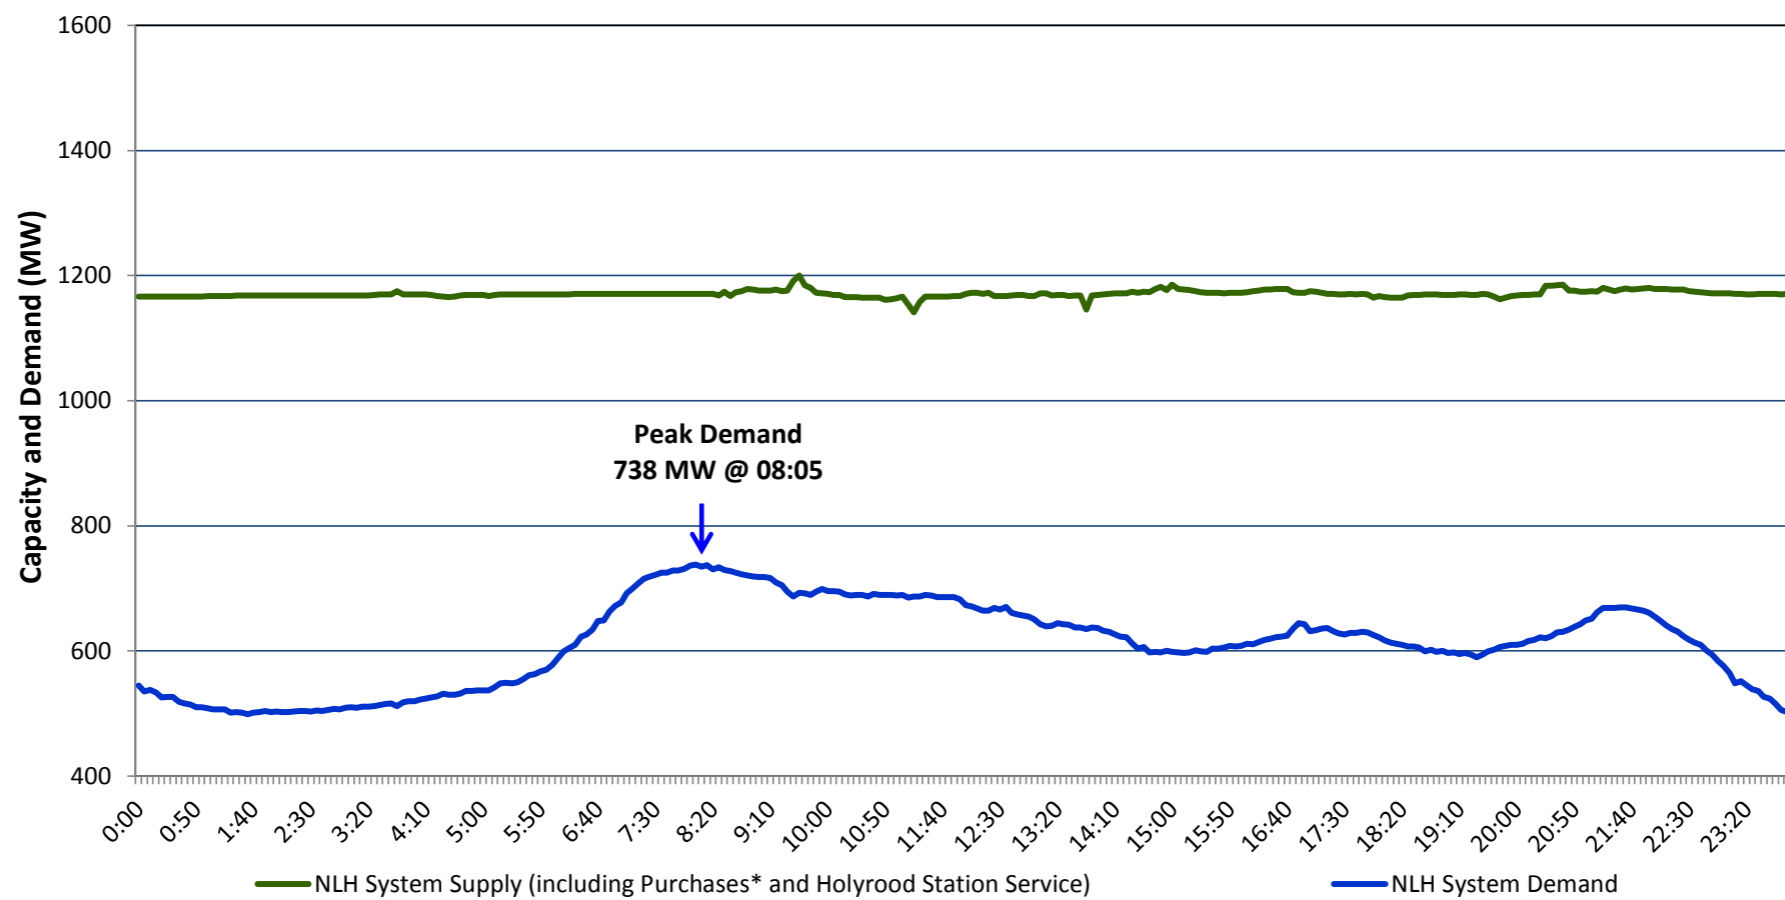

**Supply Notes for June 02, 2014**

- As of 0422 hours, Feb. 17, 2014, Bay d'Espoir Unit 6 (77 MW) unavailable for service.
- As of 1717 hours, April 10, 2014, Holyrood Unit 3 removed from service for annual maintenance (150 MW).
- As of 0800 hours, May 21, 2014, Holyrood Unit 2 removed from service for annual maintenance (165 MW).
- As of 1554 hours, May 24, 2014, Bay d'Espoir Unit 3 removed from service for annual maintenance (76.5 MW).
- 

**Section 2  
NLH System Island Interconnected Supply and Demand**

| June 3, 2014                              | NLH System Outlook <sup>3</sup> | Five-Day Forecast        | Temperature (°C) |         | NLH System Demand (MW) |         |
|---|---------------------------------|--------------------------|------------------|---------|------------------------|---------|
|   |                                 |                          | Morning          | Evening | Morning                | Evening |
| Available NLH System Supply: <sup>4</sup> | 1,160 MW                        | Tuesday, June 03, 2014   | 4                | 17      | 700                    | 650     |
| Current St. John's Temperature:           | 10 °C                           | Wednesday, June 04, 2014 | 8                | 11      | 725                    | 625     |
| Current St. John's Windchill:             | N/A °C                          | Thursday, June 05, 2014  | 10               | 13      | 675                    | 625     |
| NLH System Peak Demand Forecast:          | 700 MW                          | Friday, June 06, 2014    | 12               | 15      | 650                    | 600     |
|   |                                 | Saturday, June 07, 2014  | 12               | 11      | 700                    | 625     |

**Supply Notes for June 03, 2014<sup>3</sup>**

→

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen. Excludes wind generation and DLP Secondary.

**Section 3  
Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

|              |  |       |        |
|--------------|--|-------|--------|
| June 2, 2014 | Actual NLH System Island Interconnected Peak Demand <sup>1</sup> | 08:05 | 738 MW |
| June 3, 2014 | Forecast NLH System Island Interconnected Peak Demand            |       | 700 MW |
| June 2, 2014 | Actual Total Island Peak Demand <sup>2</sup>                     | 08:25 | 897 MW |
| June 3, 2014 | Forecast Total Island Peak Demand                                |       | 850 MW |

- Notes:
1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.
  2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.