


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed July 04, 2014 (Revised - July 07, 2014)**

**Section 1
NLH System Island Interconnected Supply and Demand
Actual 24 Hour System Performance For July 03, 2014**

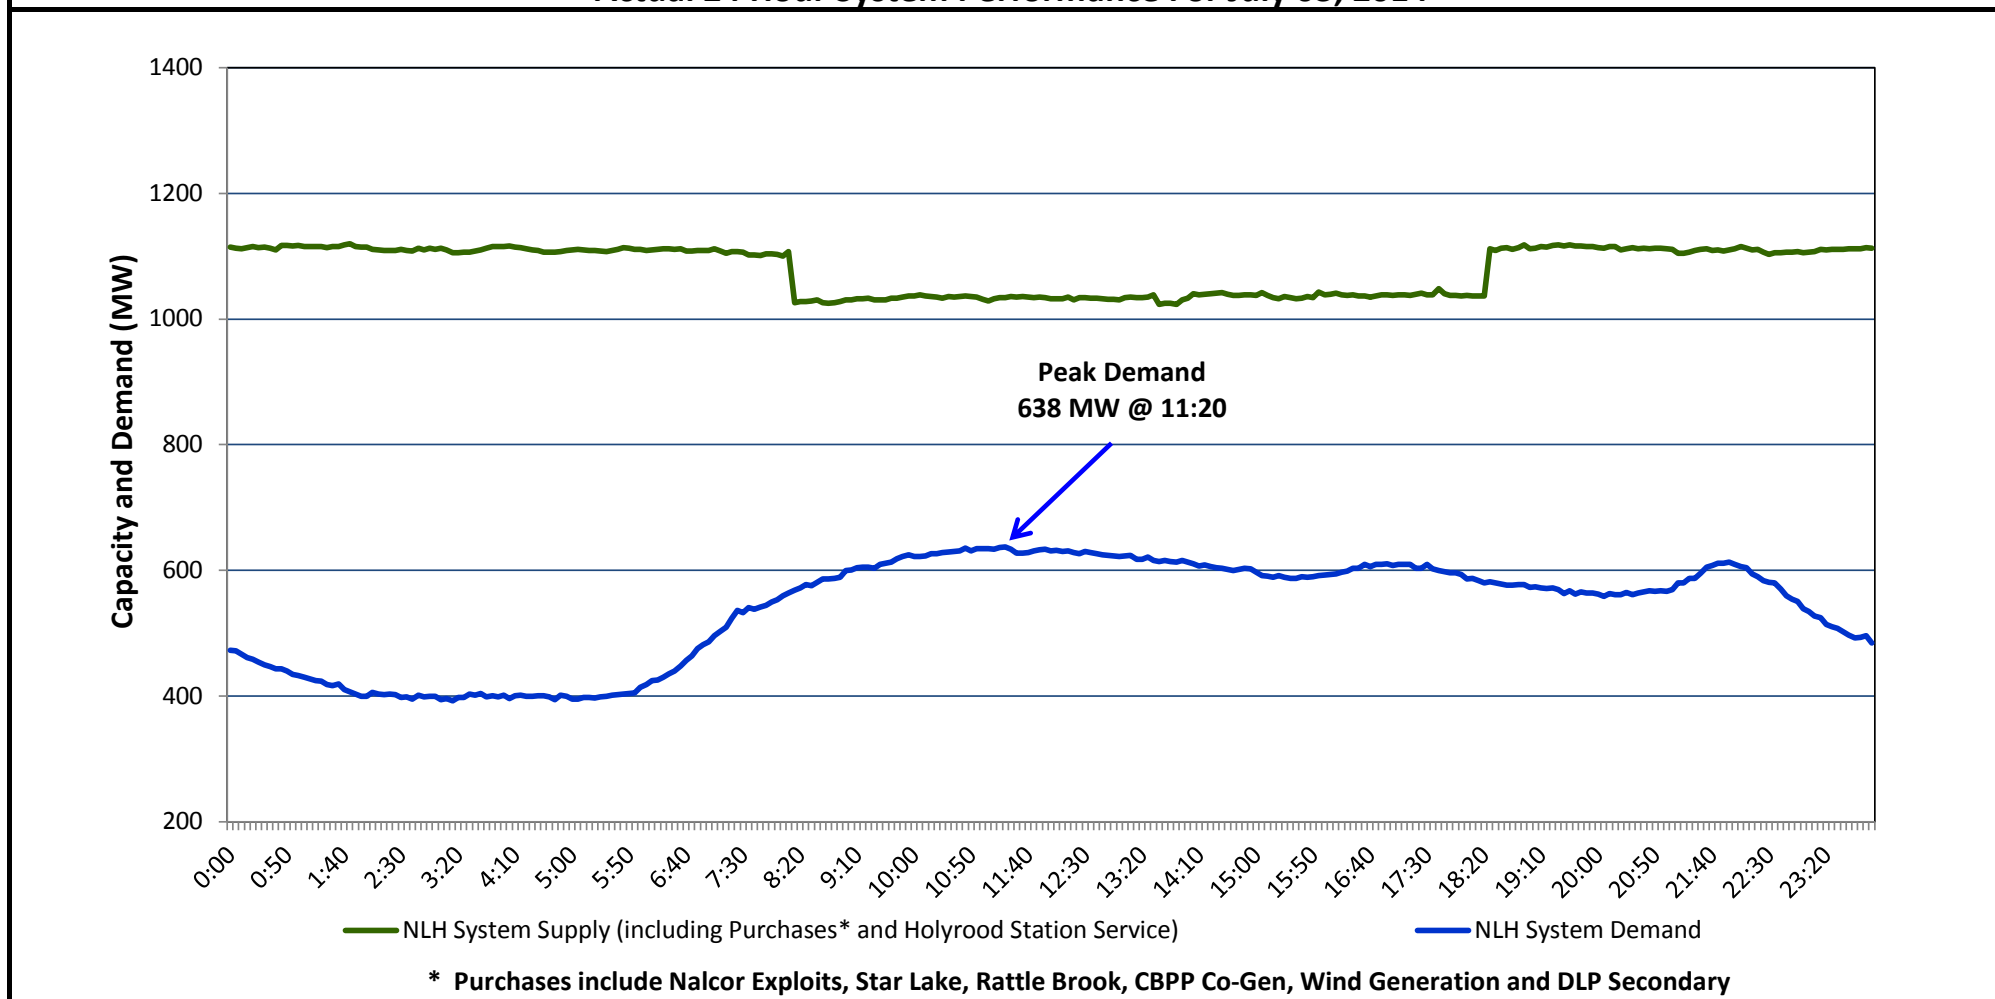

Supply Notes for July 03, 2014

- As of 0422 hours, Feb. 17, 2014, Bay d'Espoir Unit 6 unavailable for service (77 MW).
- As of 1717 hours, April 10, 2014, Holyrood Unit 3 removed from service for annual maintenance (150 MW).
- As of 0800 hours, May 21, 2014, Holyrood Unit 2 removed from service for annual maintenance (165 MW).
- As of 1554 hours, May 24, 2014, Bay d'Espoir Unit 3 removed from service for annual maintenance (76.5 MW).
- As of 0858 hours, June 13, 2014, Stephenville Gas Turbine End A removed from service for annual maintenance (25 MW).
- As of 0810 hours, June 23, 2014, Star Lake Unit removed from service for annual maintenance (18 MW).
- As of 0010 hours, July 02, 2014, Hardwoods Gas Turbine tripped offline and is unavailable (50 MW).
- At 0815 hours, July 03, 2014, Hinds Lake Unit removed from service for maintenance. Unit returned to service at 1823 hours (75 MW).

**Section 2
NLH System Island Interconnected Supply and Demand**

July 4, 2014	NLH System Outlook ³	Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)	
			Morning	Evening	Morning	Evening
Available NLH System Supply: ⁴	995 MW	Friday, July 04, 2014	18	23	625	600
Current St. John's Temperature:	18 °C	Saturday, July 05, 2014	16	20	575	525
Current St. John's Windchill:	N/A °C	Sunday, July 06, 2014	14	14	575	550
NLH System Peak Demand Forecast:	625 MW	Monday, July 07, 2014	13	19	625	625
		Tuesday, July 08, 2014	16	20	600	575

Supply Notes for July 04, 2014³

- At 0659 hours, July 04, 2014, Hinds Lake Unit removed from service for maintenance (75 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen. Excludes wind generation and DLP Secondary.

**Section 3
Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

July 3, 2014	Actual NLH System Island Interconnected Peak Demand ¹	11:20	638 MW
July 4, 2014	Forecast NLH System Island Interconnected Peak Demand		625 MW
July 3, 2014	Actual Total Island Peak Demand ²	11:25	776 MW
July 4, 2014	Forecast Total Island Peak Demand		750 MW

- Notes:
1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.
 2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.