
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed September 29, 2014

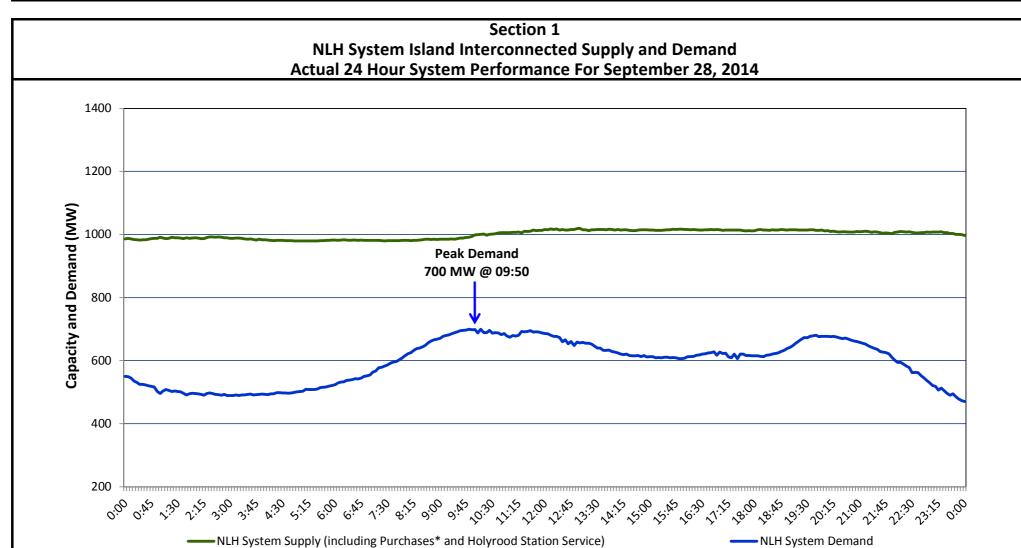

Supply Notes for September 28, 2014

- As of 0858 hours, June 13, 2014, Stephenville Gas Turbine End A removed from service for annual maintenance (25 MW).
- As of 1100 hours, July 21, 2014, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
- As of 1738 hours, August 27, 2014, Cat Arm Unit 1 derated to 53 MW (67 MW).
- As of 1216 hours, September 14, 2014, Bay d'Espoir Unit 7 removed from service for annual maintenance, derated to 100 MW (154 MW).
- As of 1520 hours, September 19, 2014, Stephenville Gas Turbine End B derated to 18 MW (25 MW).
- As of 1812 hours, September 21, 2014, Holyrood Unit 2 removed from service for planned maintenance, (170 MW but previously derated to 110

* Purchases include Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen, Wind Generation and DLP Secondary

- As of 2100 hours, September 22, 2014, Holyrood Unit 3 load tested to 115 MW (150 MW).
- As of 1653 hours, September 25, 2014, Bay d'Espoir Unit 3 removed from service on a forced outage (76.5 MW).

Section 2 NLH System Island Interconnected Supply and Demand									
September 29, 2014 NLH System Outlook ³			Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)			
				Morning	Evening	Morning	Evening		
Available NLH System Supply:4	980	MW	Monday, September 29, 2014	8	6	800	800		
Current St. John's Temperature:	7	°C	Tuesday, September 30, 2014	3	8	800	800		
Current St. John's Windchill:	N/A	°C	Wednesday, October 01, 2014	11	9	650	675		
NLH System Peak Demand Forecast:	800	MW	Thursday, October 02, 2014	5	7	750	750		
			Friday, October 03, 2014	4	10	750	675		

Supply Notes for September 29, 2014³

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.

 - 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen. Excludes wind generation and DLP Secondary.

Section 3 Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
September 28, 2014	Actual NLH System Island Interconnected Peak Demand ¹	09:50	700 MW				
September 29, 2014	Forecast NLH System Island Interconnected Peak Demand		800 MW				
September 28, 2014	Actual Total Island Peak Demand ²	10:00	783 MW				
September 29, 2014	Forecast Total Island Peak Demand		925 MW				

- Notes: 1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.
 - 2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.