
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed October 21, 2014

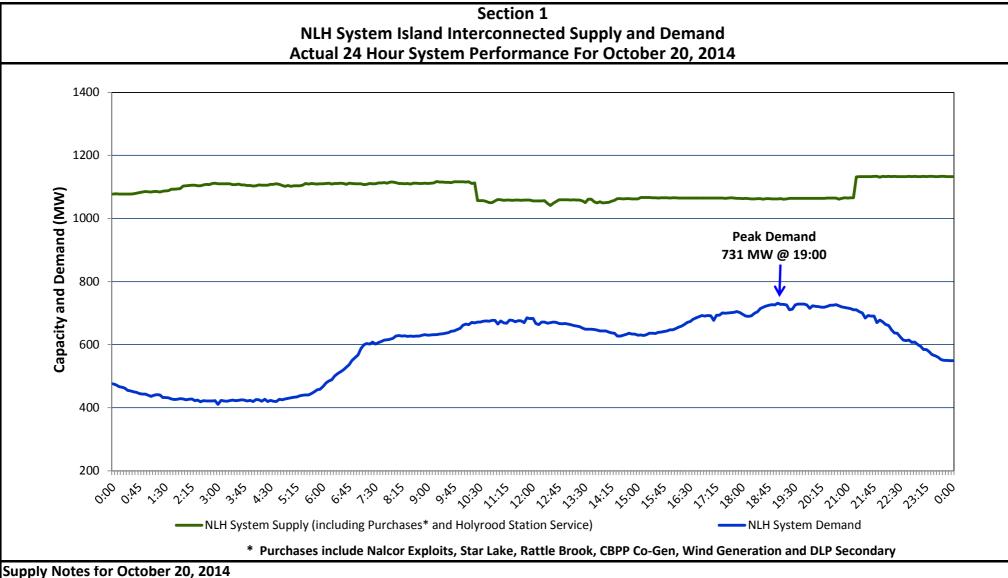

- As of 0858 hours, June 13, 2014, Stephenville Gas Turbine End A removed from service for annual maintenance (25 MW).
- As of 1100 hours, July 21, 2014, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
- As of 1653 hours, September 25, 2014, Bay d'Espoir Unit 3 removed from service on a forced outage (76.5 MW).
- As of 0826 hours, October 04, 2014, Stephenville Gas Turbine End B removed from service. Previously derated to 18 MW (25 MW).
- As of 0858 hours, October 05, 2014, Nalcor Exploits Unit 9 removed from service (30 MW).
- As of 1104 hours, October 06, 2014, Hinds Lake Unit removed from service for annual maintenance (75 MW).
- As of 2119 hours, October 13, 2014, Holyrood Unit 3 removed from service (economic dispatch), previously derated to 135 MW (150 MW).
- As of 1150 hours, October 15, 2014, Holyrood Unit 2 load tested to 145 MW (170 MW).
- At 1010 hours, October 20, 2014, Cat Arm Unit 1 removed from service for maintenance. Unit returned to service at 2113 hours at full capability (67 MW).

Section 2 NLH System Island Interconnected Supply and Demand							
October 21, 2014 NLH System Outlook ³		Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)		
				Morning	Evening	Morning	Evening
Available NLH System Supply:4	1,090	MW	Tuesday, October 21, 2014	7	9	750	775
Current St. John's Temperature:	7	°C	Wednesday, October 22, 2014	5	7	775	825
Current St. John's Windchill:	N/A	°C	Thursday, October 23, 2014	6	9	825	800
NLH System Peak Demand Forecast:	775	MW	Friday, October 24, 2014	9	10	750	800
			Saturday, October 25, 2014	9	13	750	750

Supply Notes for October 21, 2014³

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - 3. As of 0800 Hours.
 - 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen. Excludes wind generation and DLP Secondary.

Section 3							
Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
October 21, 2014	Forecast NLH System Island Interconnected Peak Demand		775 MW				
October 20, 2014	Actual Total Island Peak Demand ²	19:30	853 MW				
October 21. 2014	Forecast Total Island Peak Demand		925 MW				

Notes: 1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.

2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.