


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed November 18, 2014 (Revised - November 24, 2014)

Section 1
NLH System Island Interconnected Supply and Demand
Actual 24 Hour System Performance For November 17, 2014

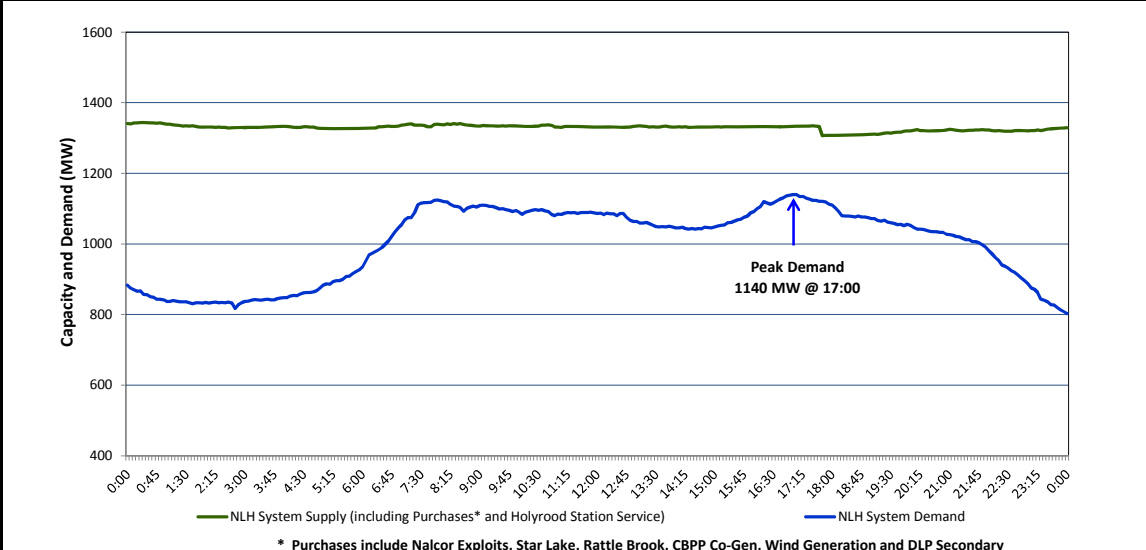

- Supply Notes for November 17, 2014**
- As of 1100 hours, July 21, 2014, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
 - As of 0826 hours, October 04, 2014, Stephenville Gas Turbine End B removed from service. Previously derated to 18 MW (25 MW).
 - As of 0715 hours, November 04, 2014, Bay d'Espoir Unit 5 removed from service for annual maintenance (76.5 MW).
 - As of 0715 hours, November 04, 2014, Bay d'Espoir Unit 6 removed from service for maintenance (76.5 MW).
 - As of 1048 hours, November 10, 2014, Stephenville Gas Turbine End A unavailable due to a forced outage (25 MW).
 - **As of 0730 hours, November 13, 2014, Nalcor Exploits Unit 4 removed from service for maintenance (30 MW).**
 - As of 2000 hours, November 15, 2014, CBPP Capacity assistance available (60 MW).
 - As of 1615 hours, November 16, 2014, Holyrood Unit 2 derating updated to 156 MW (170 MW).
 - At 1735 hours, November 17, 2014, Hardwoods End B unavailable due to a forced outage (25 MW).

Section 2
NLH System Island Interconnected Supply and Demand

November 18, 2014 NLH System Outlook ³	Five-Day Forecast	Temperature (°C)		NLH System Demand (MW)	
		Morning	Evening	Morning	Evening
Available NLH System Supply: ⁴ 1,285 MW	Tuesday, November 18, 2014	7	14	925	900
Current St. John's Temperature: 6 °C	Wednesday, November 19, 2014	5	1	1,000	1,125
Current St. John's Windchill: N/A °C	Thursday, November 20, 2014	0	1	1,050	1,100
NLH System Peak Demand Forecast: 925 MW	Friday, November 21, 2014	4	9	1,000	975
	Saturday, November 22, 2014	3	2	1,025	1,100

- Supply Notes for November 18, 2014³**
-
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved hydraulic output due to water levels (35 MW). Includes Nalcor Exploits, Star Lake, Rattle Brook, CBPP Co-Gen. Excludes wind generation and DLP Secondary.

Section 3
Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak

November 17, 2014	Actual NLH System Island Interconnected Peak Demand ¹	17:00	1,140 MW
November 18, 2014	Forecast NLH System Island Interconnected Peak Demand		925 MW
November 17, 2014	Actual Total Island Peak Demand ²	17:35	1,280 MW
November 18, 2014	Forecast Total Island Peak Demand		1,075 MW

- Notes:
1. NLH System Island Interconnected is supplied by generation owned by NLH as well as NLH Power Purchases as detailed in Section 1 above.
 2. Total Island System Demand is supplied by NLH generation and NLH Power Purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper to meet their respective supply needs.