
Newfoundland Labrador Hydro (NLH)

Supply and Demand Status Report Filed Friday, December 12, 2014 (Revised - Dec. 15, 2014)

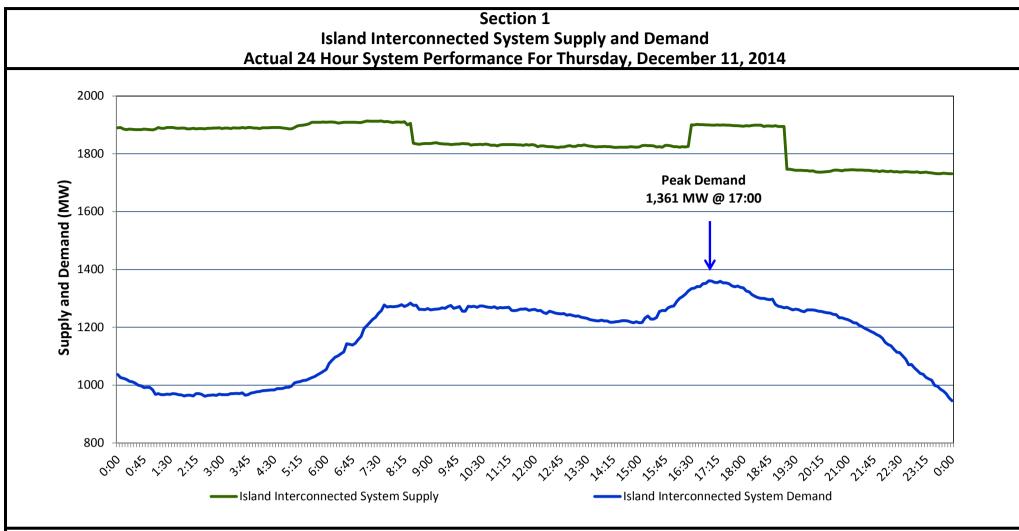

Supply Notes for December 11, 2014^{1,2}

- As of 1000 hours, November 21, 2014, Nalcor Exploits Unit 4 unavailable due to a forced outage (30 MW). Net impact to system 4 MW (the excess water utilised by other Nalcor Grand Falls Units 5 to 8).
- At 0816 hours, December 11, 2014, the Hinds Lake Unit was removed from service for maintenance. Unit returned to service at 1625 hours (75
- At 1220 hours, December 11, 2014, Vale Capacity Assistance Available (11.0 MW).
- At 1913 hours, December 11, 2014, Holyrood Unit 3 was removed from service for maintenance (150 MW).

Section 2 Island Interconnected Supply and Demand									
Fri, Dec 12, 2014 Island System Outlook ³		Seven-Day Forecast	(°C)		Peak Demand (MW)				
				Morning	Evening	Forecast	Adjusted ⁶		
Available Island System Supply:	1,880	MW	Friday, December 12, 2014	7	7	1,050	980		
NLH: ⁴	1,660	MW	Saturday, December 13, 2014	7	8	1,075	1,000		
Other Island Generation:	220	MW	Sunday, December 14, 2014	9	7	1,075	1,000		
			Monday, December 15, 2014	7	5	1,310	1,235		
Current St. John's Temperature	: 6	°C	Tuesday, December 16, 2014	0	1	1,325	1,250		
Current St. John's Windchill:	N/A	$^{\circ}$ C	Wednesday, December 17, 2014	1	1	1,360	1,285		
7-Day Island Peak Demand Fore	ecast: 1,375	MW	Thursday, December 18, 2014	2	3	1,375	1,300		

Supply Notes for December 12, 2014³

3. As of 0800 Hours.

At 0325 hours, December 12, 2014, Holyrood Unit 3 was returned to service (150 MW).

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.

Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW). Includes NLH Power

- Purchases.
- Gross output from all Island sources (including Note 4).
- Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak						
Thu, Dec 11, 2014	Actual Island Peak Demand ⁷	17:00	1,361 MW			
Fri, Dec 12, 2014	Forecast Island Peak Demand		1,050 MW			

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).