


Newfoundland Labrador Hydro (NLH)

Supply and Demand Status Report Filed Monday, December 22, 2014

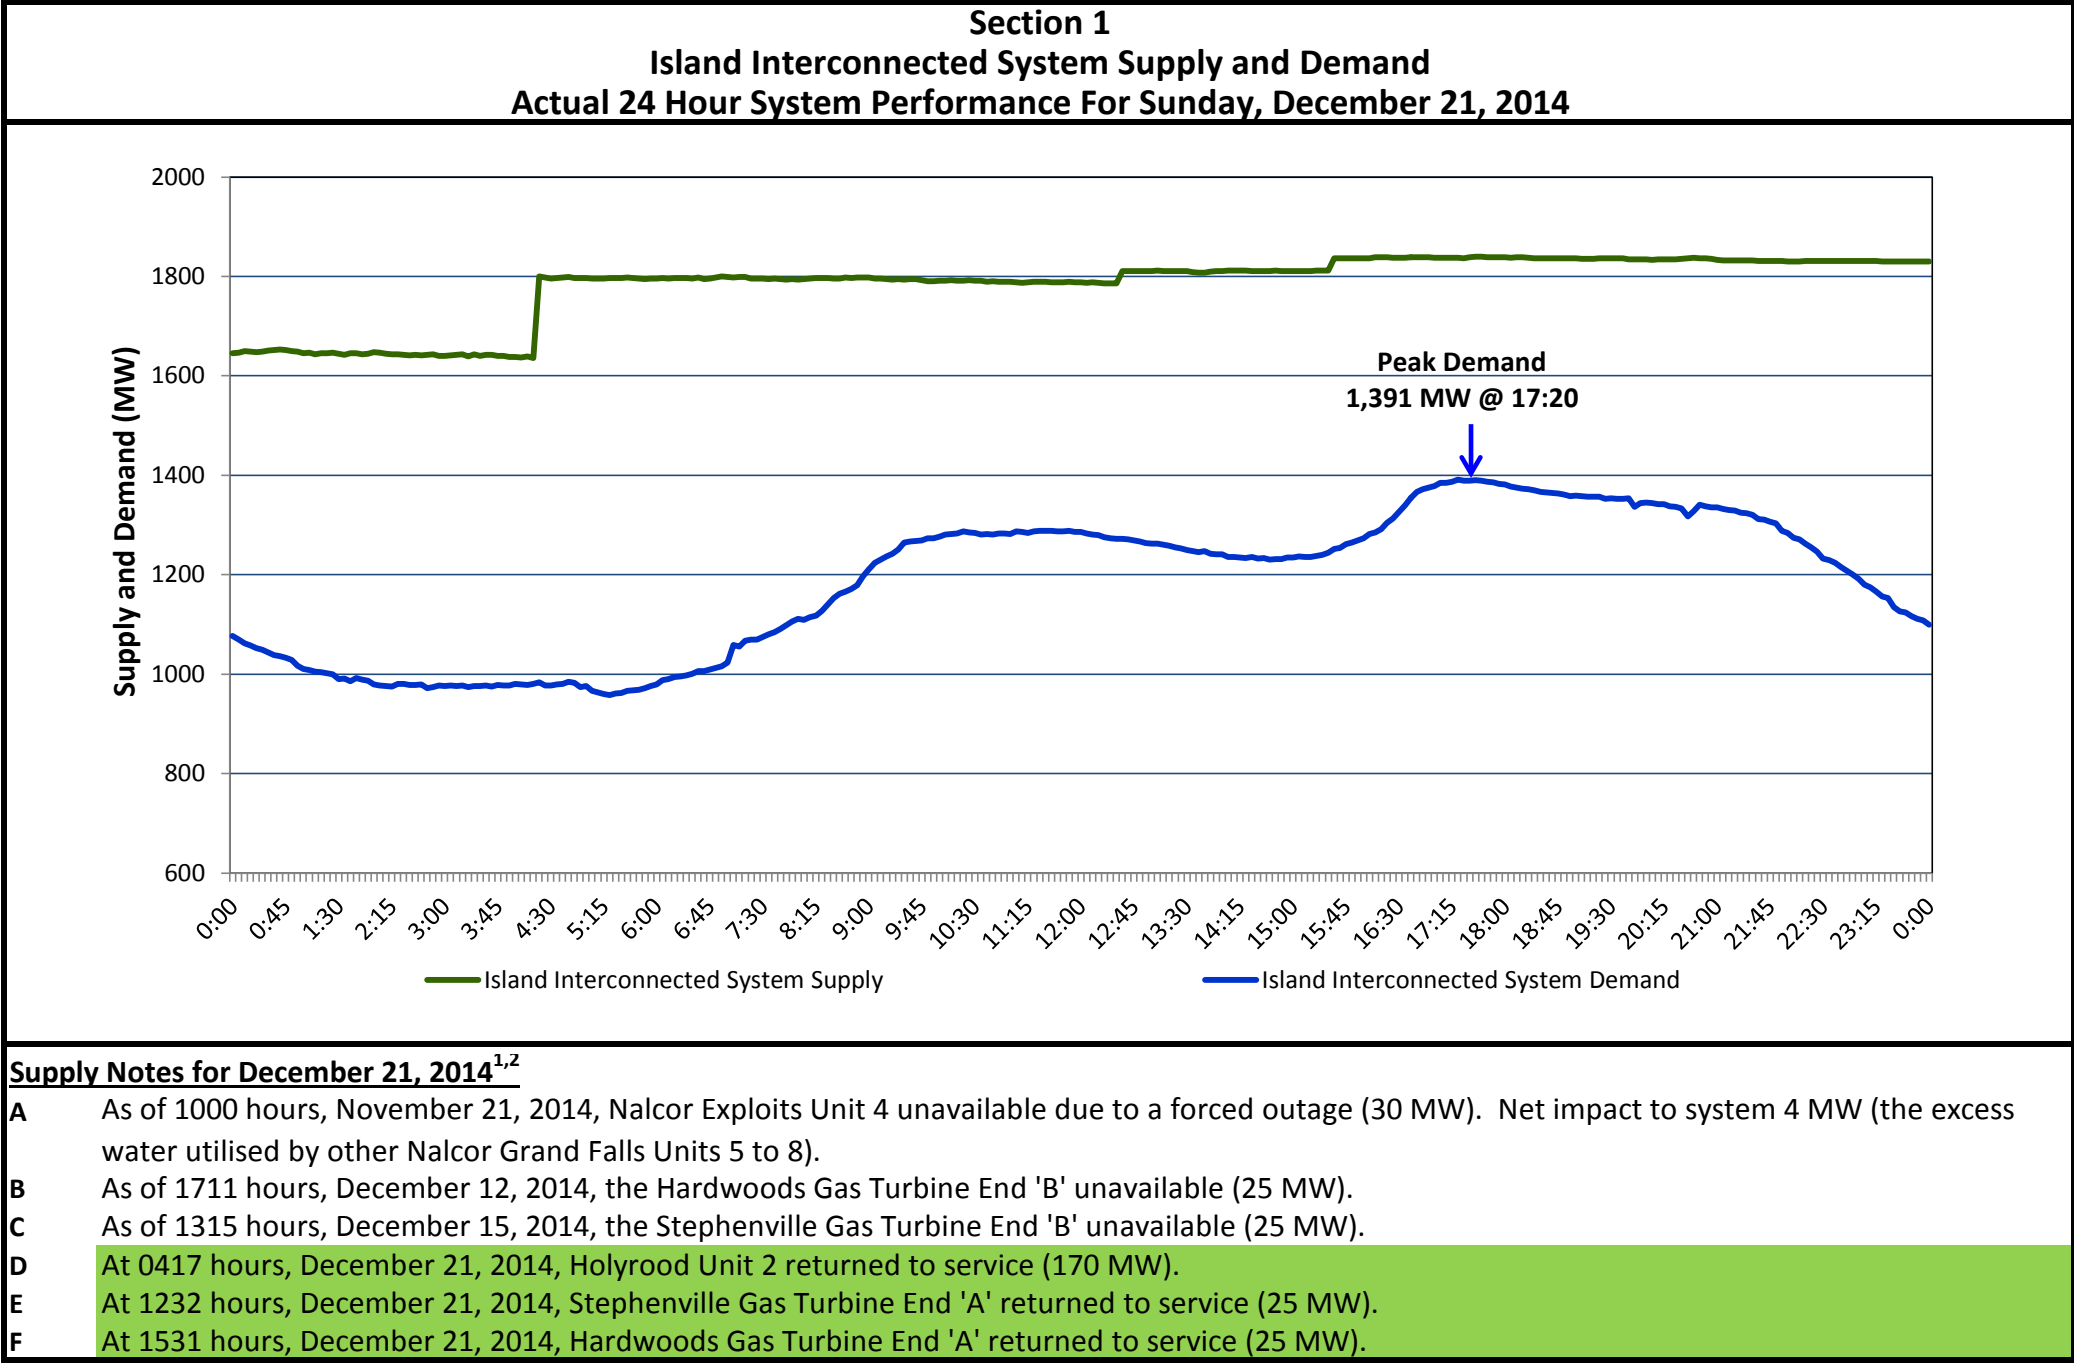

Section 2

Island Interconnected Supply and Demand

Mon, Dec 22, 2014		Island System Outlook ³		Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)	
						Morning	Evening	Forecast	Adjusted ^o
Available Island System Supply: ⁵		1,855	MW	Monday, December 22, 2014		-2	-3	1,450	1,375
NLH Generation: ⁴		1,520	MW	Tuesday, December 23, 2014		-3	-2	1,350	1,275
NLH Power Purchases:		110	MW	Wednesday, December 24, 2014		-3	-2	1,400	1,325
Other Island Generation:		225	MW	Thursday, December 25, 2014		-1	3	1,375	1,300
Current St. John's Temperature:		-3	°C	Friday, December 26, 2014		5	2	1,325	1,250
Current St. John's Windchill:		-9	°C	Saturday, December 27, 2014		1	3	1,300	1,225
7-Day Island Peak Demand Forecast:		1,450	MW	Sunday, December 28, 2014		1	4	1,250	1,175

Supply Notes for December 22, 2014³

Notes:

1.

Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.

2.

Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.

3.

As of 0800 Hours.

4.

Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).

5.

Gross output from all Island sources (including Note 4).

6.

Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.

Section 3

Island Peak Demand Information

Previous Day Actual Peak and Current Day Forecast Peak

Sun, Dec 21, 2014	Actual Island Peak Demand ⁷	17:20	1,391 MW
Mon, Dec 22, 2014	Forecast Island Peak Demand		1,450 MW

Notes:

7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).