
## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Thursday, February 05, 2015

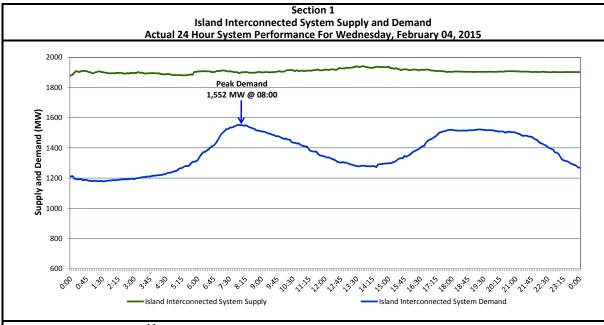

## Supply Notes for February 04, 2015<sup>1,2</sup>

- As of 1016 hours, January 30, 2015, St. Anthony Diesel Plant G5 (Unit 546) unavailable (2 MW).
- At 0009 hours, February 04, 2015, Nalcor Exploits Grand Falls Unit 9 returned to service (30 MW).
  - At 1258 hours, February 04, 2015, the Paradise River Unit became available (8 MW).
- At 1305 hours, February 04, 2015, Hawke's Bay Diesel Plant G1 available (2.5 MW).
- At 1305 hours, February 04, 2015, Hawke's Bay Diesel Plant G2 available (2.5 MW).

Section 2 Island Interconnected Supply and Demand									
Thu, Feb 05, 2015 Island System Outlook <sup>3</sup>				Temperature (°C)		Island System Daily Peak Demand (MW)			
				Morning	Evening	Forecast	Adjusted <sup>6</sup>		
Available Island System Supply:5	1,895	MW	Thursday, February 05, 2015	-10	-2	1,625	1,525		
NLH Generation: <sup>4</sup>	1,565	MW	Friday, February 06, 2015	3	4	1,325	1,230		
NLH Power Purchases:	120	MW	Saturday, February 07, 2015	-10	-6	1,475	1,380		
Other Island Generation:	210	MW	Sunday, February 08, 2015	-6	-10	1,535	1,435		
Current St. John's Temperature:	-12	°C	Monday, February 09, 2015	-12	-9	1,550	1,450		
Current St. John's Windchill:	-18	°C	Tuesday, February 10, 2015	-7	-6	1,480	1,385		
7-Day Island Peak Demand Forecast:	1,625	MW	Wednesday, February 11, 2015	5	-1	1,390	1,295		

## Supply Notes for February 05, 2015<sup>3</sup>

- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.

  - 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  - 5. Gross output from all Island sources (including Note 4).
  - Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Wed, Feb 04, 2015	Actual Island Peak Demand <sup>7</sup>	08:00	1,552 MW				
Thu, Feb 05, 2015	Forecast Island Peak Demand		1,625 MW				

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).