

Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Tuesday, March 03, 2015



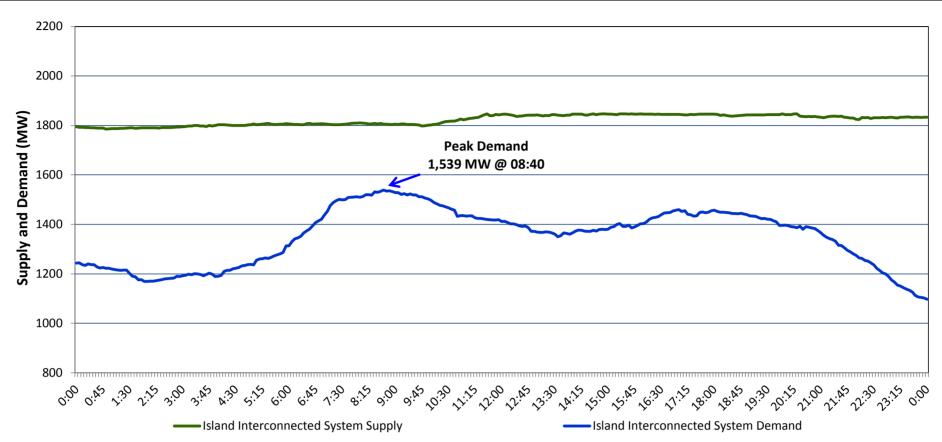

Supply Notes For March 02, 2015

- As of 1522 hours, February 27, 2015, Holyrood Unit 1 removed from service (170 MW).
- As of 1823 hours, March 01, 2015, Hardwoods Gas Turbine unavailable (50 MW).
 - At 1113 hours, March 02, 2015, St. Anthony Diesel Plant G3 (Unit 522) unavailable (1 MW).
- At 1527 hours, March 02, 2015, St. Anthony Diesel Plant G3 (Unit 522) returned to service (1 MW).

Section 2 Island Interconnected Supply and Demand									
Tue, Mar 03, 2015 Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)				
				Morning	Evening	Forecast	Adjusted ⁶		
Available Island System Supply:5	1,810	MW	Tuesday, March 03, 2015	-3	-8	1,490	1,395		
NLH Generation: ⁴	1,475	MW	Wednesday, March 04, 2015	-12	0	1,570	1,470		
NLH Power Purchases:	135	MW	Thursday, March 05, 2015	-2	-3	1,385	1,290		
Other Island Generation:	200	MW	Friday, March 06, 2015	-14	-12	1,650	1,550		
Current St. John's Temperature:	-4	°C	Saturday, March 07, 2015	-13	-7	1,515	1,415		
Current St. John's Windchill:	-15	$^{\circ}$ C	Sunday, March 08, 2015	-3	-5	1,350	1,255		
7-Day Island Peak Demand Forecast:	1,650	MW	Monday, March 09, 2015	-10	-12	1,515	1,415		

Supply Notes For March 03, 2015

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - 3. As of 0800 Hours.
 - 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - 5. Gross output from all Island sources (including Note 4).
 - 6. Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Mon, Mar 02, 2015	Actual Island Peak Demand ⁷	08:40	1,539 MW				
Tue, Mar 03, 2015	Forecast Island Peak Demand		1,490 MW				

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).