

## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, June 01, 2015



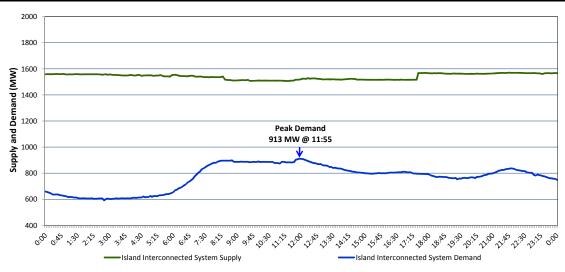

## Supply Notes For May 29, 2015

1,2

- As of 1823 hours, March 01, 2015, Hardwoods Gas Turbine End B unavailable (25 MW).
- As of 1333 hours, April 10, 2015, Holyrood Unit 3 removed from service for annual maintenance (150 MW).
- C As of 0843 hours, April 26, 2015, Bay d'Espoir Unit 1 removed from service for annual maintenance (76.5 MW).
- D As of 0808 hours, May 27, 2015, Bay d'Espoir Unit 5 removed from service for annual maintenance (76.5 MW).
- As of 0808 hours, May 27, 2015, Bay d'Espoir Unit 6 removed from service for annual maintenance (76.5 MW).
- At 0824 hours, May 29, 2015, Hardwoods Gas Turbine End A unavailable (25 MW).
- At 1726 hours, May 29, 2015, Stephenville Gas Turbine returned to service (50 MW)

Section 2 Island Interconnected Supply and Demand								
Sat, May 30, 2015 Island System Outlook <sup>3</sup>			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)		
				Morning	Evening	Forecast		
Available Island System Supply:5	1,600	MW	Saturday, May 30, 2015	7	13	865		
NLH Generation: <sup>4</sup>	1,265	MW	Sunday, May 31, 2015	13	12	835		
NLH Power Purchases:	115	MW	Monday, June 01, 2015	4	5	1,000		
Other Island Generation:	220	MW	Tuesday, June 02, 2015	8	10	900		
Current St. John's Temperature:	8	°C	Wednesday, June 03, 2015	7	13	960		
Current St. John's Windchill:	N/A	°C	Thursday, June 04, 2015	9	11	915		
7-Day Island Peak Demand Forecast:	1,000	MW	Friday, June 05, 2015	12	15	820		

Supply Notes For May 30, 2015

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  - 3. As of 0800 Hours.
  - 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  - 5. Gross output from all Island sources (including Note 4).

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Fri, May 29, 2015	Actual Island Peak Demand <sup>7</sup>	11:55	913 MW				
Sat, May 30, 2015	Forecast Island Peak Demand		865 MW				

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).