


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Wednesday, June 03, 2015**

**Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Tuesday, June 02, 2015**

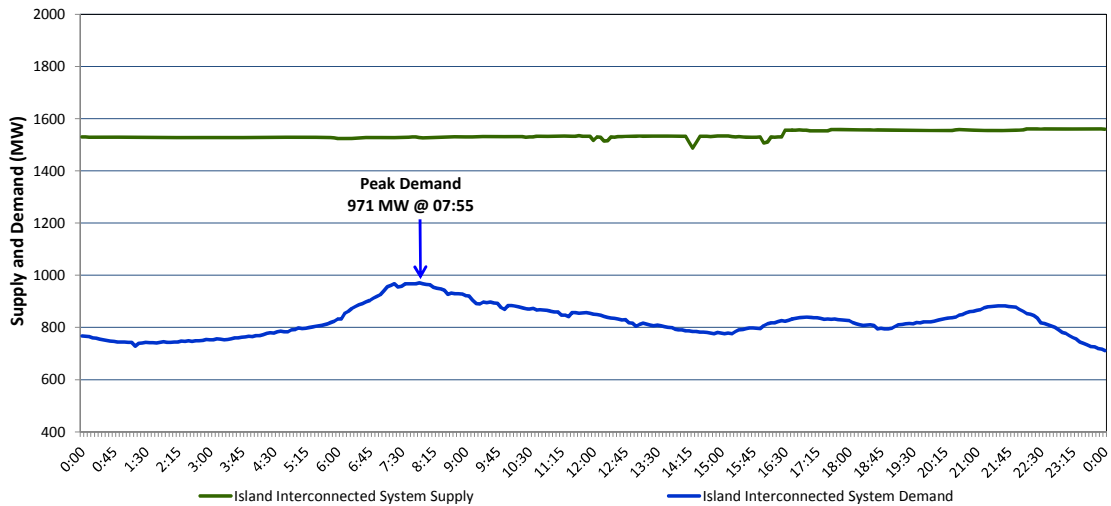

Supply Notes For June 02, 2015

- ^{1,2}
- A As of 1823 hours, March 01, 2015, Hardwoods Gas Turbine End B unavailable (25 MW).
 - B As of 1333 hours, April 10, 2015, Holyrood Unit 3 removed from service for annual maintenance (150 MW).
 - C As of 0843 hours, April 26, 2015, Bay d'Espoir Unit 1 removed from service for annual maintenance (76.5 MW).
 - D As of 0808 hours, May 27, 2015, Bay d'Espoir Unit 5 removed from service for annual maintenance (76.5 MW).
 - E As of 0808 hours, May 27, 2015, Bay d'Espoir Unit 6 removed from service for annual maintenance (76.5 MW).
 - F As of 0824 hours, May 29, 2015, Hardwoods Gas Turbine End A unavailable (25 MW).
 - G At 1631 hours, June 2, 2015, Bay d'Espoir Unit 2 resumed normal loading (76.5 MW).

**Section 2
Island Interconnected Supply and Demand**

Wed, Jun 03, 2015	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW) Forecast
			Morning	Evening	
Available Island System Supply: ⁵	1,580 MW	Wednesday, June 03, 2015	6	4	960
NLH Generation: ⁴	1,265 MW	Thursday, June 04, 2015	3	3	990
NLH Power Purchases:	115 MW	Friday, June 05, 2015	7	7	900
Other Island Generation:	200 MW	Saturday, June 06, 2015	8	8	880
Current St. John's Temperature:	6 °C	Sunday, June 07, 2015	8	8	880
Current St. John's Windchill:	N/A °C	Monday, June 08, 2015	11	12	825
7-Day Island Peak Demand Forecast:	990 MW	Tuesday, June 09, 2015	9	8	885

Supply Notes For June 03, 2015

- ³
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Jun 02, 2015	Actual Island Peak Demand ⁷	07:55	971 MW
Wed, Jun 03, 2015	Forecast Island Peak Demand		960 MW

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).