


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Wednesday, August 26, 2015

### Section 1 Island Interconnected System Supply and Demand Actual 24 Hour System Performance For Tuesday, August 25, 2015

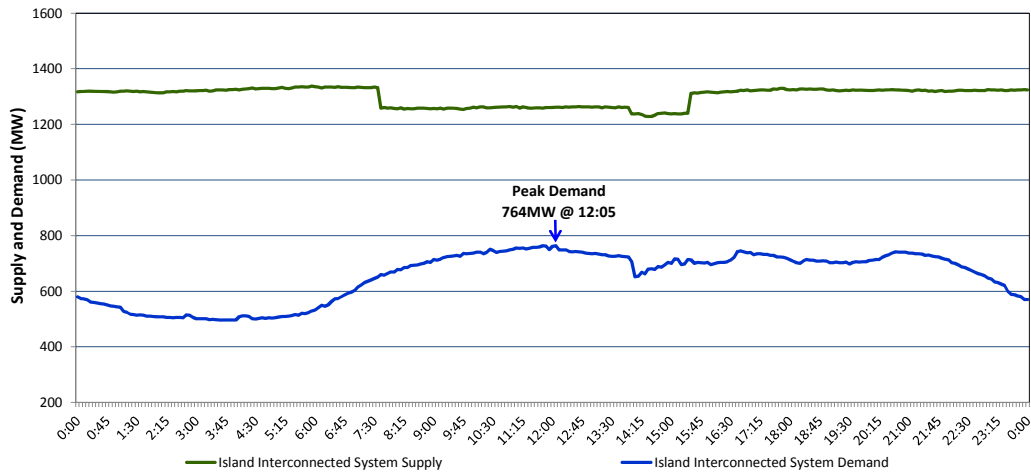

#### Supply Notes For August 25, 2015

- A As of 1440 hours, June 06, 2015, Holyrood Unit 2 removed from service for annual maintenance (170 MW).
- B As of 1450 hours, June 24, 2015, Hawke's Bay Unit 548 (G2) unavailable (2.5 MW).
- C As of 1225 hours, July 30, 2015, Stephenville Gas Turbine derated to 30 MW (50 MW). End A 25 MW, End B 15 MW.
- D As of 1602 hours, July 31, 2015, Hardwoods Gas Turbine derated to 38 MW (50 MW). End A 20 MW, End B 19 MW.
- E As of 0949 hours, August 01, 2015, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
- F As of 0816 hours, August 07, 2015, Nalcor Grand Falls Unit 9 unavailable (30 MW). Net loss to the system is 4 MW.
- G As of 0912 hours, August 16, 2015, Bay d'Espoir Unit 7 removed from service for annual maintenance (154.4 MW).
- H As of 1330 hours, August 19, 2015, Bay d'Espoir Unit 2 unavailable (76.5 MW).
- I As of 1942 hours, August 20, 2015, Bay d'Espoir Unit 1 derated to 45 MW (76.5 MW).
- J As of 1728 hours, August 22, 2015, Star Lake Unit unavailable (18 MW).
- K At 0736 hours, August 25, 2015, Hinds Lake Unit unavailable (75 MW).
- L At 1527 hours, August 25, 2015, Hinds Lake Unit available (75 MW).

### Section 2 Island Interconnected Supply and Demand

Wed, Aug 26, 2015 Island System Outlook <sup>3</sup>		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)
			Morning	Evening	
Available Island System Supply: <sup>5</sup>	1,330 MW	Wednesday, August 26, 2015	12	11	770
NLH Generation: <sup>4</sup>	1,055 MW	Thursday, August 27, 2015	13	14	770
NLH Power Purchases:	65 MW	Friday, August 28, 2015	15	19	780
Other Island Generation:	210 MW	Saturday, August 29, 2015	15	16	740
Current St. John's Temperature:	11 °C	Sunday, August 30, 2015	12	14	750
Current St. John's Windchill:	N/A °C	Monday, August 31, 2015	15	16	795
7-Day Island Peak Demand Forecast:	795 MW	Tuesday, September 01, 2015	14	14	780

#### Supply Notes For August 26, 2015

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Tue, Aug 25, 2015	Actual Island Peak Demand <sup>7</sup>	12:05	764 MW
Wed, Aug 26, 2015	Forecast Island Peak Demand		770 MW

- Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).