


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, September 14, 2015

Section 1 Island Interconnected System Supply and Demand Actual 24 Hour System Performance For Saturday, September 12, 2015

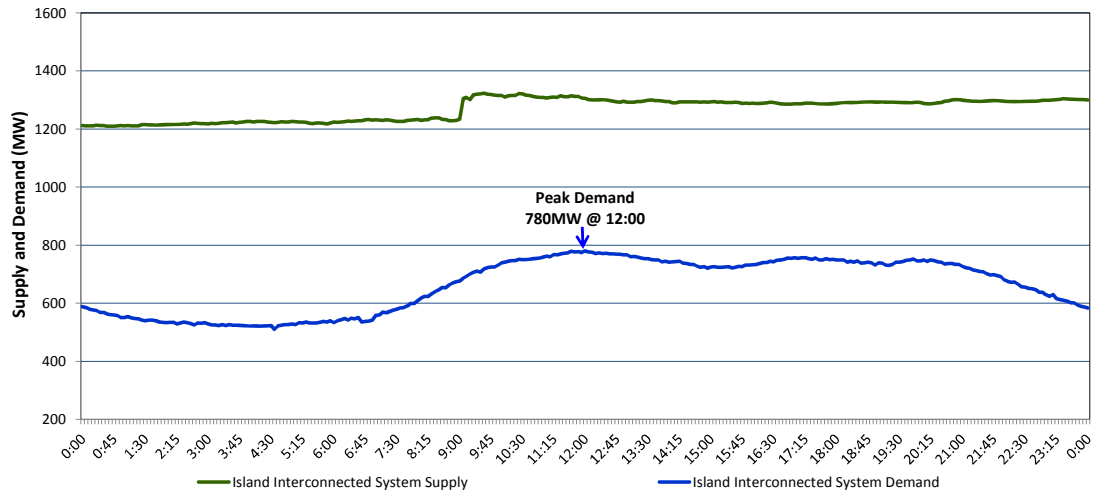

Supply Notes For September 12, 2015

- 1,2
- A** As of 1440 hours, June 06, 2015, Holyrood Unit 2 removed from service for annual maintenance (170 MW).
B As of 1450 hours, June 24, 2015, Hawke's Bay Unit 548 (G2) unavailable (2.5 MW).
C As of 1602 hours, July 31, 2015, Hardwoods Gas Turbine derated to 38 MW (50 MW). End A 20 MW, End B 19 MW.
D As of 0949 hours, August 01, 2015, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
E As of 1330 hours, August 19, 2015, Bay d'Espoir Unit 2 unavailable (76.5 MW).
F As of 1042 hours, August 31, 2015, Stephenville Gas Turbine unavailable. Previously derated to 30 MW (50 MW).
G As of 1510 hours, September 02, 2015, Bay d'Espoir Unit 1 available. Derated to 45 MW (76.5 MW).
H As of 0808 hours, September 08, 2015, Cat Arm Unit 2 unavailable (67 MW).
I At 0904 hours, September 12, 2015, Holyrood Unit 3 available. Derated to 70 MW (150 MW).
J At 0918 hours, September 12, 2015, Star Lake Unit available (18 MW).

Section 2 Island Interconnected System Supply and Demand

Sun, Sep 13, 2015		Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)
				Morning	Evening	
Available Island System Supply: ⁵	1,280	MW	Sunday, September 13, 2015	17	18	755
NLH Generation: ⁴	1,035	MW	Monday, September 14, 2015	13	12	805
NLH Power Purchases:	55	MW	Tuesday, September 15, 2015	14	17	785
Other Island Generation:	190	MW	Wednesday, September 16, 2015	11	10	875
Current St. John's Temperature:	16	°C	Thursday, September 17, 2015	8	10	870
Current St. John's Windchill:	N/A	°C	Friday, September 18, 2015	13	15	775
7-Day Island Peak Demand Forecast:	875	MW	Saturday, September 19, 2015	9	13	765

Supply Notes For September 13, 2015

- 3
- K** At 0654 hours, September 13, 2015, Star Lake Unit unavailable (18 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Sat, Sep 12, 2015	Actual Island Peak Demand ⁷	12:00	780 MW
Sun, Sep 13, 2015	Forecast Island Peak Demand		755 MW

- Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).