
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Tuesday, October 06, 2015

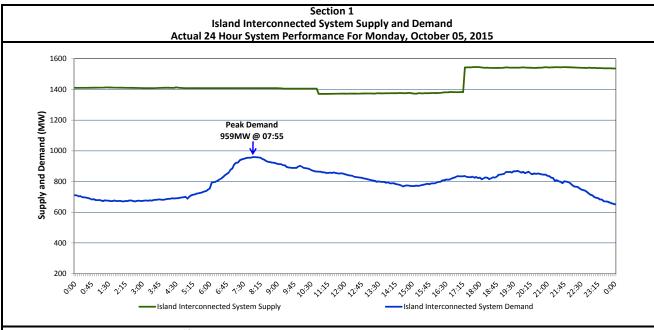

Supply Notes For October 05, 2015

- As of 1450 hours, June 24, 2015, Hawke's Bay Unit 548 (G2) unavailable (2.5 MW).
- As of 0949 hours, August 01, 2015, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
- As of 1330 hours, August 19, 2015, Bay d'Espoir Unit 2 unavailable (76.5 MW).
- As of 1042 hours, August 31, 2015, Stephenville Gas Turbine unavailable. Previously derated to 30 MW (50 MW).
- As of 1605 hours, September 27, 2015, Bay d'Espoir Unit 4 unavailable (76.5 MW).
- At 1046 hours, October 05, 2015, Hardwoods Gas Turbine unavailable. Previously derated to 38 MW (50 MW). End A 20 MW, End B 19 MW. At 1716 hours, October 05, 2015, Holyrood Unit 2 available (170 MW).

Section 2 Island Interconnected Supply and Demand								
Tue, Oct 06, 2015 Island System Outlook ³		Seven-Day Forecast	_ i _ · .	erature C)	Island System Daily Peak Demand (MW)			
				Morning	Evening	Forecast		
Available Island System Supply:5	1,540	MW	Tuesday, October 06, 2015	10	9	870		
NLH Generation: ⁴	1,270	MW	Wednesday, October 07, 2015	8	7	885		
NLH Power Purchases:	90	MW	Thursday, October 08, 2015	9	9	875		
Other Island Generation:	180	MW	Friday, October 09, 2015	7	8	940		
Current St. John's Temperature:	9	°C	Saturday, October 10, 2015	9	12	860		
Current St. John's Windchill:	N/A	°C	Sunday, October 11, 2015	7	6	990		
7-Day Island Peak Demand Foreca	st: 990	MW	Monday, October 12, 2015	11	10	870		

Supply Notes For October 06, 2015

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - As of 0800 Hours.
 - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - 5. Gross output from all Island sources (including Note 4).

Section 3 Island Peak Demand Information						
Previous Day Actual Peak and Current Day Forecast Peak						
Mon, Oct 05, 2015	Actual Island Peak Demand ⁷	07:55	959 MW			
Tue, Oct 06, 2015	Forecast Island Peak Demand		870 MW			

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power,