

# Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, October 19, 2015



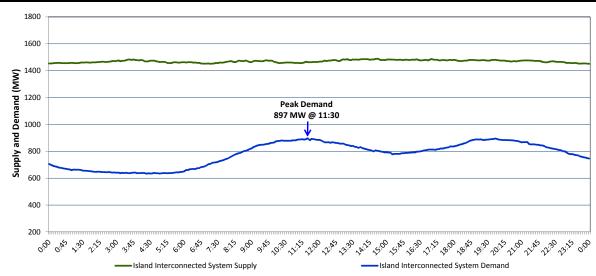

### Supply Notes For October 17, 2015

- A As of 0949 hours, August 01, 2015, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
- B As of 1042 hours, August 31, 2015, Stephenville Gas Turbine unavailable. Previously derated to 30 MW (50 MW).
- As of 1605 hours, September 27, 2015, Bay d'Espoir Unit 4 unavailable (76.5 MW).
- D As of 1527 hours, October 07, 2015, Holyrood Unit 3 removed from service for economic dispatch (150 MW).

1,145

- As of 1608 hours, October 09, 2015, Hardwoods Gas Turbine available. Derated to 38 MW (50 MW). End A 20 MW, End B 19 MW.
- F As of 1610 hours, October 11, 2015, Bay d'Espoir Unit 3 unavailable (76.5 MW)

### Section 2 **Island Interconnected Supply and Demand** Temperature **Island System Daily** Island System Outlook<sup>3</sup> Sun, Oct 18, 2015 (°C) Peak Demand (MW) Seven-Day Forecast Morning **Evening** Forecast Available Island System Supply: 1,460 1,000 MW Sunday, October 18, 2015 10 1,040 NLH Generation: 1.160 MW Monday, October 19, 2015 7 6 **NLH Power Purchases:** 100 MW Tuesday, October 20, 2015 4 4 1,045 Other Island Generation: 200 MW Wednesday, October 21, 2015 10 6 1.010 Current St. John's Temperature: 2 °C Thursday, October 22, 2015 5 6 1,080 °C Current St. John's Windchill: N/A Friday, October 23, 2015 6 8 1,050

## 7-Day Island Peak Demand Forecast: Supply Notes For October 18, 2015

- otes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.

Saturday, October 24, 2015

1,145

- 3. As of 0800 Hour
- 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).

MW

5. Gross output from all Island sources (including Note 4)

# Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak Sat, Oct 17, 2015 Actual Island Peak Demand 11:30 897 MW Sun, Oct 18, 2015 Forecast Island Peak Demand 1,000 MW

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).