

Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, October 26, 2015



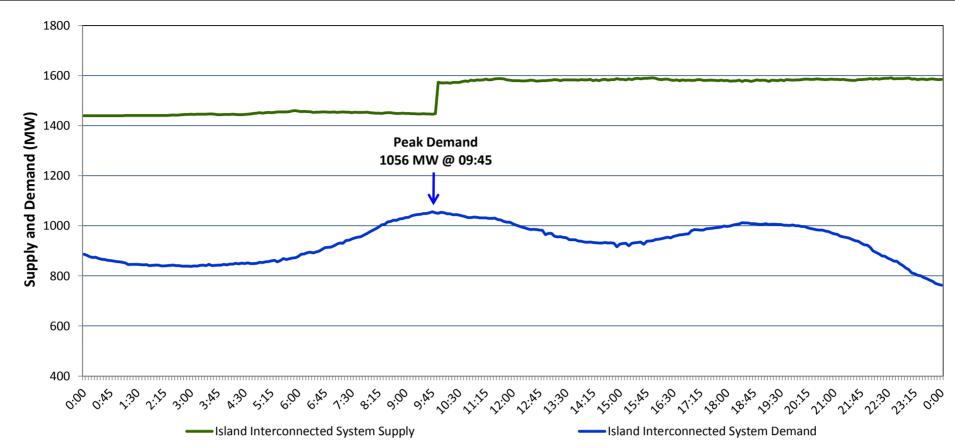

Supply Notes For October 25, 2015

- As of 0949 hours, August 01, 2015, Holyrood Unit 1 removed from service for annual maintenance (170 MW).
- As of 1042 hours, August 31, 2015, Stephenville Gas Turbine unavailable. Previously derated to 30 MW (50 MW).
- C As of 1605 hours, September 27, 2015, Bay d'Espoir Unit 4 unavailable (76.5 MW).
- As of 1610 hours, October 11, 2015, Bay d'Espoir Unit 3 unavailable (76.5 MW).
- At 0954 hours, October 25, 2015, Holyrood Combustion Turbine available (123.5 MW)

Section 2 **Island Interconnected Supply and Demand** Temperature **Island System Daily** Island System Outlook³ Mon, Oct 26, 2015 (°C) Peak Demand (MW) Seven-Day Forecast Morning **Evening Forecast** Available Island System Supply:5 1,600 MW Monday, October 26, 2015 1,060 11 NLH Generation:⁴ 1,310 MWTuesday, October 27, 2015 2 1,120 1 **NLH Power Purchases:** 85 MW Wednesday, October 28, 2015 0 2 1,260 Other Island Generation: 205 MWThursday, October 29, 2015 3 1,115 1 Current St. John's Temperature: $^{\circ}$ C Friday, October 30, 2015 12 9 910 $^{\circ}$ C 1,095 Current St. John's Windchill: N/A Saturday, October 31, 2015 5 4 7-Day Island Peak Demand Forecast: Sunday, November 01, 2015 1,260 MW 1,155

Supply Notes For October 26, 2015

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - 3. As of 0800 Hours
 - 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - 5. Gross output from all Island sources (including Note 4).

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak			
Sun, Oct 25, 2015	Actual Island Peak Demand ⁷	09:45	1,056 MW
Mon, Oct 26, 2015	Forecast Island Peak Demand		1,060 MW

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).