


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Wednesday, December 23, 2015

Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Tuesday, December 22, 2015

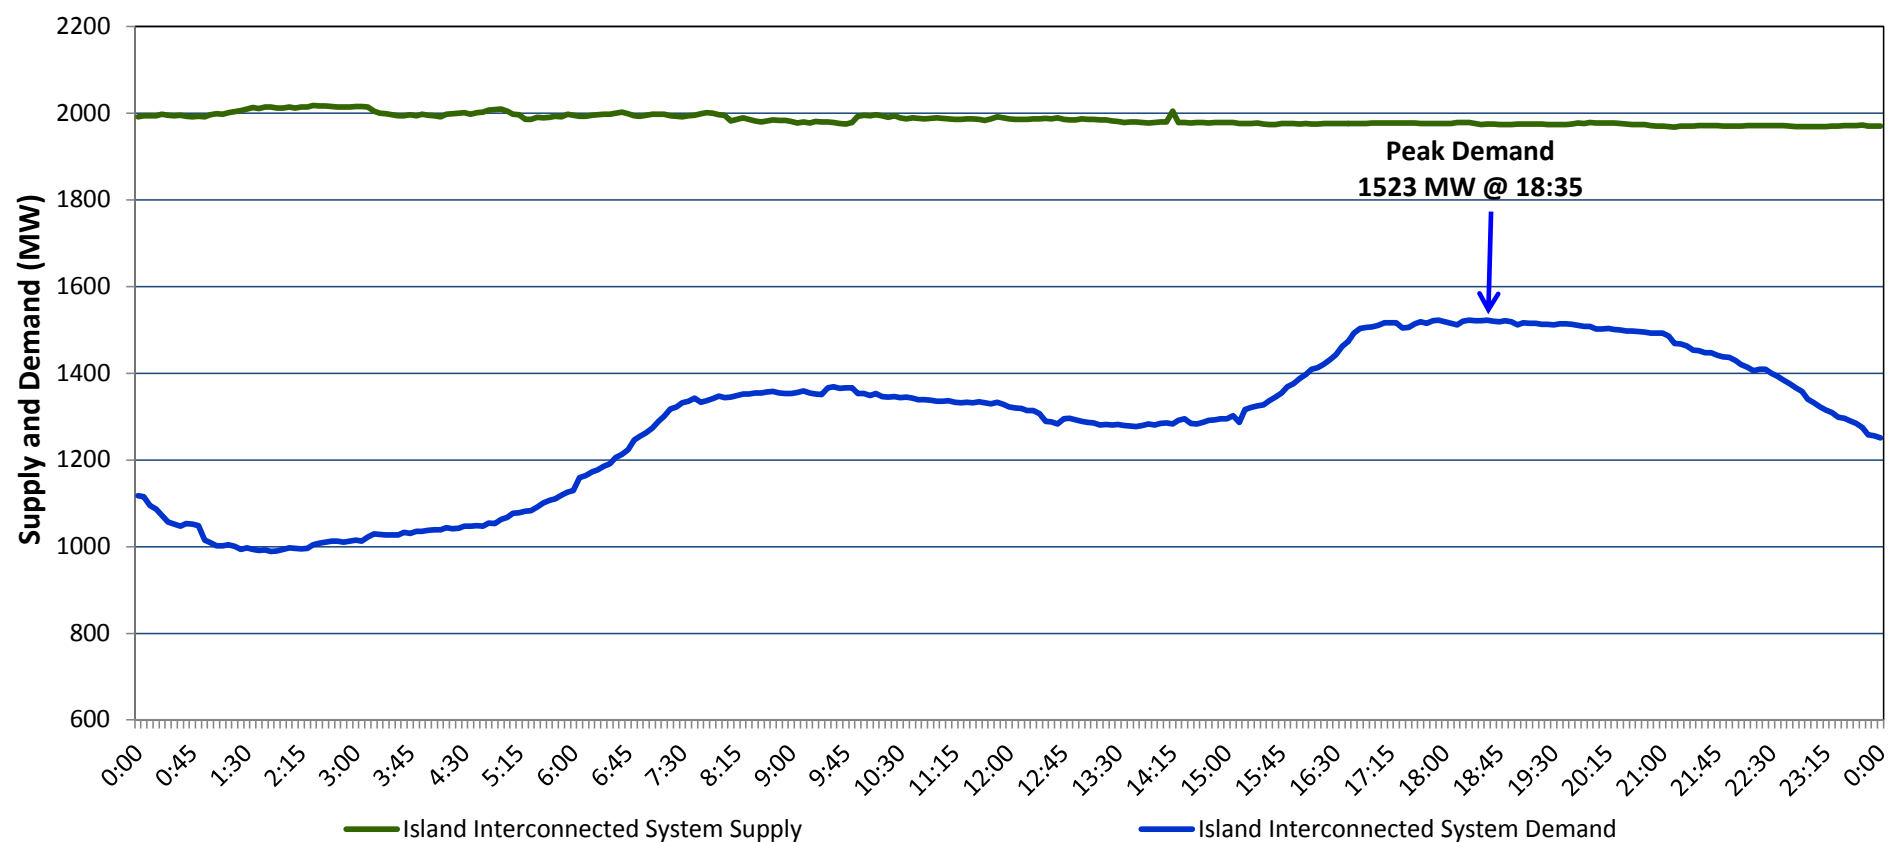

Supply Notes For December 22, 2015

- A As of 1200 hours, November 06, 2015, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.
- B As of 1437 hours, December 12, 2015, Holyrood Unit 1 available. Derated to 155 MW (170 MW).
- C As of 1000 hours, December 15, 2015, St. Anthony Diesel Unit 229 unavailable (1 MW).
- D At 0800 hours, December 22, 2015, Star Lake Unit unavailable (18 MW).
- E At 1004 hours, December 22, 2015, Star Lake Unit available (18 MW).

Section 2
Island Interconnected Supply and Demand

Wed, Dec 23, 2015 Island System Outlook ³			Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁶
Available Island System Supply: ⁵	1,990	MW	Wednesday, December 23, 2015		-7	-7	1,475	1,378
NLH Generation: ⁴	1,675	MW	Thursday, December 24, 2015		-4	-3	1,450	1,353
NLH Power Purchases:	105	MW	Friday, December 25, 2015		5	2	1,220	1,126
Other Island Generation:	210	MW	Saturday, December 26, 2015		-4	-4	1,435	1,338
Current St. John's Temperature:	-6	°C	Sunday, December 27, 2015		-6	-6	1,485	1,388
Current St. John's Windchill:	-10	°C	Monday, December 28, 2015		-7	-9	1,585	1,486
7-Day Island Peak Demand Forecast:	1,640	MW	Tuesday, December 29, 2015		-12	-10	1,640	1,551

Supply Notes For December 23, 2015

- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
3. As of 0800 Hours.
4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
5. Gross output from all Island sources (including Note 4).
6. Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.

Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak

Tue, Dec 22, 2015	Actual Island Peak Demand ⁷	18:35	1,523 MW
Wed, Dec 23, 2015	Forecast Island Peak Demand		1,475 MW

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).