


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Monday, August 29, 2016**

**Section 1  
Island Interconnected System Supply and Demand  
Actual 24 Hour System Performance For Saturday, August 27, 2016**

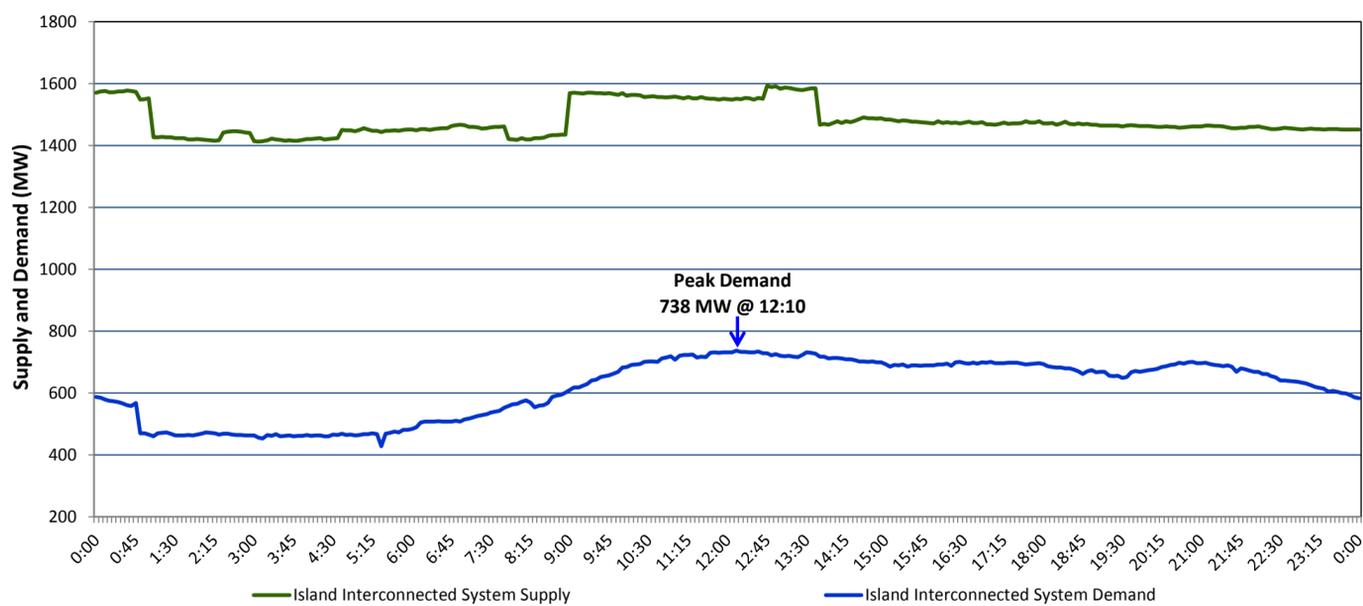

**Supply Notes For August 27, 2016**

- A As of 1956 hours, January 14, 2016, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.
- B As of 1526 hours, March 26, 2016, Stephenville Gas Turbine End A unavailable (25 MW).
- C As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 4 unavailable (76.5 MW).
- D As of 1425 hours, June 16, 2016, Holyrood Unit 2 unavailable. Previously derated to 120 MW (170 MW).
- E As of 1316 hours, July 15, 2016, Nalcor Exploits Grand Falls Unit 4 unavailable. Net impact to the Island Interconnected System is 7 MW.
- F As of 1125 hours, July 18, 2016, Hardwoods Turbine unavailable. Previously derated to 38 MW (50 MW).
- G As of 1451 hours, August 22, 2016, Nalcor Exploits Bishop's Falls plant unavailable. Net impact to the Island Interconnected System is 15 MW.
- H As of 1733 hours, August 26, 2016, Holyrood Unit 3 derated to 135 MW (150 MW).
- I At 0048 hours, August 27, 2016, Stephenville Gas Turbine End B unavailable (25 MW).
- J At 0102 hours, August 27, 2016, Cat Arm Unit 1 unavailable (67 MW).
- K At 0102 hours, August 27, 2016, Cat Arm Unit 2 unavailable (67 MW).
- L At 0221 hours, August 27, 2016, Stephenville Gas Turbine End B available (25 MW).
- M At 0256 hours, August 27, 2016, Stephenville Gas Turbine End B unavailable (25 MW).
- N At 0438 hours, August 27, 2016, Stephenville Gas Turbine End B available (25 MW).
- O At 0748 hours, August 27, 2016, Granite Canal Unit unavailable (40 MW).
- P At 0900 hours, August 27, 2016, Cat Arm Unit 1 available (67 MW).
- Q At 0900 hours, August 27, 2016, Cat Arm Unit 2 available (67 MW).
- R At 1240 hours, August 27, 2016, Granite Canal Unit available (40 MW).
- S At 1341 hours, August 27, 2016, Holyrood Unit 1 unavailable. Previously derated to 120 MW (170 MW).

**Section 2  
Island Interconnected Supply and Demand**

Sun, Aug 28, 2016	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW) Forecast
			Morning	Evening	
Available Island System Supply: <sup>5</sup>	1,440 MW	Sunday, August 28, 2016	14	12	740
NLH Generation: <sup>4</sup>	1,185 MW	Monday, August 29, 2016	16	15	800
NLH Power Purchases: <sup>6</sup>	90 MW	Tuesday, August 30, 2016	16	11	815
Other Island Generation:	165 MW	Wednesday, August 31, 2016	11	14	800
Current St. John's Temperature:	12 °C	Thursday, September 01, 2016	16	15	795
Current St. John's Windchill:	N/A °C	Friday, September 02, 2016	12	11	795
7-Day Island Peak Demand Forecast:	830 MW	Saturday, September 03, 2016	10	12	830

**Supply Notes For August 28, 2016**

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Sat, Aug 27, 2016	Actual Island Peak Demand <sup>8</sup>	12:10	738 MW
Sun, Aug 28, 2016	Forecast Island Peak Demand		740 MW

Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).