


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Friday, October 14, 2016**

**Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Thursday, October 13, 2016**

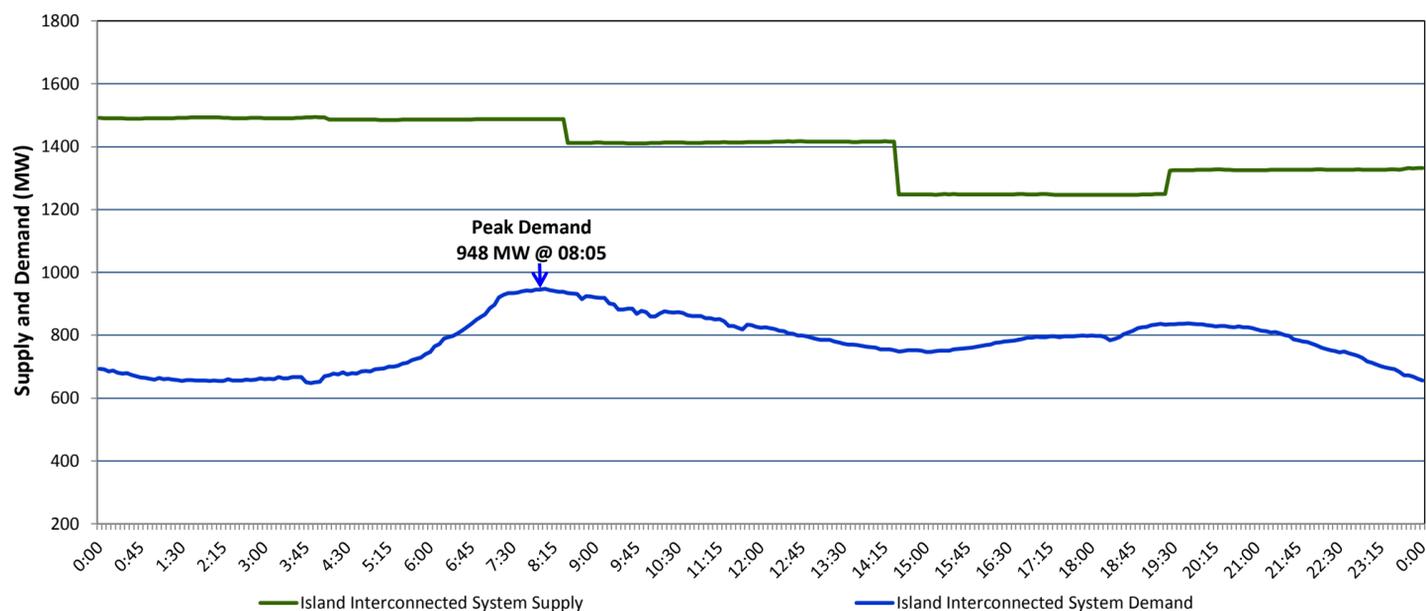

Supply Notes For October 13, 2016

- ^{1,2}
- A As of 1956 hours, January 14, 2016, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.
 - B As of 1526 hours, March 26, 2016, Stephenville Gas Turbine End A unavailable (25 MW).
 - C As of 1316 hours, July 15, 2016, Nalcor Exploits Grand Falls Unit 4 unavailable. Net impact to the Island Interconnected System is 7 MW.
 - D As of 1341 hours, August 27, 2016, Holyrood Unit 1 unavailable. Previously derated to 120 MW (170 MW).
 - E As of 0714 hours, August 31, 2016, Cat Arm Unit 1 unavailable (67 MW).
 - F As of 1719 hours, September 09, 2016, Nalcor Exploits Bishop's Falls plant units 7 and 9 unavailable. No net impact to the Island Interconnected System.
 - G As of 0717 hours, September 14, 2016, Bay d'Espoir Unit 1 unavailable (76.5 MW).
 - H As of 0717 hours, September 14, 2016, Bay d'Espoir Unit 2 unavailable (76.5 MW).
 - I As of 1956 hours, September 30, 2016, Paradise River Unit unavailable (8 MW).
 - J As of 1154 hours, October 02, 2016, Holyrood Unit 3 derated to 135 MW (150 MW).
 - K As of 0808 hours, October 04, 2016, Holyrood Diesels unit 5 unavailable (2 MW). No net impact to the Island Interconnected System.
 - L As of 2132 hours, October 10, 2016, Nalcor Exploits Bishop's Falls plant units 1,2,3,4,5,6 and 8 unavailable. Net impact to the Island Interconnected System is 15 MW.
 - M As of 0843 hours, October 12, 2016, St. Anthony Diesel Plant Units 522 (G3) and 521 (G4) unavailable (2 MW).
 - N As of 1432 hours, October 12, 2016, Hardwoods Gas Turbine derated to 38 MW (50 MW).
 - O **At 0830 hours, October 13, 2016, Hinds Lake Unit unavailable (75 MW).**
 - P **At 1427 hours, October 13, 2016, Holyrood Unit 2 unavailable (170 MW).**
 - Q **At 1922 hours, October 13, 2016, Hinds Lake Unit available (75 MW).**

**Section 2
Island Interconnected Supply and Demand**

Fri, Oct 14, 2016	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW) Forecast
			Morning	Evening	
Available Island System Supply: ⁵	1,325 MW	Friday, October 14, 2016	10	12	895
NLH Generation: ⁴	1,070 MW	Saturday, October 15, 2016	6	3	1,000
NLH Power Purchases: ⁶	80 MW	Sunday, October 16, 2016	5	7	1,000
Other Island Generation:	175 MW	Monday, October 17, 2016	8	8	950
Current St. John's Temperature:	9 °C	Tuesday, October 18, 2016	5	5	1,080
Current St. John's Windchill:	N/A °C	Wednesday, October 19, 2016	6	8	1,015
7-Day Island Peak Demand Forecast:	1,080 MW	Thursday, October 20, 2016	8	6	980

Supply Notes For October 14, 2016

- ³
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Thu, Oct 13, 2016	Actual Island Peak Demand ⁸	08:05	948 MW
Fri, Oct 14, 2016	Forecast Island Peak Demand		895 MW

- Notes: ⁸ Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).