


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, March 03, 2017

### Section 1 Island Interconnected System Supply and Demand Actual 24 Hour System Performance For Thursday, March 02, 2017

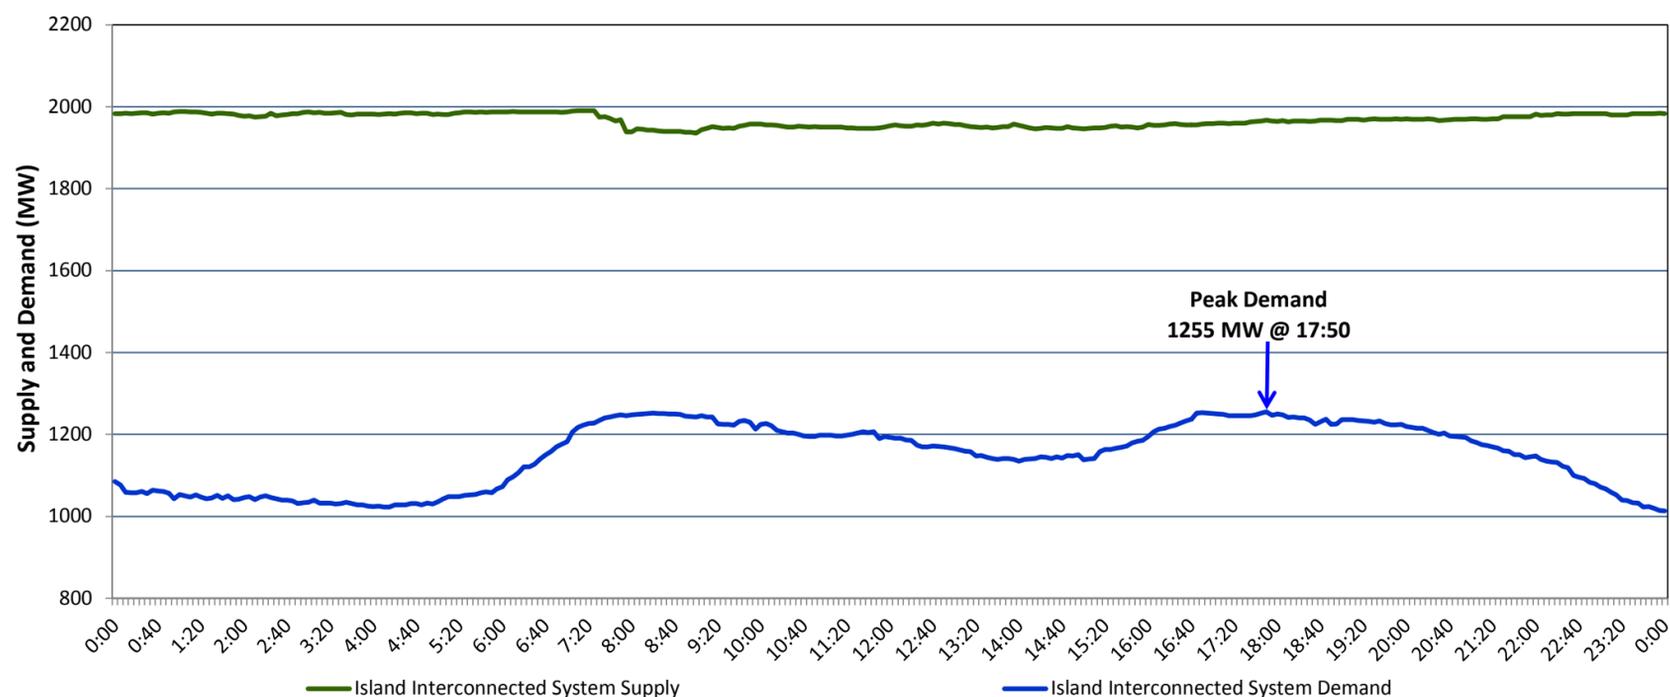

#### Supply Notes For March 02, 2017

1,2

- A As of 1513 hours, February 09, 2017, Stephenville Gas Turbine available at 38 MW (50 MW).  
 B As of 1238 hours, February 19, 2017, Hardwoods Gas Turbine available at 25 MW (50 MW).  
 C As of 0720 hours, February 22, 2017, Holyrood Unit 2 available at 150 MW (170 MW).  
 D As of 1925 hours, February 27, 2017, Holyrood Unit 1 available at 150 MW (170 MW).

### Section 2 Island Interconnected Supply and Demand

Fri, Mar 03, 2017	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,950 MW	Friday, March 03, 2017	-1	-5	1,470	1,362
NLH Generation: <sup>4</sup>	1,615 MW	Saturday, March 04, 2017	-6	-7	1,565	1,456
NLH Power Purchases: <sup>6</sup>	125 MW	Sunday, March 05, 2017	-5	-1	1,455	1,347
Other Island Generation:	210 MW	Monday, March 06, 2017	-2	-4	1,425	1,317
Current St. John's Temperature:	-1 °C	Tuesday, March 07, 2017	-3	-3	1,450	1,342
Current St. John's Windchill:	-10 °C	Wednesday, March 08, 2017	-3	0	1,395	1,288
7-Day Island Peak Demand Forecast:	1,565 MW	Thursday, March 09, 2017	4	0	1,260	1,154

#### Supply Notes For March 03, 2017

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.
  7. Adjusted for CBP&P, Praxair and Vale interruptible load as well as the impact of voltage reduction, when applicable.

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Thu, Mar 02, 2017	Actual Island Peak Demand <sup>8</sup>	17:50	1,255 MW
Fri, Mar 03, 2017	Forecast Island Peak Demand		1,470 MW

- Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).