


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Wednesday, March 22, 2017**

**Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Tuesday, March 21, 2017**

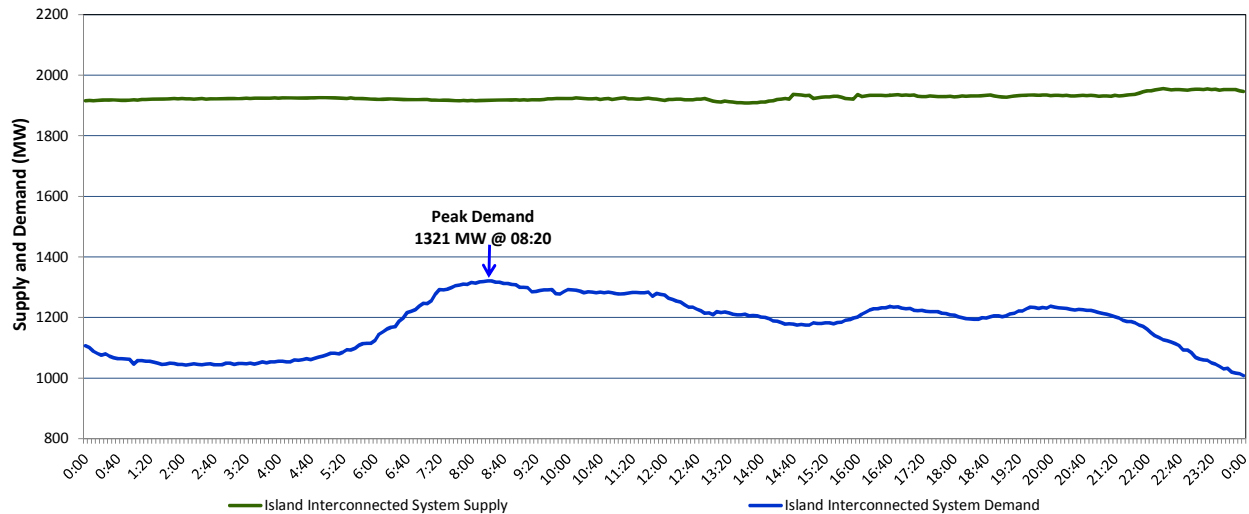

Supply Notes For March 21, 2017

- 1,2
- A As of 0928 hours, March 12, 2017, Stephenville Gas Turbine available at 25 MW (50 MW).
 B At 1440 hours, March 21, 2017, Holyrood Unit 3 available at full capacity (150 MW).
 C At 1600 hours, March 21, 2017, Holyrood Unit 1 available at 134 MW (170 MW).
 D At 1600 hours, March 21, 2017, Holyrood Unit 2 available at 134 MW (170 MW).

**Section 2
Island Interconnected Supply and Demand**

Wed, Mar 22, 2017	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,935 MW	Wednesday, March 22, 2017	-1	-2	1,335	1,228
NLH Generation: ⁴	1,595 MW	Thursday, March 23, 2017	3	-3	1,375	1,268
NLH Power Purchases: ⁶	125 MW	Friday, March 24, 2017	-9	-9	1,555	1,446
Other Island Generation:	215 MW	Saturday, March 25, 2017	-5	-1	1,340	1,233
Current St. John's Temperature:	-1 °C	Sunday, March 26, 2017	-11	-9	1,530	1,421
Current St. John's Windchill:	-8 °C	Monday, March 27, 2017	-9	-2	1,580	1,471
7-Day Island Peak Demand Forecast:	1,580 MW	Tuesday, March 28, 2017	-1	0	1,375	1,268

Supply Notes For March 22, 2017

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.
 7. Adjusted for CBP&P, Praxair and Vale interruptible load as well as the impact of voltage reduction, when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Mar 21, 2017	Actual Island Peak Demand ⁸	08:20	1,321 MW
Wed, Mar 22, 2017	Forecast Island Peak Demand		1,335 MW

- Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).