


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Tuesday, July 25, 2017**

**Section 1  
Island Interconnected System Supply and Demand  
Actual 24 Hour System Performance For Monday, July 24, 2017**

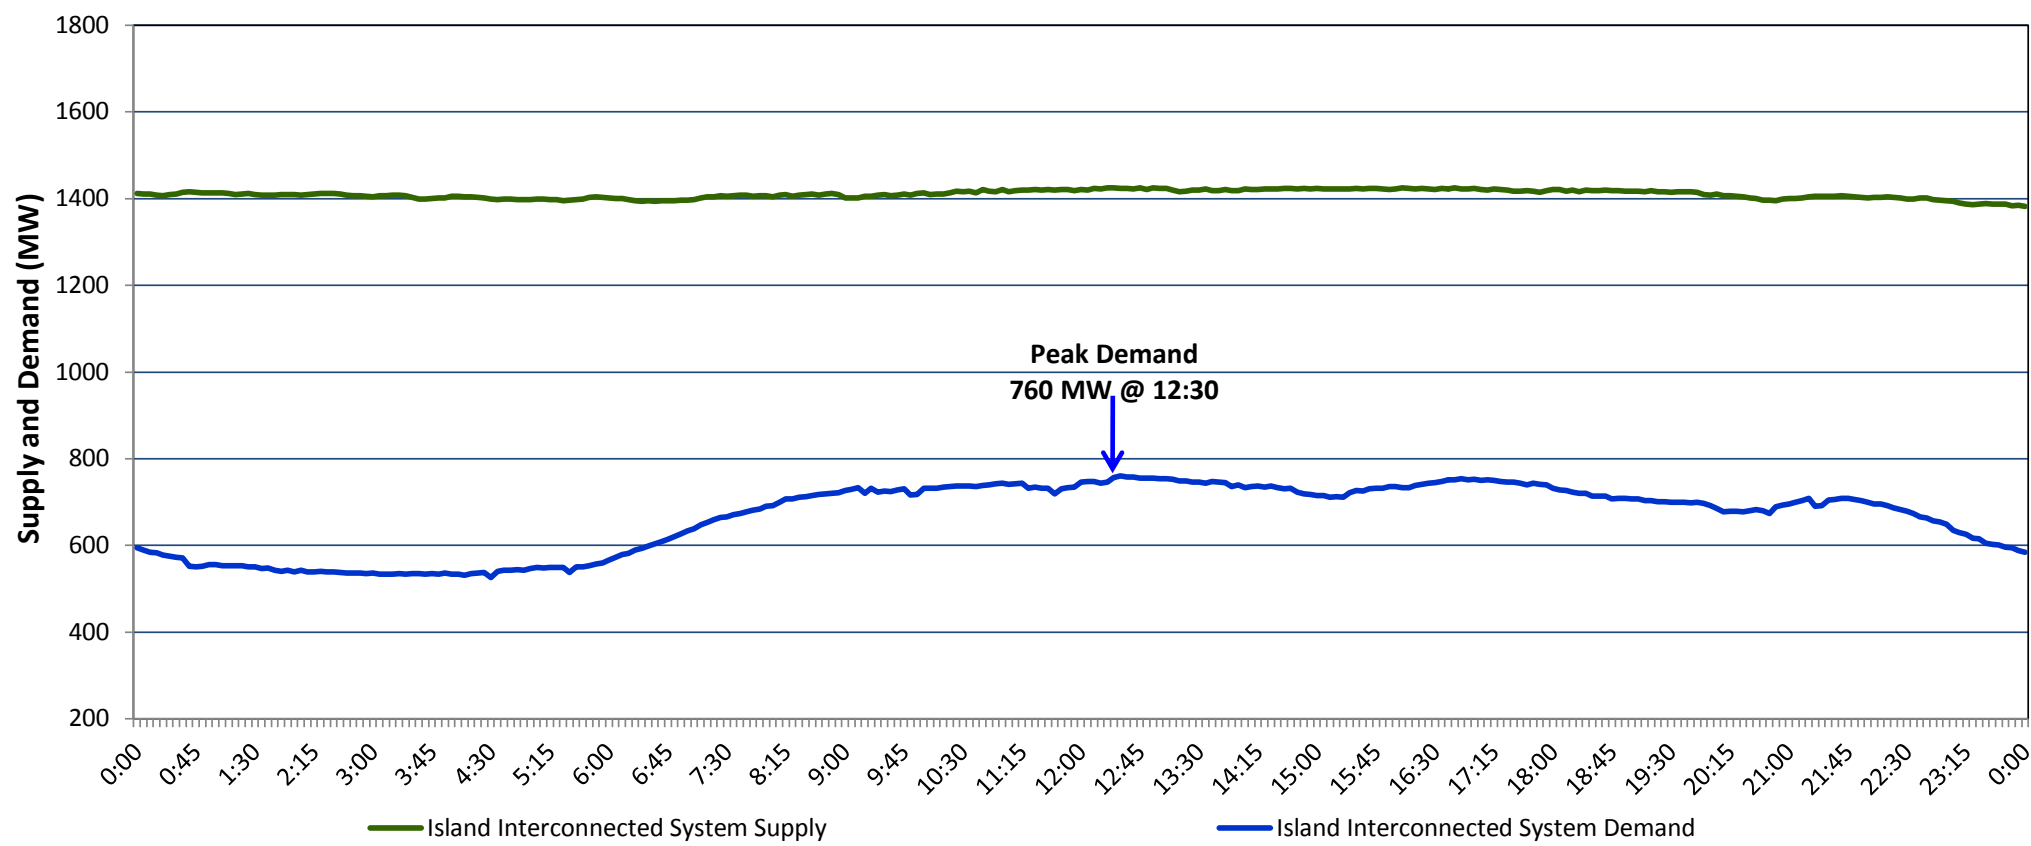

**Supply Notes For July 24, 2017**

1,2

- A As of 2003 hours, May 03, 2017, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
- B As of 1858 hours, June 22, 2017, Stephenville Gas Turbine available at 25 MW (50 MW).
- C As of 0938 hours, June 23, 2017, Holyrood Unit 1 unavailable due to planned outage 120 MW (170 MW).
- D As of 1851 hours, July 02, 2017, Holyrood Unit 2 available at 165 MW (170 MW).
- E As of 0604 hours, July 03, 2017, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
- F As of 1018 hours, July 07, 2017, Granite Canal Unit unavailable due to planned outage (40 MW).
- G As of 1314 hours, July 11, 2017, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- H As of 2000 hours, July 14, 2017, Holyrood Unit 3 available but offline for economic dispatch (150 MW).
- I As of 1058 hours, July 23, 2017, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
- J At 0901 hours, July 24, 2017, Paradise River Unit unavailable due to planned outage (8 MW).
- K At 1410 hours, July 24, 2017, Paradise River Unit available (8 MW).

**Section 2  
Island Interconnected Supply and Demand**

Tue, Jul 25, 2017	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW) Forecast
			Morning	Evening	
Available Island System Supply: <sup>5</sup>	1,365 MW	Tuesday, July 25, 2017	14	12	790
NLH Generation: <sup>4</sup>	1,070 MW	Wednesday, July 26, 2017	14	14	765
NLH Power Purchases: <sup>6</sup>	100 MW	Thursday, July 27, 2017	18	20	795
Other Island Generation:	195 MW	Friday, July 28, 2017	17	15	775
Current St. John's Temperature:	13 °C	Saturday, July 29, 2017	15	18	765
Current St. John's Windchill:	N/A °C	Sunday, July 30, 2017	16	17	755
7-Day Island Peak Demand Forecast:	800 MW	Monday, July 31, 2017	14	17	800

**Supply Notes For July 25, 2017**

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Jul 24, 2017	Actual Island Peak Demand <sup>8</sup>	12:30	760 MW
Tue, Jul 25, 2017	Forecast Island Peak Demand		790 MW

Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).