


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, January 08, 2018**

**Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Saturday, January 06, 2018**

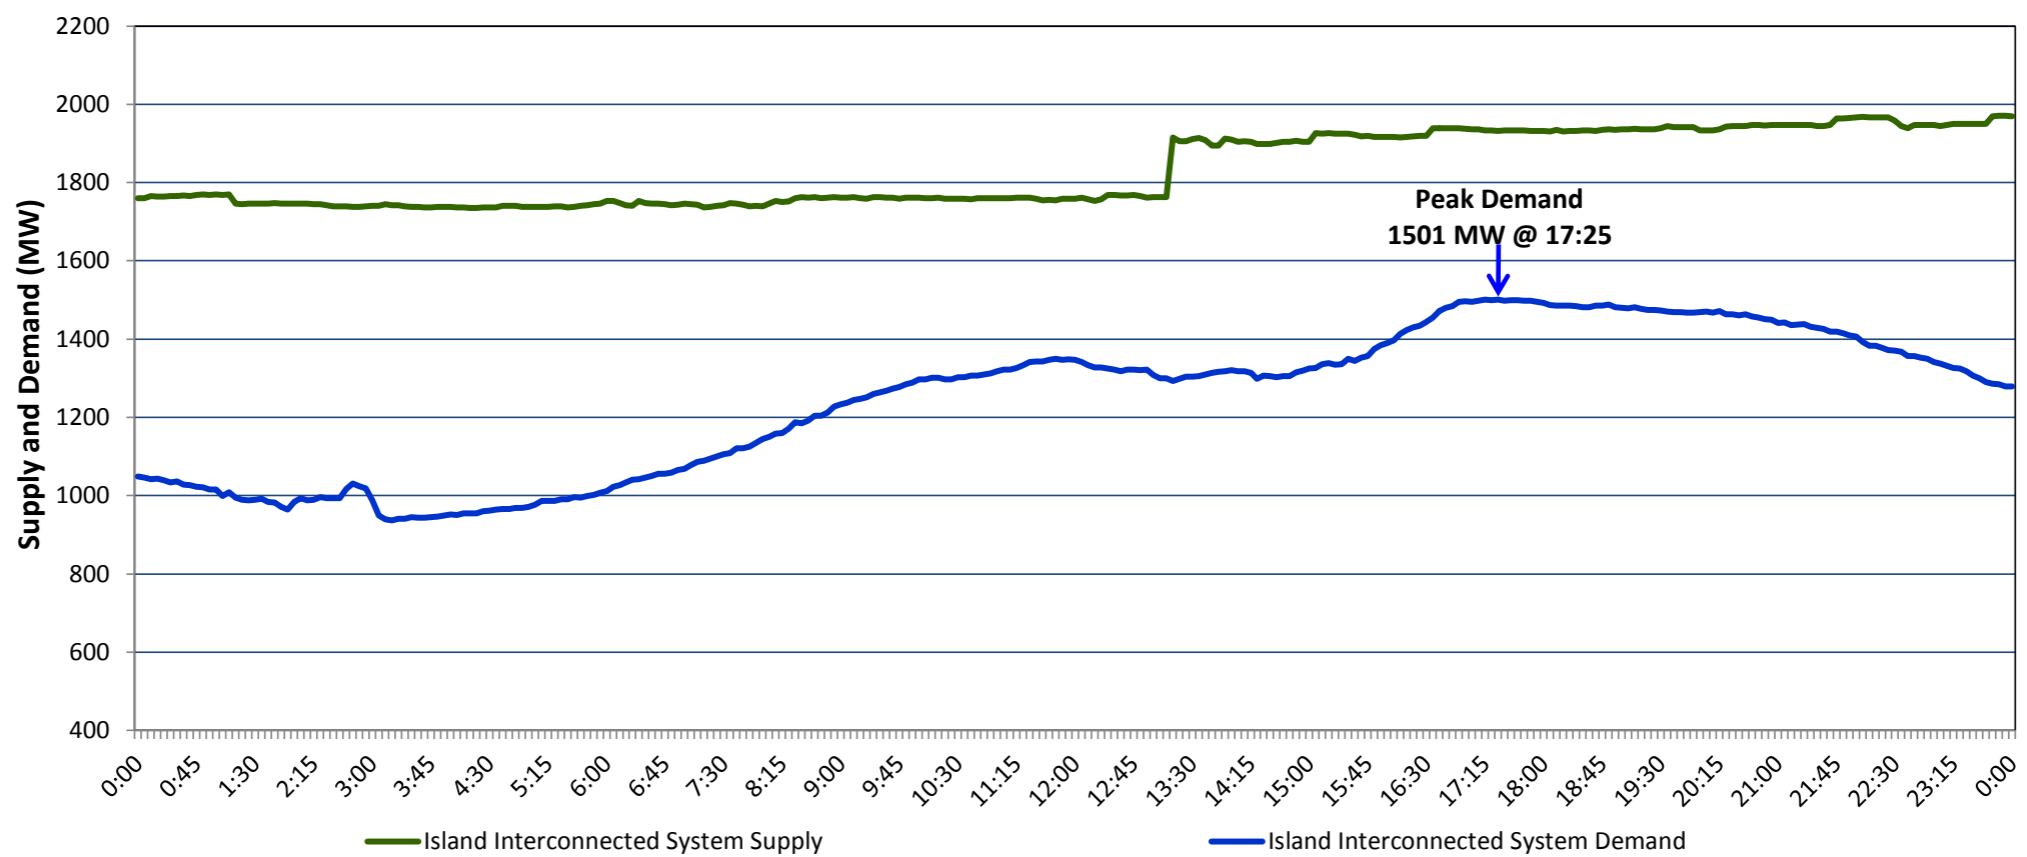

Supply Notes For January 06, 2018

- 1,2
- A As of 1609 hours, December 31, 2017, Holyrood Unit 3 available at 130 MW (150 MW).
 - B As of 0739 hours, January 03, 2018, Holyrood Unit 2 available at 154 MW (170 MW).
 - C As of 2115 hours, January 04, 2017, Stephenville Gas Turbine available at 25 MW (50 MW).
 - D At 1313 hours, January 06, 2018, Holyrood Unit 1 available at 150 MW (170 MW).
 - E At 1501 hours, January 06, 2017, Hardwoods Gas Turbine available at full capacity (50 MW).

**Section 2
Island Interconnected Supply and Demand**

Sun, Jan 07, 2018	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,935 MW	Sunday, January 07, 2018	-7	-8	1,635	1,525
NLH Generation: ⁴	1,615 MW	Monday, January 08, 2018	-7	-7	1,625	1,515
NLH Power Purchases: ⁶	125 MW	Tuesday, January 09, 2018	-7	0	1,560	1,451
Other Island Generation:	195 MW	Wednesday, January 10, 2018	-4	-8	1,630	1,520
Current St. John's Temperature:	-8 °C	Thursday, January 11, 2018	-9	-5	1,605	1,495
Current St. John's Windchill:	-18 °C	Friday, January 12, 2018	2	5	1,345	1,238
7-Day Island Peak Demand Forecast:	1,635 MW	Saturday, January 13, 2018	10	-1	1,420	1,312

Supply Notes For January 07, 2018

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance and Maritime Link Import (when applicable).
 7. Adjusted for CBP&P and Vale and Praxair interruptible load, the impact of voltage reduction and Maritime Link Exports (when applicable).

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Sat, Jan 06, 2018	Actual Island Peak Demand ⁸	17:25	1,501 MW
Sun, Jan 07, 2018	Forecast Island Peak Demand		1,635 MW

- Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).