


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Wednesday, January 10, 2018**

**Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Tuesday, January 09, 2018**

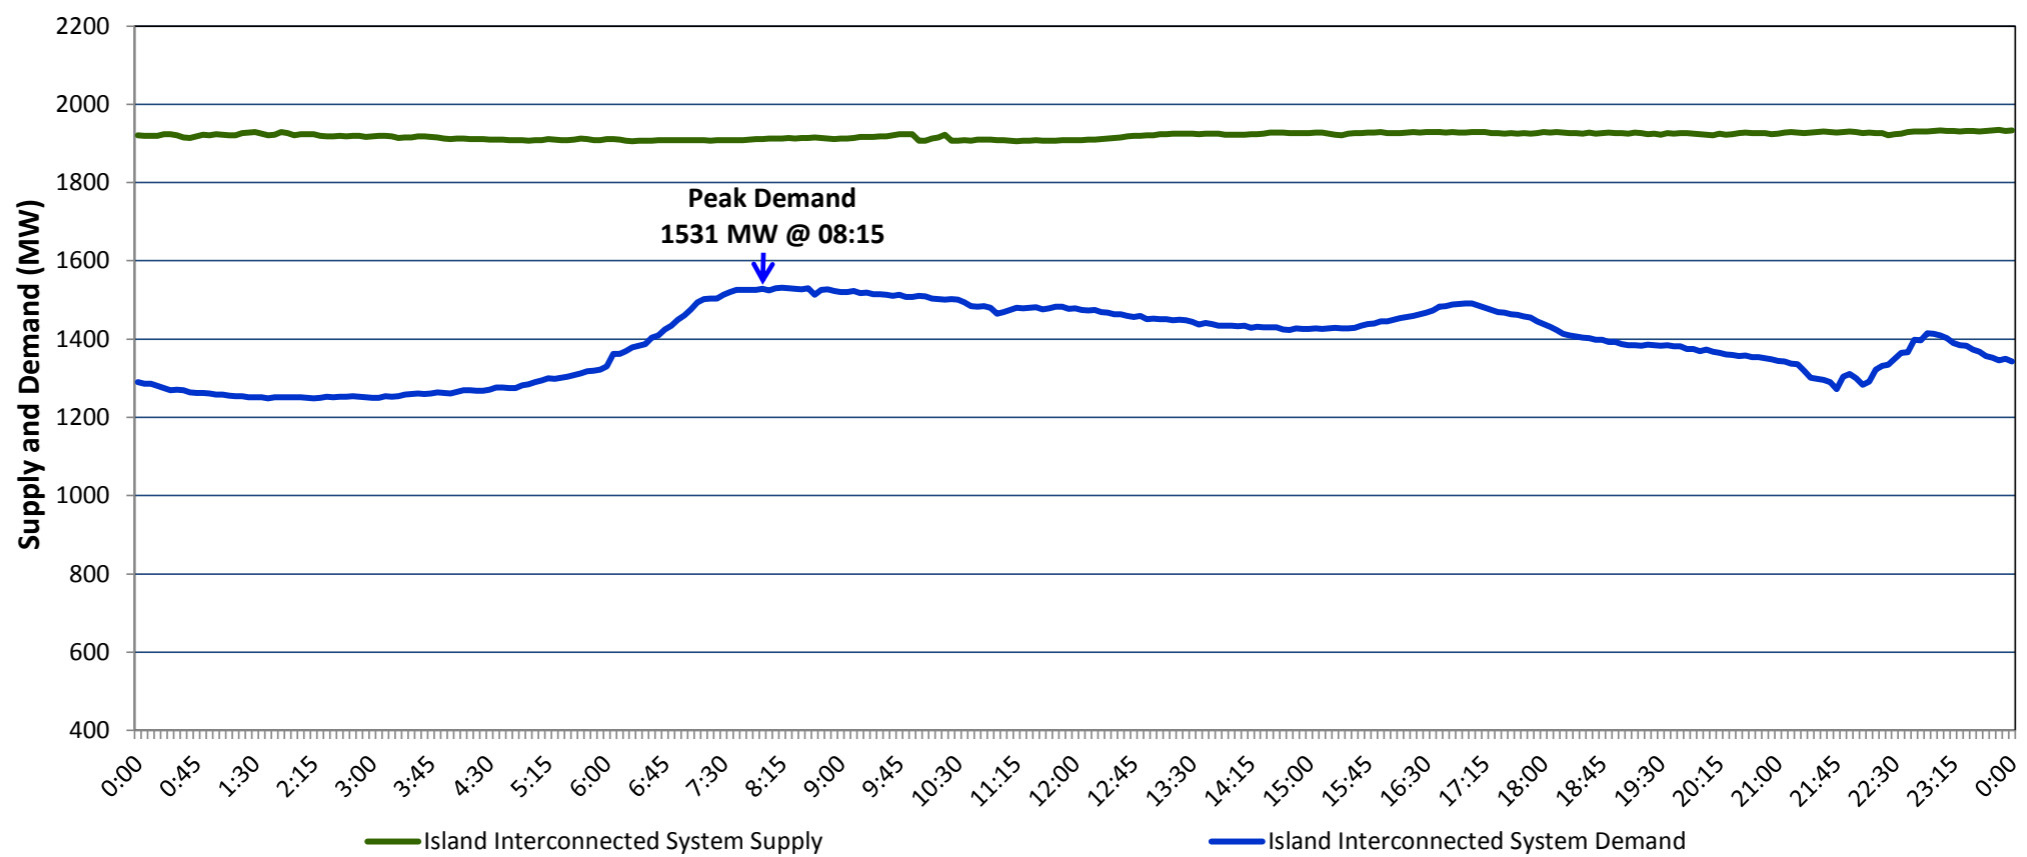

Supply Notes For January 09, 2018

^{1,2}

- A As of 1609 hours, December 31, 2017, Holyrood Unit 3 available at 130 MW (150 MW).
- B As of 0739 hours, January 03, 2018, Holyrood Unit 2 available at 154 MW (170 MW).
- C As of 2115 hours, January 04, 2017, Stephenville Gas Turbine available at 25 MW (50 MW).
- D As of 0815 hours, January 08, 2018, Holyrood Unit 1 available at 148 MW (170 MW).

**Section 2
Island Interconnected Supply and Demand**

Wed, Jan 10, 2018	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,925 MW	Wednesday, January 10, 2018	-4	-8	1,640	1,530
NLH Generation: ⁴	1,610 MW	Thursday, January 11, 2018	-8	1	1,535	1,426
NLH Power Purchases: ⁶	110 MW	Friday, January 12, 2018	3	7	1,315	1,209
Other Island Generation:	205 MW	Saturday, January 13, 2018	7	8	1,315	1,209
Current St. John's Temperature:	-5 °C	Sunday, January 14, 2018	8	8	1,310	1,204
Current St. John's Windchill:	-16 °C	Monday, January 15, 2018	3	2	1,525	1,416
7-Day Island Peak Demand Forecast:	1,640 MW	Tuesday, January 16, 2018	2	-3	1,480	1,372

Supply Notes For January 10, 2018

³

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance and Maritime Link Import (when applicable).
 7. Adjusted for CBP&P and Vale and Praxair interruptible load, the impact of voltage reduction and Maritime Link Exports (when applicable).

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Jan 09, 2018	Actual Island Peak Demand ⁸	08:15	1,531 MW
Wed, Jan 10, 2018	Forecast Island Peak Demand		1,640 MW

- Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).