


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Thursday, February 08, 2018**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Wednesday, February 07, 2018**

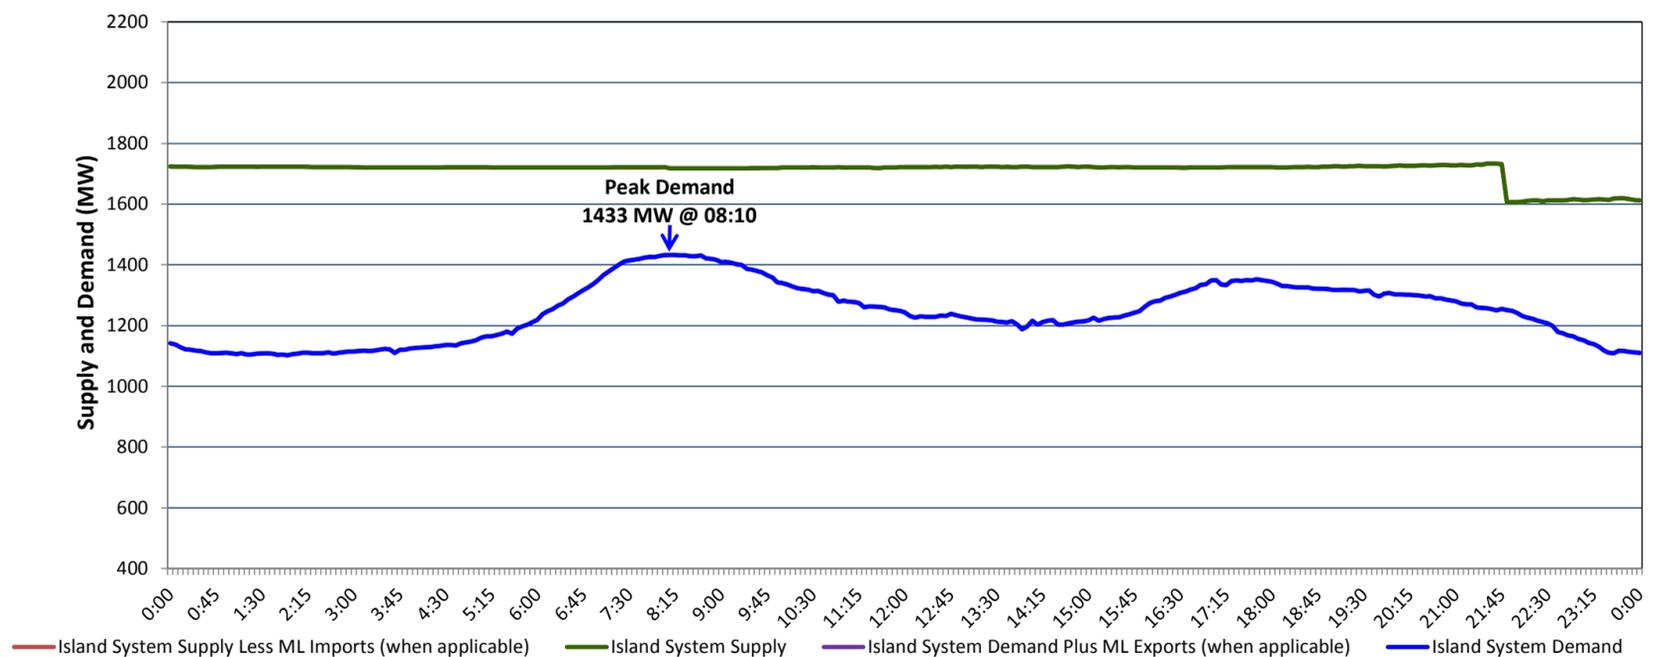

**Supply Notes For February 07, 2018**

1,2

- A As of 2115 hours, January 04, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
- B As of 1204 hours, February 03, 2018, Holyrood Unit 1 unavailable 70 MW (170 MW).
- C At 0809 hours, February 07, 2018, Holyrood Unit 2 available at 127 MW (170 MW).
- D At 0809 hours, February 07, 2018, Holyrood Unit 3 available at 105 MW (150 MW).
- E At 2148 hours, February 07, 2018, Holyrood Unit 2 unavailable due to planned outage 127 MW (170 MW).

**Section 2  
Island Interconnected Supply and Demand**

Thu, Feb 08, 2018	Island System Outlook <sup>3</sup>		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,620	MW	Thursday, February 08, 2018	2	2	1,410	1,303
NLH Generation: <sup>4</sup>	1,285	MW	Friday, February 09, 2018	-6	-7	1,535	1,426
NLH Power Purchases: <sup>6</sup>	120	MW	Saturday, February 10, 2018	-10	-2	1,470	1,327
Maritime Link Imports:	-	MW	Sunday, February 11, 2018	4	2	1,275	1,164
Other Island Generation:	215	MW	Monday, February 12, 2018	6	5	1,310	1,204
Current St. John's Temperature & Windchill:	3 °C	N/A °C	Tuesday, February 13, 2018	-7	-6	1,565	1,426
7-Day Island Peak Demand Forecast:	1,565	MW	Wednesday, February 14, 2018	-3	0	1,410	1,293

**Supply Notes For February 08, 2018**

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
  7. Adjusted for CBP&P, Vale and Praxair interruptible load, Maritime Link Exports and the impact of voltage reduction (when applicable).

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Feb 07, 2018	Actual Island Peak Demand <sup>8</sup>	08:10	1,433 MW
Thu, Feb 08, 2018	Forecast Island Peak Demand		1,410 MW

- Notes: 8. Island Demand / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).