


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, February 23, 2018

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Thursday, February 22, 2018

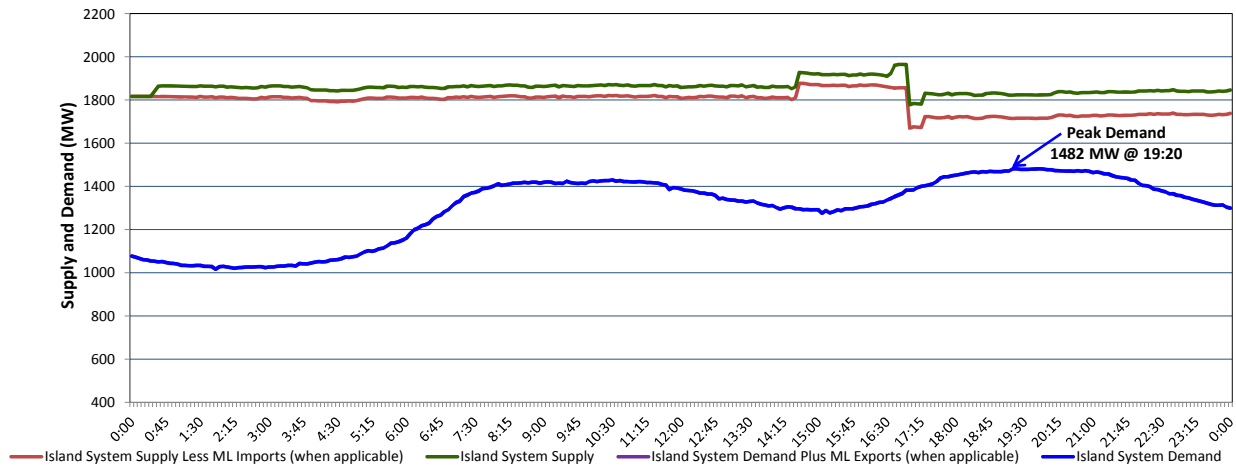

Supply Notes For February 22, 2018

1,2

- A As of 2115 hours, January 04, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
- B As of 0810 hours, February 18, 2018, Holyrood Unit 3 available at 108 MW (150 MW).
- C At 0829 hours, February 22, 2018, Holyrood Unit 2 available at 108 MW (170 MW).
- D At 1433 hours, February 22, 2018, Holyrood Unit 1 available at 140 MW (170 MW).
- E At 1659 hours, February 22, 2018, Holyrood Unit 1 unavailable 140 MW (170 MW).
- F At 1700 hours, February 22, 2018, Hardwoods Gas Turbine unavailable (50 MW).
- G At 1717 hours, February 22, 2018, Hardwoods Gas Turbine available (50 MW).

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

1,2

Section 2 Island Interconnected System Supply and Demand								
Fri, Feb 23, 2018	Island System Outlook ³		Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,958	MW	Friday, February 23, 2018		-13	-10	1,665	1,490
NLH Generation: ⁴	1,395	MW	Saturday, February 24, 2018		-7	-2	1,485	1,307
NLH Power Purchases: ⁶	245	MW	Sunday, February 25, 2018		-11	-9	1,535	1,426
Maritime Link Imports:	108	MW	Monday, February 26, 2018		-7	-5	1,505	1,337
Other Island Generation:	210	MW	Tuesday, February 27, 2018		-1	-2	1,410	1,303
Current St. John's Temperature & Windchill: -11 °C	-22	°C	Wednesday, February 28, 2018		-1	1	1,415	1,307
7-Day Island Peak Demand Forecast:	1,665	MW	Thursday, March 01, 2018		3	2	1,225	1,120

Supply Notes For February 23, 2018

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
 7. Adjusted for CBP&P, Vale and Praxair interruptible load, Maritime Link Exports and the impact of voltage reduction (when applicable).

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Thu, Feb 22, 2018	Actual Island Peak Demand ⁸	19:20	1,482 MW
Fri, Feb 23, 2018	Forecast Island Peak Demand		1,665 MW

Notes: 8. Island Demand / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).