


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Wednesday, June 06, 2018

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Tuesday, June 05, 2018

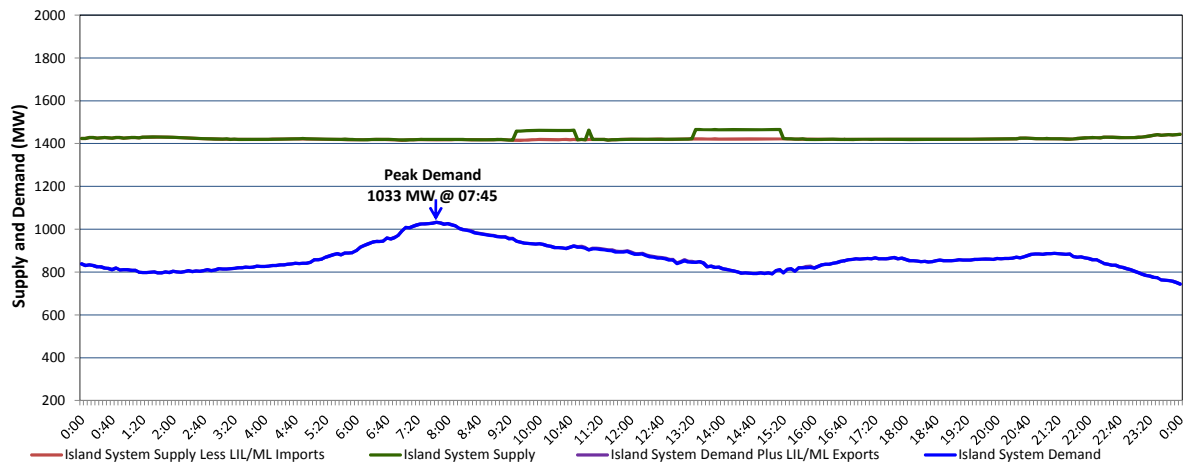

Supply Notes For June 05, 2018

- A As of 0801 hours, April 02, 2018, Holyrood Unit 3 unavailable due to planned outage 110 MW (150 MW).
 B As of 1800 hours, April 29, 2018, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
 C As of 0623 hours, May 08, 2018, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
 D As of 0801 hours, May 15, 2018, St. Anthony Diesel Plant available at 7.7 MW (9.7 MW).
 E As of 1438 hours, May 22, 2018, Holyrood Unit 2 unavailable due to planned outage 70 MW (170 MW).
 F As of 1357 hours, June 01, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
 G As of 1430 hours, June 02, 2018, Hardwoods Gas Turbine available at 25 MW (50 MW).
 H As of 2143 hours, June 04, 2018, Holyrood Unit 1 available at 100 MW (170 MW).

1,2

Section 2 Island Interconnected Supply and Demand

Wed, Jun 06, 2018	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,445 MW	Wednesday, June 06, 2018	3	2	1,080	1,080
NLH Generation: ⁴	1,100 MW	Thursday, June 07, 2018	6	6	975	975
NLH Power Purchases: ⁶	145 MW	Friday, June 08, 2018	6	9	905	905
ML/LIL Imports:	- MW	Saturday, June 09, 2018	8	6	855	855
Other Island Generation:	200 MW	Sunday, June 10, 2018	5	7	945	945
Current St. John's Temperature & Windchill:	2 °C	Monday, June 11, 2018	6	5	910	910
7-Day Island Peak Demand Forecast:	1,080 MW	Tuesday, June 12, 2018	9	11	845	845

Supply Notes For June 06, 2018

3

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - As of 0800 Hours.
 - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - Gross output from all Island sources (including Note 4).
 - NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
 - Adjusted for CBPP, Vale and Praxair interruptible load, Maritime Link and Labrador-Island Link exports and the impact of voltage reduction, when applicable.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Tue, Jun 05, 2018	Actual Island Peak Demand ⁸	7:45	1,033 MW
Wed, Jun 06, 2018	Forecast Island Peak Demand		1,080 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).