
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Wednesday, August 22, 2018

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Tuesday, August 21, 2018

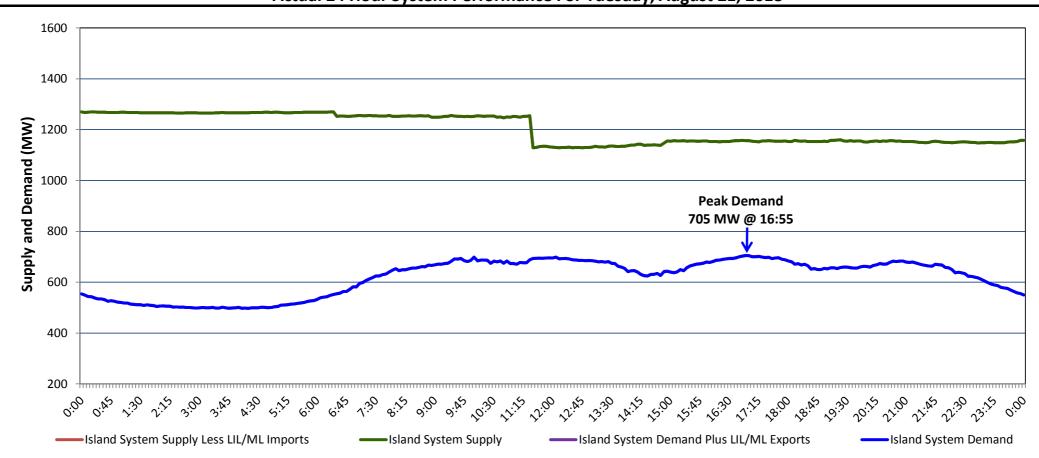

Supply Notes For August 21, 2018

- As of 1438 hours, May 22, 2018, Holyrood Unit 2 unavailable due to planned outage 70 MW (170 MW).
- As of 0801 hours, July 19, 2018, Holyrood Unit 3 removed from service for economic dispatch 110 MW (150 MW).
- As of 1000 hours, July 27, 2018, Holyrood Unit 1 unavailable due to planned outage 88 MW (170 MW).
- As of 0823 hours, August 06, 2018, Cat Arm unit 1 unavailable due to planned outage 50 MW (67 MW).
- As of 1000 hours, August 06, 2018, Cat Arm unit 2 unavailable due to planned outage (67 MW).
- As of 1609 hours, August 07, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).

3

1,2

- As of 2245 hours, August 20, 2018, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- At 0851 hours, August 21, 2018, Paradise River Unit unavailable due to planned outage (8 MW).
- At 1118 hours, August 21, 2018, Holyrood Gas Turbine unavailable due to planned outage (123.5 MW).
- At 1451 hours, August 21, 2018, Paradise River Unit available (8 MW).

Section 2

Island Interconnected Supply and Demand

Wed, Aug 22, 2018	aug 22, 2018 Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,125	MW	Wednesday, August 22, 2018	17	16	770	770
NLH Island Generation: ⁴	845	MW	Thursday, August 23, 2018	19	20	805	805
NLH Island Power Purchases: ⁶	95	MW	Friday, August 24, 2018	19	20	800	800
Other Island Generation:	185	MW	Saturday, August 25, 2018	19	20	765	765
ML/LIL Imports:	-	MW	Sunday, August 26, 2018	19	18	765	765
Current St. John's Temperature & Windchill:	15 °C N/A	°C	Monday, August 27, 2018	17	18	810	810
7-Day Island Peak Demand Forecast:	810	MW	Tuesday, August 28, 2018	16	13	810	810

Supply Notes For August 22, 2018

- 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
- 2. Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
- 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
- 5. Gross output from all Island sources (including Note 4).
- 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
- 7. Adjusted for CBPP, Vale and Praxair interruptible load, Maritime Link and Labrador-Island Link exports and the impact of voltage reduction, when applicable.

Section 3 **Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Aug 21, 2018	Actual Island Peak Demand ⁸	16:55	705 MW
Wed, Aug 22, 2018	Forecast Island Peak Demand		770 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).