


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, October 09, 2018**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Saturday, October 06, 2018**

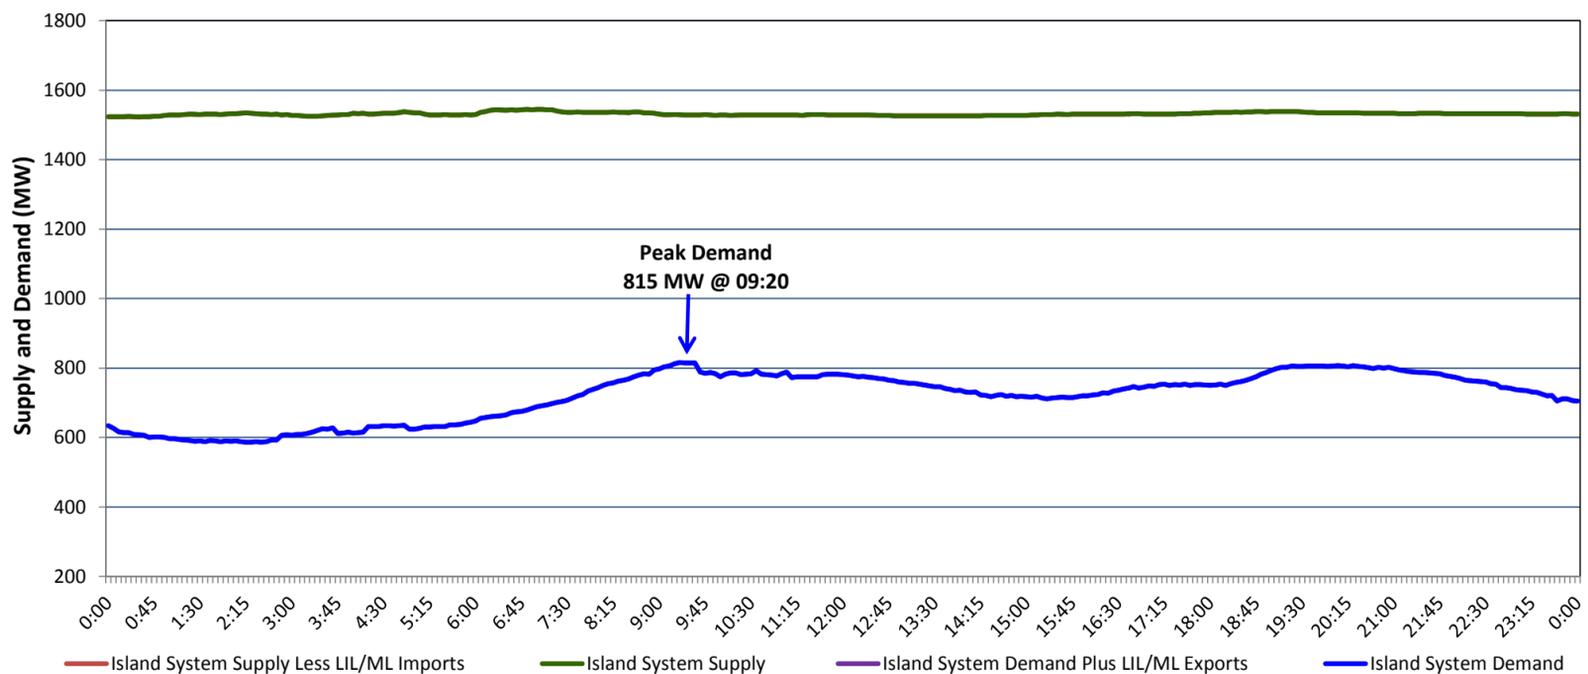

Supply Notes For October 06, 2018

1,2

- A As of 1000 hours, July 27, 2018, Holyrood Unit 1 unavailable due to planned outage 88 MW (170 MW).
- B As of 1034 hours, September 17, 2018, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
- C As of 1623 hours, September 28, 2018, Holyrood Unit 3 unavailable due to planned outage 110 MW (150 MW).
- D As of 1633 hours, October 05, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).

**Section 2
Island Interconnected Supply and Demand**

Sun, Oct 07, 2018	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,530	MW	Sunday, October 07, 2018	7	6	895	895
NLH Island Generation: ⁴	1,270	MW	Monday, October 08, 2018	5	5	960	960
NLH Island Power Purchases: ⁶	80	MW	Tuesday, October 09, 2018	4	6	1,105	1,105
Other Island Generation:	180	MW	Wednesday, October 10, 2018	10	4	1,060	1,060
ML/LIL Imports:	-	MW	Thursday, October 11, 2018	3	2	1,155	1,155
Current St. John's Temperature & Windchill:	7 °C	N/A °C	Friday, October 12, 2018	3	9	1,145	1,145
7-Day Island Peak Demand Forecast:	1,155	MW	Saturday, October 13, 2018	9	7	1,010	1,010

Supply Notes For October 07, 2018

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Sat, Oct 06, 2018	Actual Island Peak Demand ⁸	09:20	815 MW
Sun, Oct 07, 2018	Forecast Island Peak Demand		895 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).