


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, February 05, 2019**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Monday, February 04, 2019**

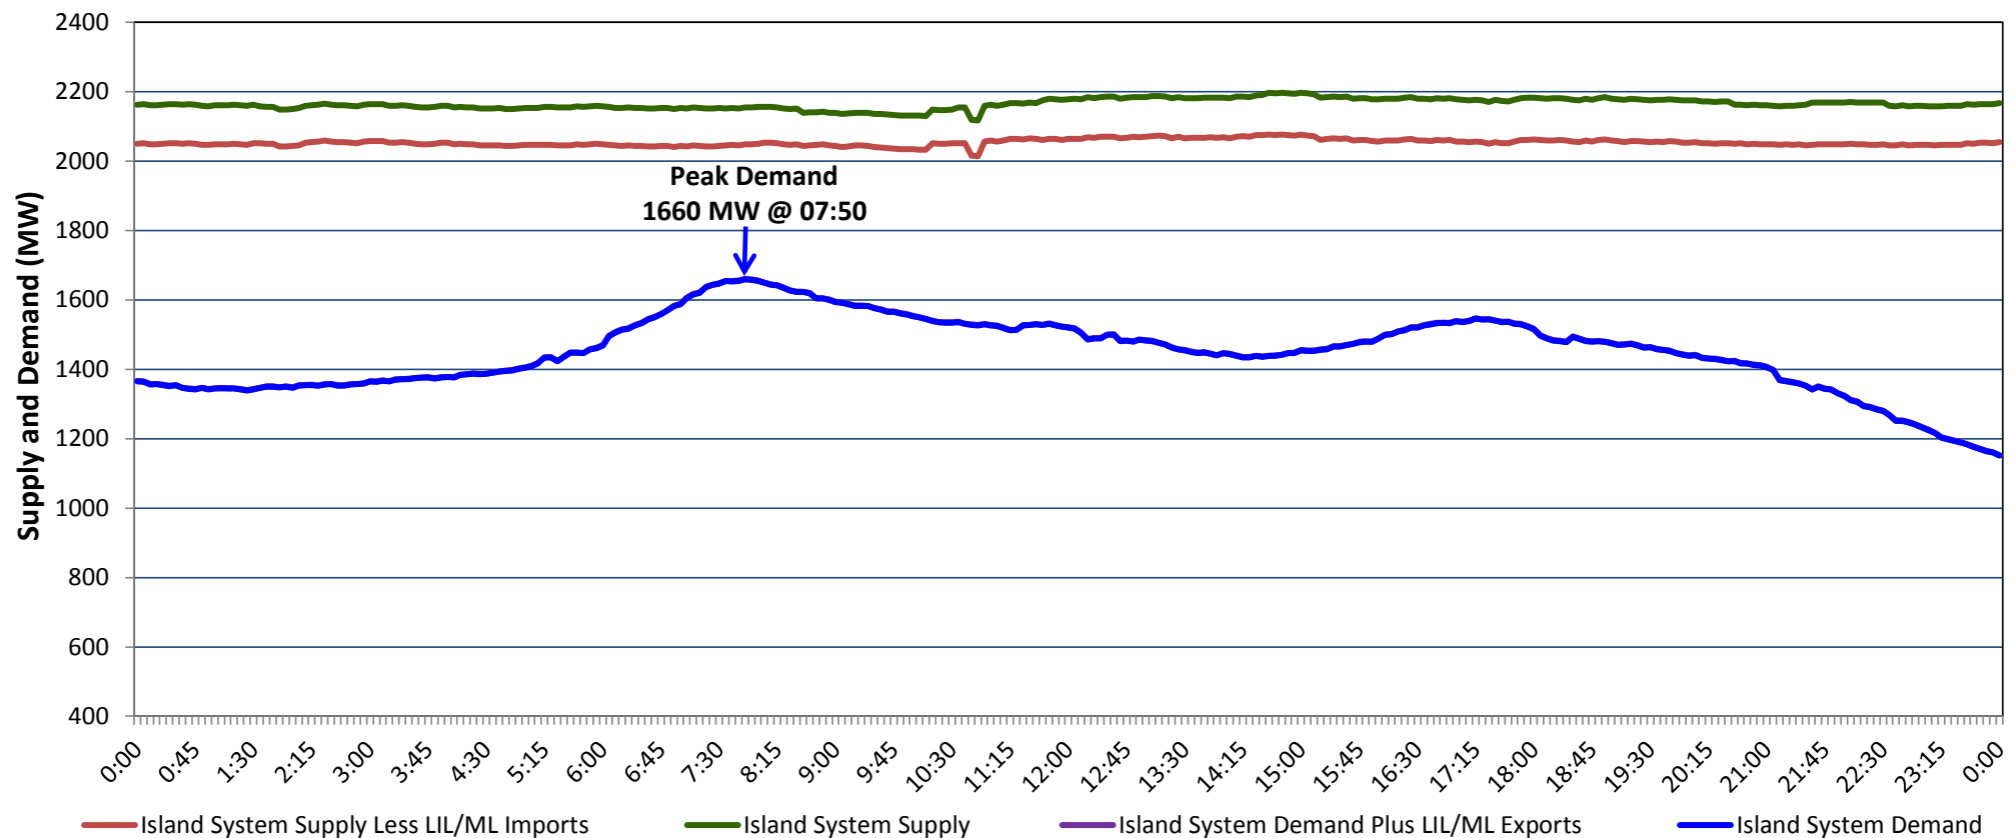

Supply Notes For February 04, 2019

1,2

- A At 1012 hours, February 04, 2019, Holyrood Unit 1 available at full capacity (170 MW).
- B At 1045 hours, February 04, 2019, Granite Canal Unit unavailable due to planned outage (40 MW).
- C At 1101 hours, February 04, 2019, Granite Canal Unit available (40 MW).
- D At 1513 hours, February 04, 2019, Paradise River Unit unavailable due to planned outage (8 MW).

**Section 2
Island Interconnected Supply and Demand**

Tue, Feb 05, 2019	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,130 MW	Tuesday, February 05, 2019	-4	-1	1,405	1,303
NLH Island Generation: ⁴	1,685 MW	Wednesday, February 06, 2019	4	-3	1,455	1,352
NLH Island Power Purchases: ⁶	110 MW	Thursday, February 07, 2019	-4	-5	1,515	1,411
Other Island Generation:	215 MW	Friday, February 08, 2019	-7	-2	1,475	1,372
ML/LIL Imports:	120 MW	Saturday, February 09, 2019	6	-3	1,465	1,362
Current St. John's Temperature & Windchill:	-2 °C	Sunday, February 10, 2019	-8	-9	1,620	1,515
7-Day Island Peak Demand Forecast:	1,645 MW	Monday, February 11, 2019	-11	-9	1,645	1,540

Supply Notes For February 05, 2019

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Feb 04, 2019	Actual Island Peak Demand ⁸	07:50	1,660 MW
Tue, Feb 05, 2019	Forecast Island Peak Demand		1,405 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).