


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, March 04, 2019

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Sunday, March 03, 2019

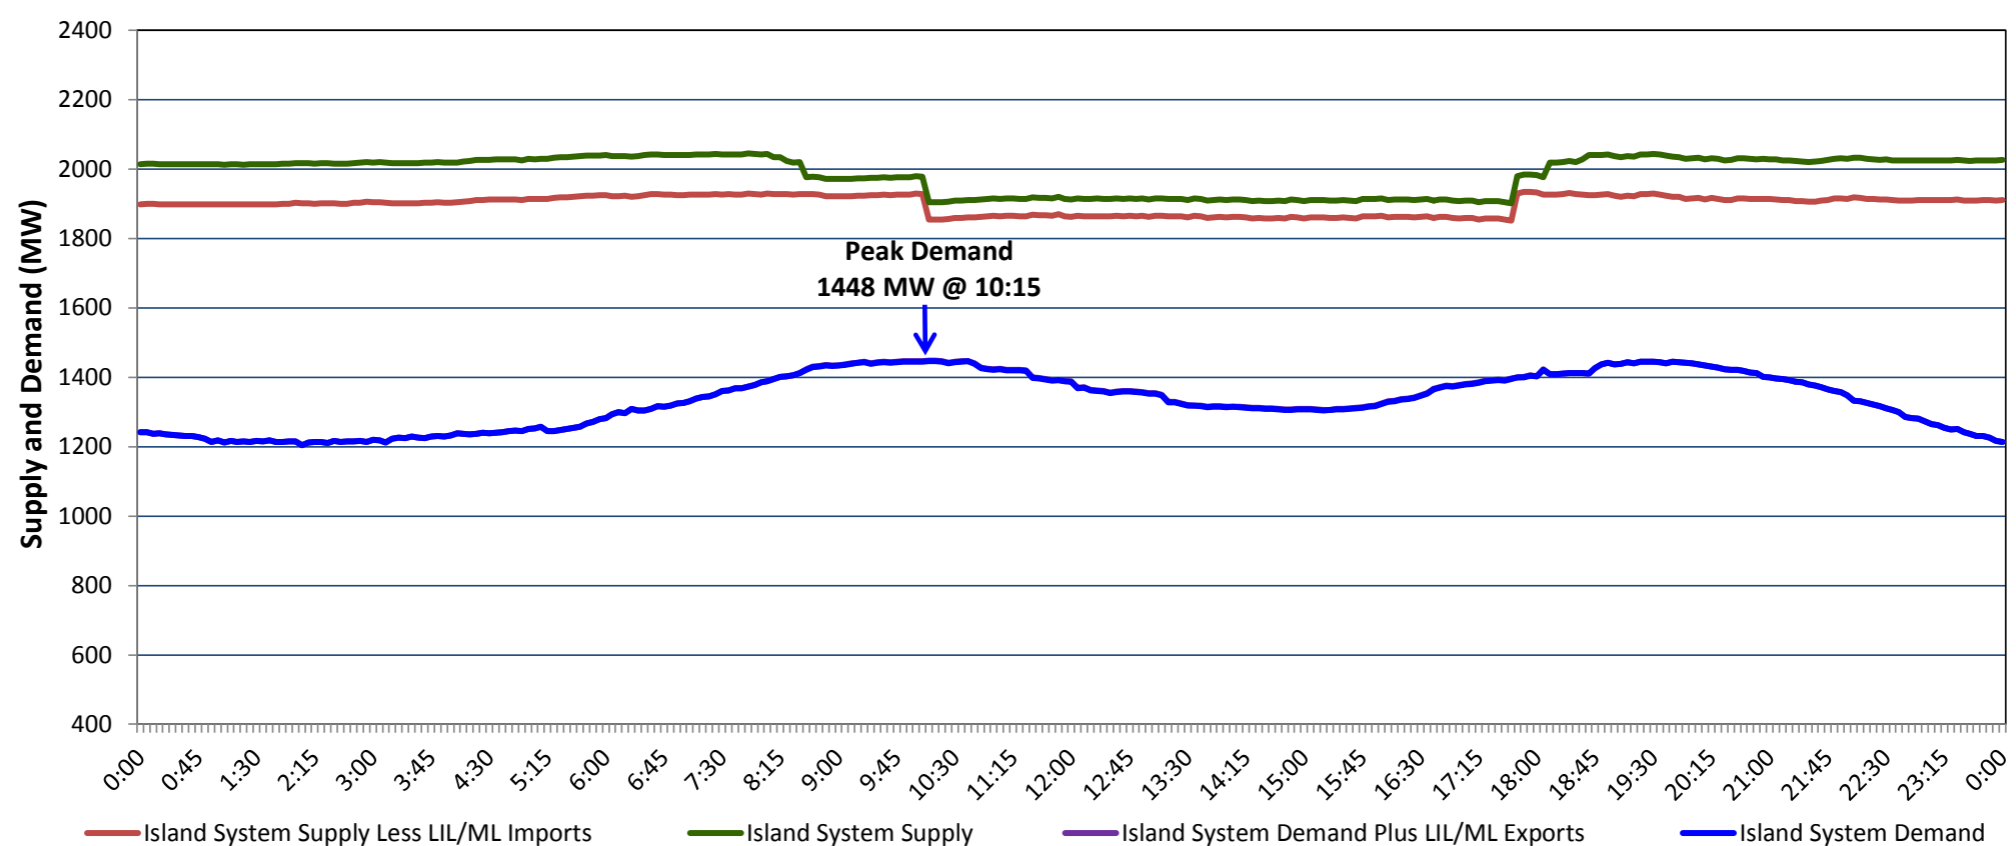

Supply Notes For March 03, 2019

1,2

- A As of 0409 hours, February 27, 2019, Bay d'Espoir Unit 5 unavailable (76.5 MW).
 B As of 1003 hours, February 27, 2019, Hardwoods Gas Turbine available at 25 MW (50 MW).
 C **At 1008 hours, March 03, 2019, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).**
 D **At 1745 hours, March 03, 2019, Bay d'Espoir Unit 6 available (76.5 MW).**

Section 2 Island Interconnected Supply and Demand

Mon, Mar 04, 2019	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,032	MW	Monday, March 04, 2019	-6	-3	1,515	1,411
NLH Island Generation: ⁴	1,590	MW	Tuesday, March 05, 2019	3	-4	1,455	1,352
NLH Island Power Purchases: ⁶	95	MW	Wednesday, March 06, 2019	-5	-4	1,490	1,387
Other Island Generation:	200	MW	Thursday, March 07, 2019	-8	-10	1,595	1,491
ML/LIL Imports:	147	MW	Friday, March 08, 2019	-10	-8	1,540	1,436
Current St. John's Temperature & Windchill: -8 °C	-15	°C	Saturday, March 09, 2019	-6	-5	1,535	1,431
7-Day Island Peak Demand Forecast:	1,595	MW	Sunday, March 10, 2019	-8	-7	1,440	1,340

Supply Notes For March 04, 2019

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Sun, Mar 03, 2019	Actual Island Peak Demand ⁸	10:15	1,448 MW
Mon, Mar 04, 2019	Forecast Island Peak Demand		1,515 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).