


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Thursday, August 15, 2019**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Wednesday, August 14, 2019**

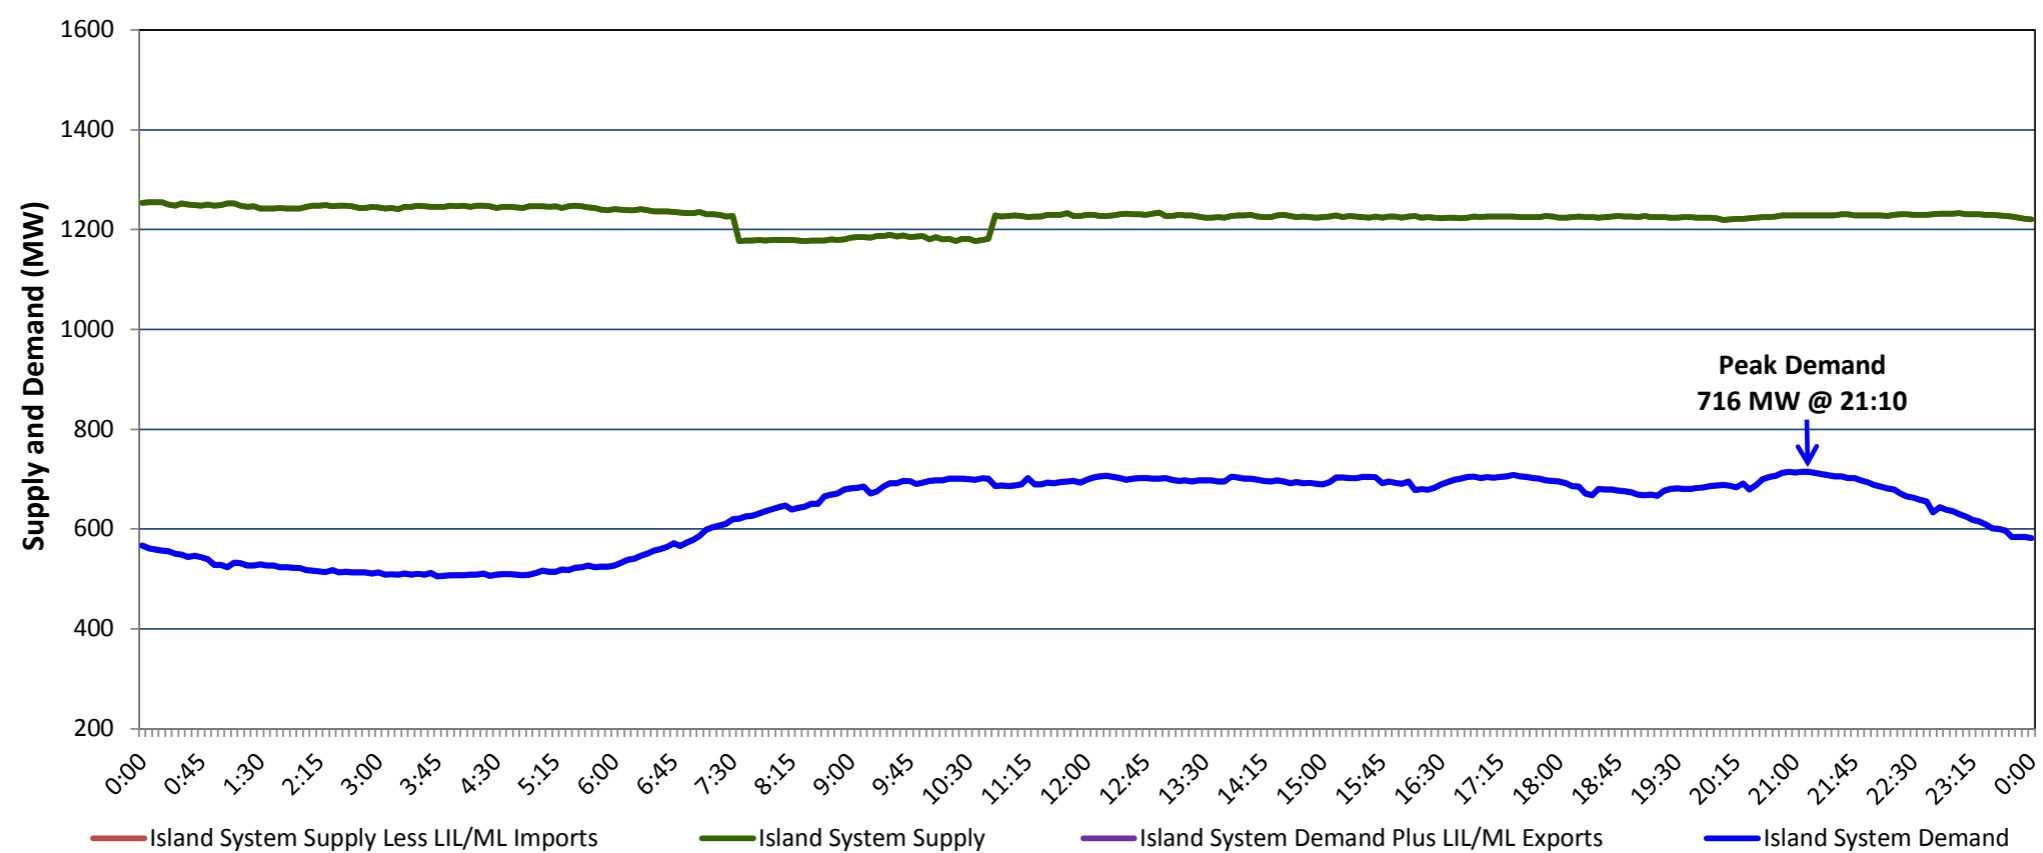

Supply Notes For August 14, 2019

- 1,2
- A As of 1303 hours, May 26, 2019, Bay d'Espoir Unit 7 unavailable due to planned outage (153.4 MW).
 - B As of 0800 hours, June 17, 2019, Holyrood Unit 2 unavailable due to planned outage (170 MW).
 - C As of 1457 hours, June 28, 2019, Stephenville Gas Turbine available at 25 MW (50 MW).
 - D As of 0800 hours, July 29, 2019, Holyrood Unit 1 unavailable due to planned outage (170 MW).
 - E As of 0800 hours, July 29, 2019, Holyrood Unit 3 unavailable due to planned outage (150 MW).
 - F As of 1504 hours, August 04, 2019, Cat Arm Unit 2 unavailable due to planned outage (67 MW).
 - G At 0734 hours, August 14, 2019, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).
 - H At 1050 hours, August 14, 2019, Hardwoods Gas Turbine available (50 MW).

**Section 2
Island Interconnected Supply and Demand**

Thu, Aug 15, 2019	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,225 MW	Thursday, August 15, 2019	16	15	755	755
NLH Island Generation: ⁴	955 MW	Friday, August 16, 2019	14	14	800	800
NLH Island Power Purchases: ⁶	75 MW	Saturday, August 17, 2019	14	14	765	765
Other Island Generation:	195 MW	Sunday, August 18, 2019	15	16	760	760
ML/LIL Imports:	- MW	Monday, August 19, 2019	18	17	790	790
Current St. John's Temperature & Windchill:	14 °C	Tuesday, August 20, 2019	18	20	795	795
7-Day Island Peak Demand Forecast:	800 MW	Wednesday, August 21, 2019	20	20	795	795

Supply Notes For August 15, 2019

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Aug 14, 2019	Actual Island Peak Demand ⁸	21:10	716 MW
Thu, Aug 15, 2019	Forecast Island Peak Demand		755 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).