


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, September 16, 2019**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Saturday, September 14, 2019**

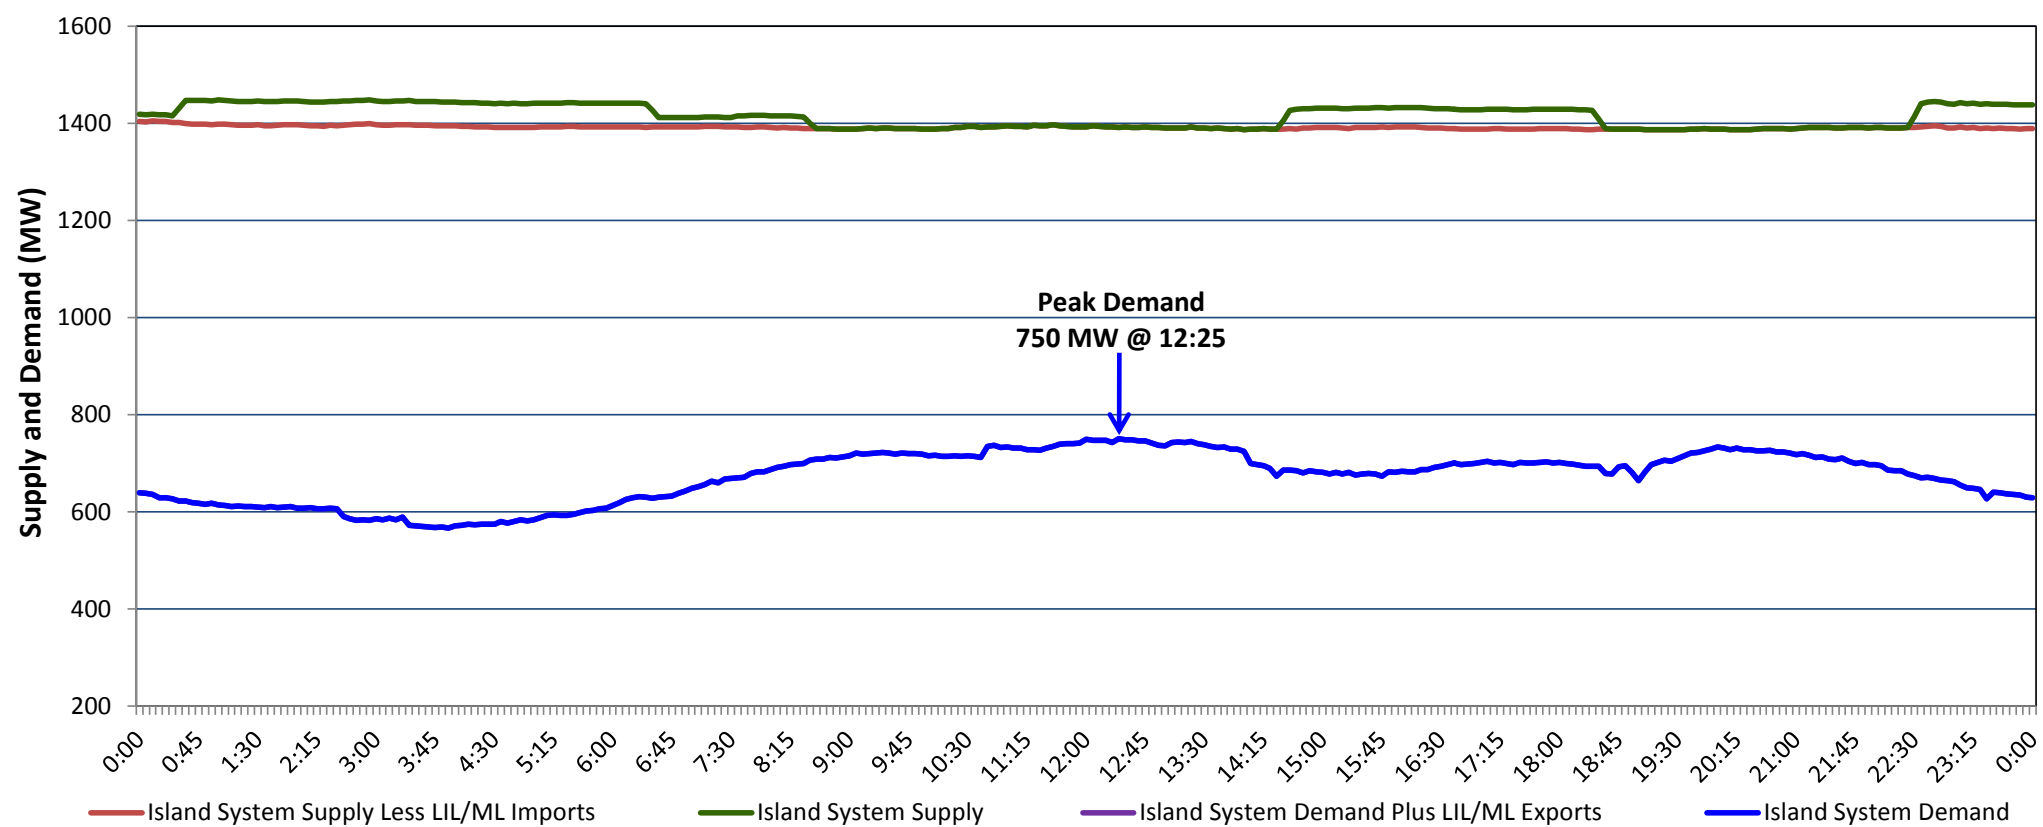

Supply Notes For September 14, 2019

- A As of 1303 hours, May 26, 2019, Bay d'Espoir Unit 7 unavailable due to planned outage (153.4 MW).
- B As of 0800 hours, July 29, 2019, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- C As of 1150 hours, August 18, 2019, Hinds Lake Unit unavailable due to planned outage (75 MW).
- D As of 1300 hours, August 28, 2019, Stephenville Gas Turbine available at 25 MW (50 MW).
- E As of 1903 hours, September 11, 2019, Holyrood Unit 3 unavailable due to planned outage (150 MW).

**Section 2
Island Interconnected Supply and Demand**

Sun, Sep 15, 2019	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,400	MW	Sunday, September 15, 2019	10	13	785	785
NLH Island Generation: ⁴	1,120	MW	Monday, September 16, 2019	13	13	845	845
NLH Island Power Purchases: ⁶	70	MW	Tuesday, September 17, 2019	9	10	925	925
Other Island Generation:	190	MW	Wednesday, September 18, 2019	9	6	980	980
ML/LIL Imports:	20	MW	Thursday, September 19, 2019	6	9	980	980
Current St. John's Temperature & Windchill:	9 °C	N/A °C	Friday, September 20, 2019	11	9	855	855
7-Day Island Peak Demand Forecast:	980	MW	Saturday, September 21, 2019	13	8	835	835

Supply Notes For September 15, 2019

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Sat, Sep 14, 2019	Actual Island Peak Demand ⁸	12:25	750 MW
Sun, Sep 15, 2019	Forecast Island Peak Demand		785 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).