


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, February 10, 2020

### Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Saturday, February 08, 2020

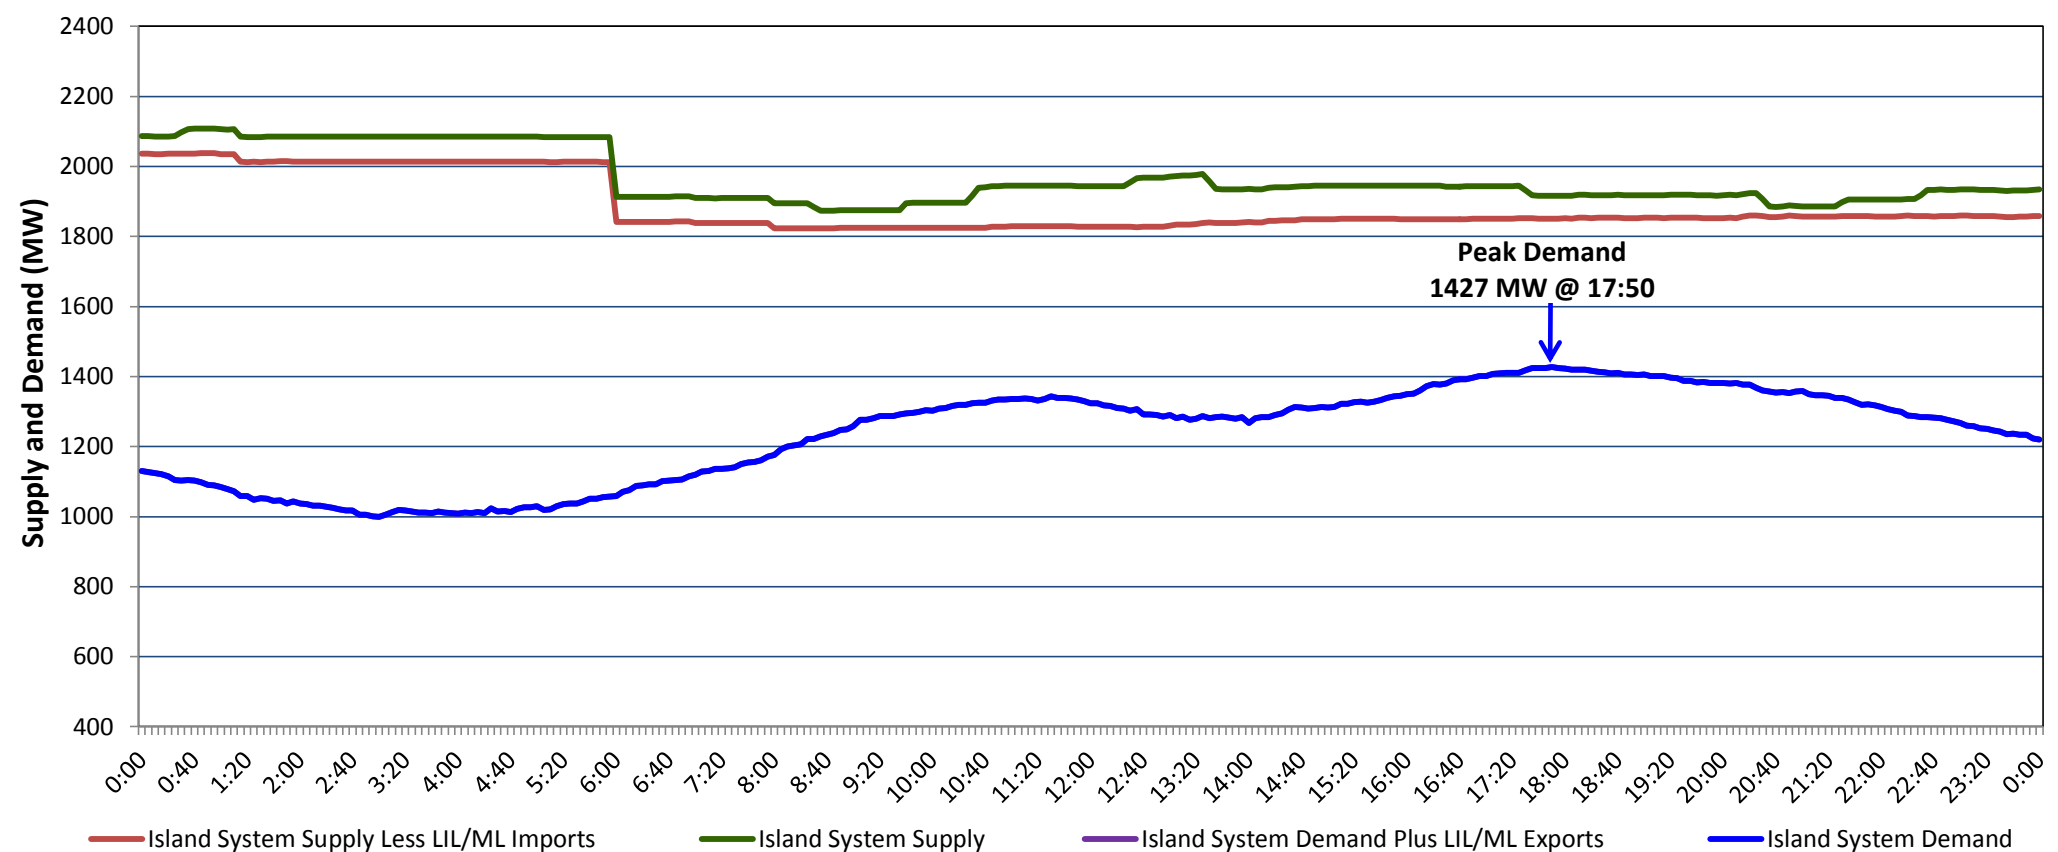

#### Supply Notes For February 08, 2020

1,2

A At 0557 hours, February 08, 2020, Holyrood Unit 2 unavailable due to planned outage (170 MW).

### Section 2 Island Interconnected Supply and Demand

Sun, Feb 09, 2020	Island System Outlook <sup>3</sup>		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	2,070	MW	Sunday, February 09, 2020	-6	-8	1,470	1,365
NLH Island Generation: <sup>4</sup>	1,695	MW	Monday, February 10, 2020	-7	-3	1,510	1,405
NLH Island Power Purchases: <sup>6</sup>	125	MW	Tuesday, February 11, 2020	0	-4	1,375	1,271
Other Island Generation:	200	MW	Wednesday, February 12, 2020	-2	-3	1,445	1,340
ML/LIL Imports:	50	MW	Thursday, February 13, 2020	-4	-2	1,440	1,335
Current St. John's Temperature & Windchill: -7 °C	-15	°C	Friday, February 14, 2020	-4	-12	1,605	1,498
7-Day Island Peak Demand Forecast:	1,605	MW	Saturday, February 15, 2020	-13	-10	1,555	1,449

#### Supply Notes For February 09, 2020

3

B At 0301 hours, February 09, 2020, Holyrood Unit 2 available (170 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Sat, Feb 08, 2020	Actual Island Peak Demand <sup>8</sup>	17:50	1,427 MW
Sun, Feb 09, 2020	Forecast Island Peak Demand		1,470 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).