


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Wednesday, April 22, 2020**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Tuesday, April 21, 2020**

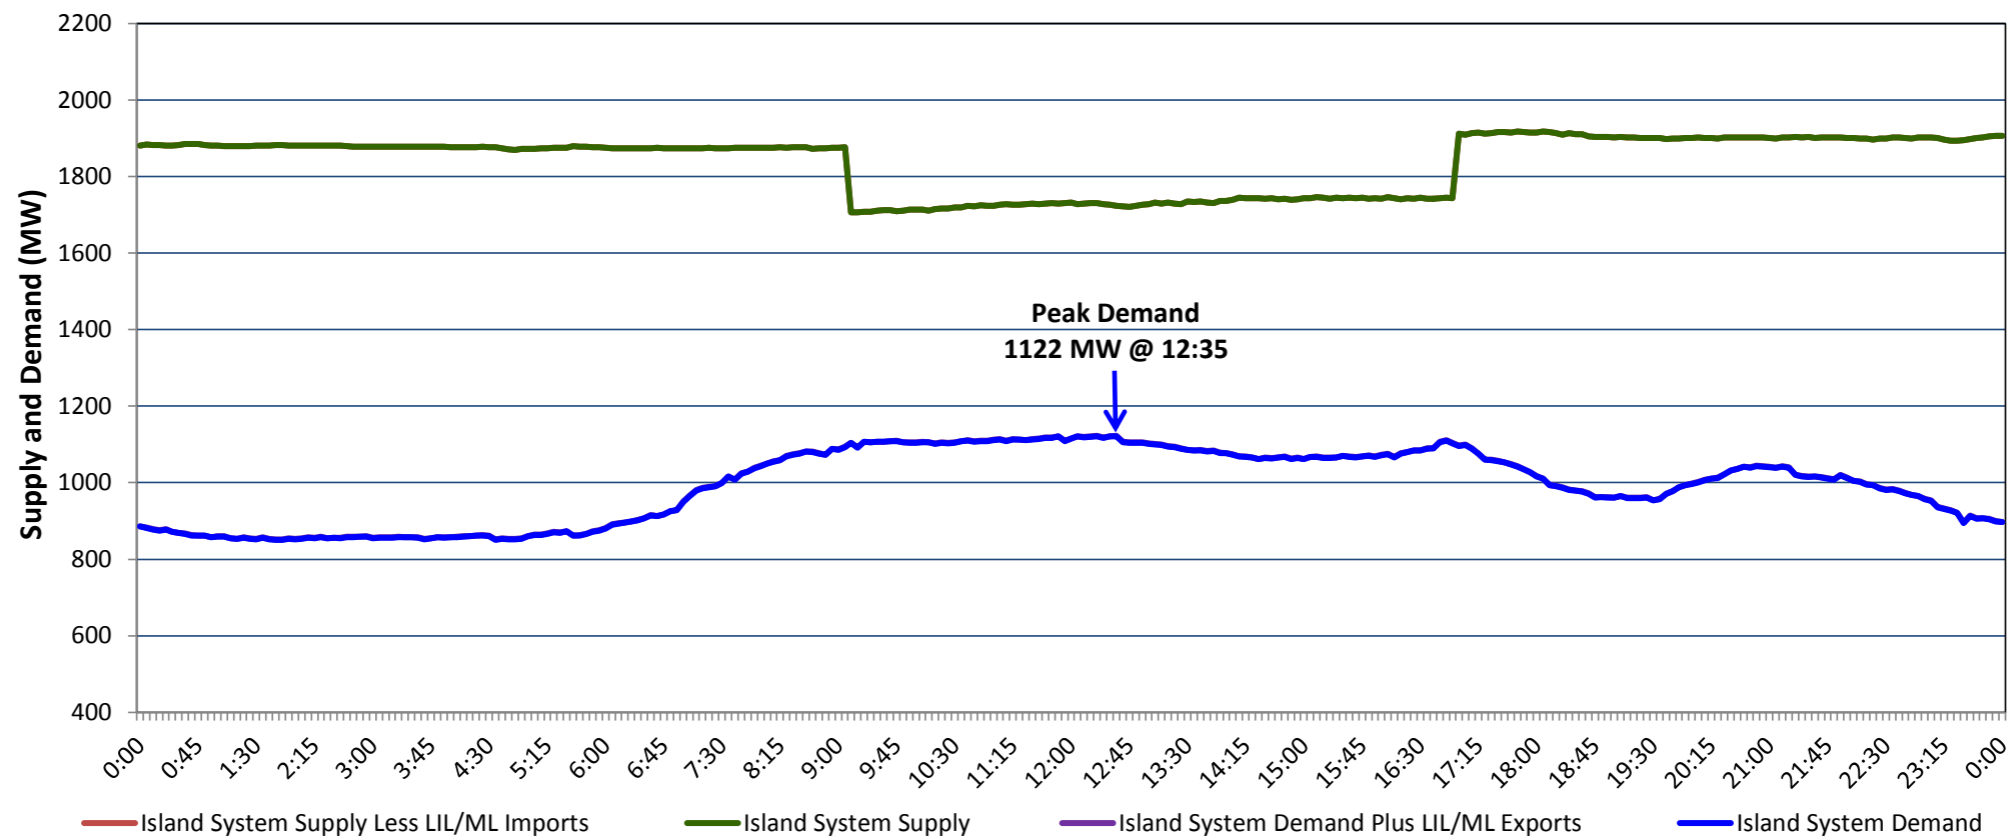

Supply Notes For April 21, 2020

- A As of 0847 hours, March 19, 2020, Holyrood Diesels available at 8 MW (10 MW).
- B As of 1054 hours, March 31, 2020, Holyrood Unit 3 removed from service for economic dispatch (150 MW).
- C At 0908 hours, April 21, 2020, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- D At 1659 hours, April 21, 2020, Holyrood Unit 1 available (170 MW).

**Section 2
Island Interconnected Supply and Demand**

Wed, Apr 22, 2020	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,795	MW	Wednesday, April 22, 2020	1	1	1,115	1,022
NLH Island Generation: ⁴	1,475	MW	Thursday, April 23, 2020	3	0	1,085	992
NLH Island Power Purchases: ⁶	110	MW	Friday, April 24, 2020	1	2	1,105	1,012
Other Island Generation:	210	MW	Saturday, April 25, 2020	2	1	1,035	943
ML/LIL Imports:	-	MW	Sunday, April 26, 2020	3	3	980	889
Current St. John's Temperature & Windchill: 1 °C	N/A	°C	Monday, April 27, 2020	2	3	1,020	928
7-Day Island Peak Demand Forecast:	1,115	MW	Tuesday, April 28, 2020	6	2	1,045	953

Supply Notes For April 22, 2020

- E At 0711 hours, April 22, 2020, Cat Arm Unit 2 unavailable due to planned outage (67 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Apr 21, 2020	Actual Island Peak Demand ⁸	12:35	1,122 MW
Wed, Apr 22, 2020	Forecast Island Peak Demand		1,115 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).