


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Thursday, June 25, 2020**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Wednesday, June 24, 2020**

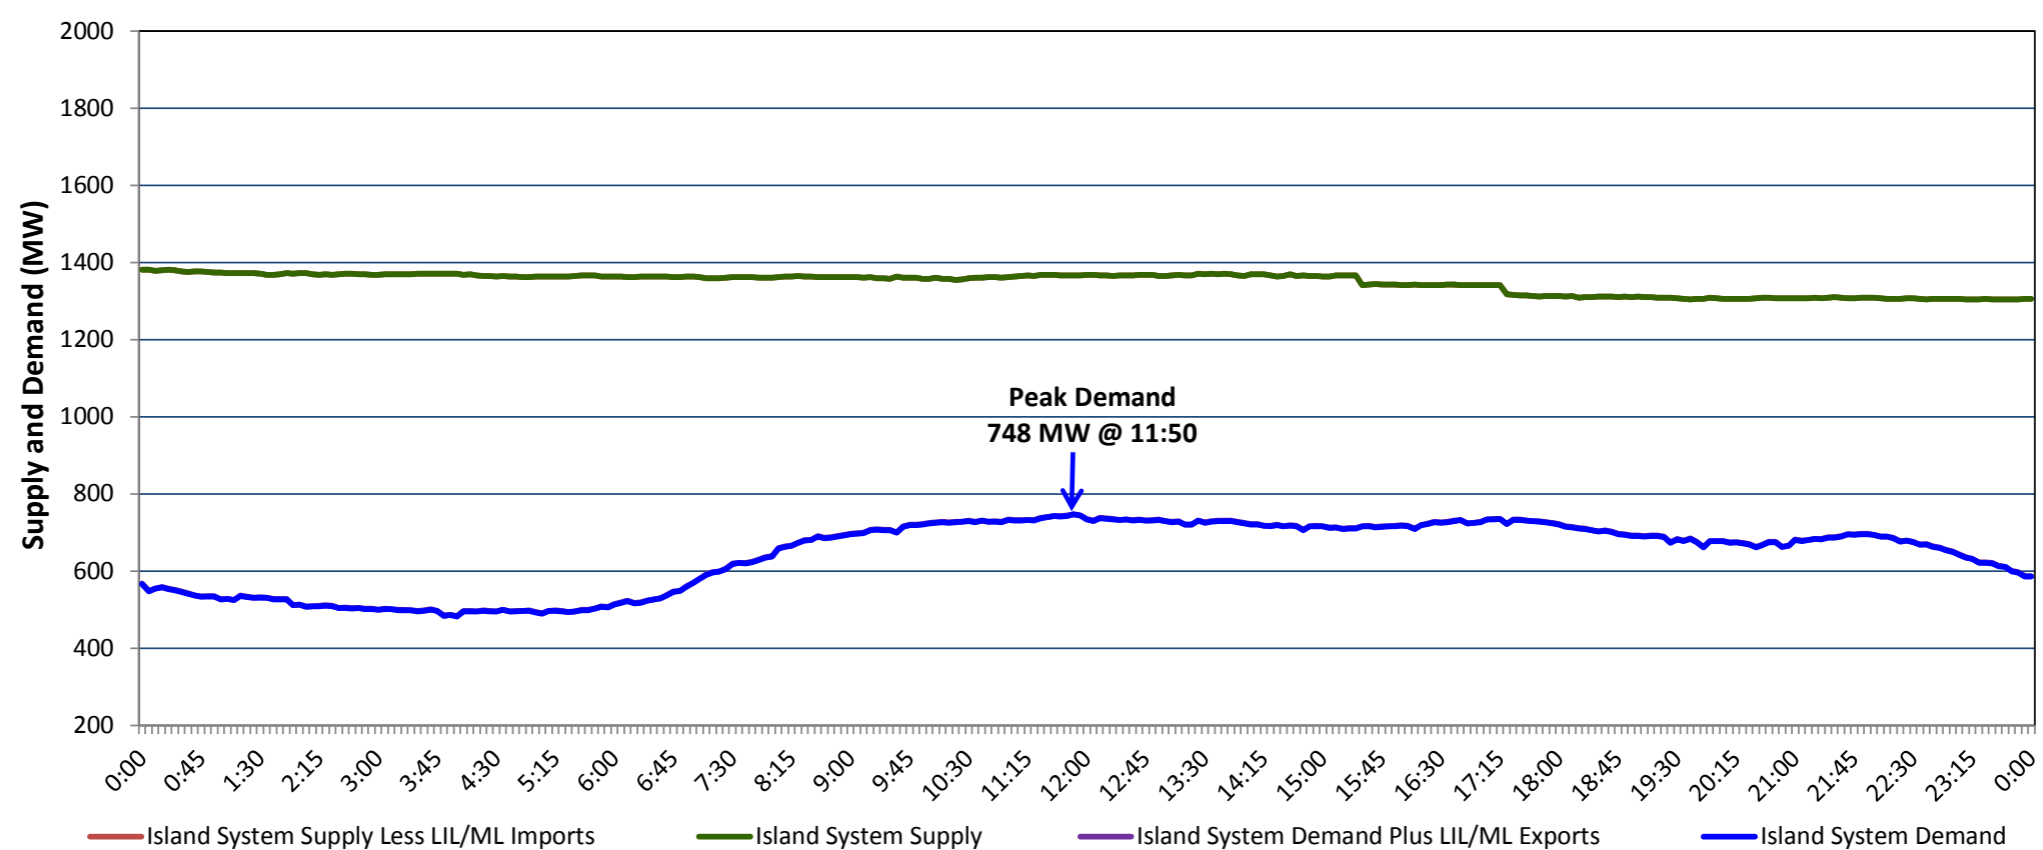

Supply Notes For June 24, 2020

1,2

- A As of 1000 hours, May 31, 2020, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
- B As of 1415 hours, June 11, 2020, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- C As of 1913 hours, June 13, 2020, Holyrood Unit 2 available but not operating (170 MW).
- D As of 0801 hours, June 19, 2020, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
- E As of 0853 hours, June 21, 2020, Holyrood Unit 3 available but not operating (150 MW).
- F At 1526 hours, June 24, 2020, Hardwoods Gas Turbine available at 25 MW (50 MW).
- G At 1717 hours, June 24, 2020, Hardwoods Gas Turbine unavailable (50 MW).

**Section 2
Island Interconnected Supply and Demand**

Thu, Jun 25, 2020	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,300 MW	Thursday, June 25, 2020	18	20	755	755
NLH Island Generation: ⁴	1,000 MW	Friday, June 26, 2020	19	19	735	735
NLH Island Power Purchases: ⁶	90 MW	Saturday, June 27, 2020	15	14	705	705
Other Island Generation:	210 MW	Sunday, June 28, 2020	12	13	735	735
ML/LIL Imports:	- MW	Monday, June 29, 2020	12	12	805	805
Current St. John's Temperature & Windchill:	18 °C	Tuesday, June 30, 2020	13	14	765	765
7-Day Island Peak Demand Forecast:	820 MW	Wednesday, July 01, 2020	11	10	820	765

Supply Notes For June 25, 2020

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Jun 24, 2020	Actual Island Peak Demand ⁸	11:50	748 MW
Thu, Jun 25, 2020	Forecast Island Peak Demand		755 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).