


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, November 30, 2020

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Friday, November 27, 2020

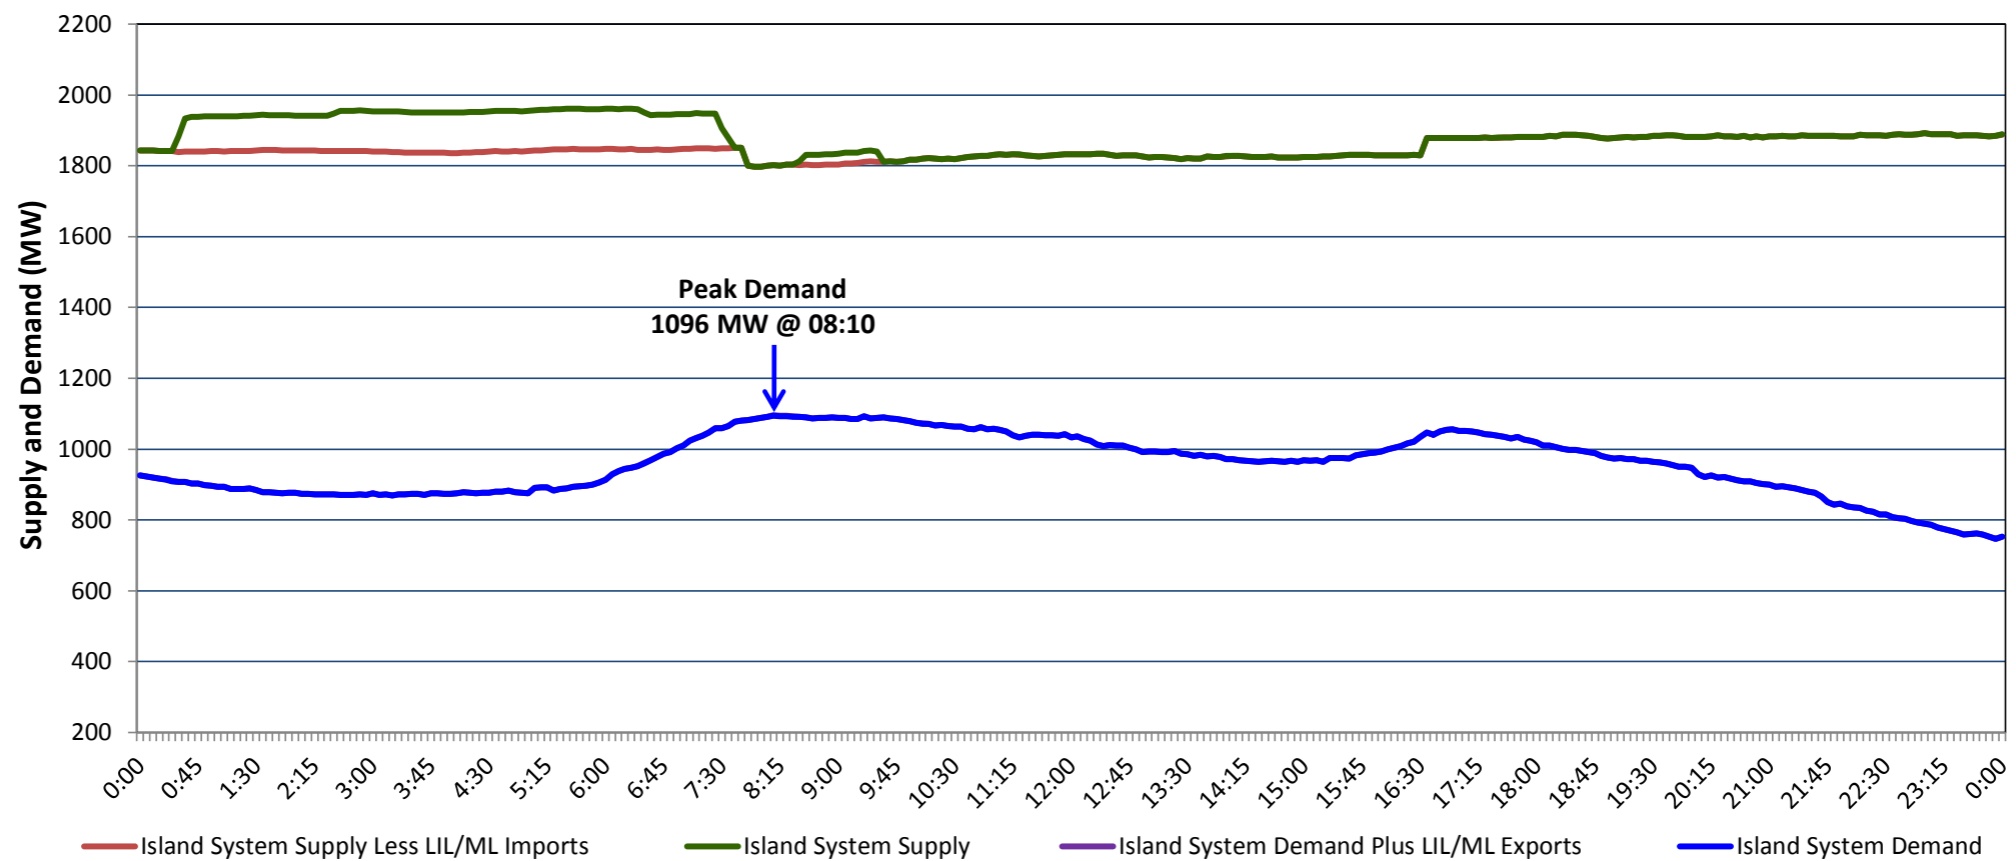

Supply Notes For November 27, 2020

1,2

A As of 0921 hours, November 26, 2020, Bay d'Espoir Unit 7 unavailable due to planned outage (154.4 MW).

B At 0750 hours, November 27, 2020, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).

C At 1632 hours, November 27, 2020, Hardwoods Gas Turbine available (50 MW).

Section 2 Island Interconnected Supply and Demand

Sat, Nov 28, 2020	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,890	MW		Saturday, November 28, 2020	11	11	985	894
NLH Island Generation: ⁴	1,540	MW		Sunday, November 29, 2020	6	3	1,150	1,057
NLH Island Power Purchases: ⁶	115	MW		Monday, November 30, 2020	1	0	1,190	1,096
Other Island Generation:	235	MW		Tuesday, December 01, 2020	0	4	1,180	1,078
ML/LIL Imports:	-	MW		Wednesday, December 02, 2020	6	6	1,120	1,019
Current St. John's Temperature & Windchill:	10 °C	N/A	°C	Thursday, December 03, 2020	8	7	1,095	994
7-Day Island Peak Demand Forecast:	1,190	MW		Friday, December 04, 2020	7	5	1,175	1,073

Supply Notes For November 28, 2020

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Fri, Nov 27, 2020	Actual Island Peak Demand ⁸	08:10	1,096 MW
Sat, Nov 28, 2020	Forecast Island Peak Demand		985 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).