


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Thursday, June 24, 2021**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Monday, June 21, 2021**

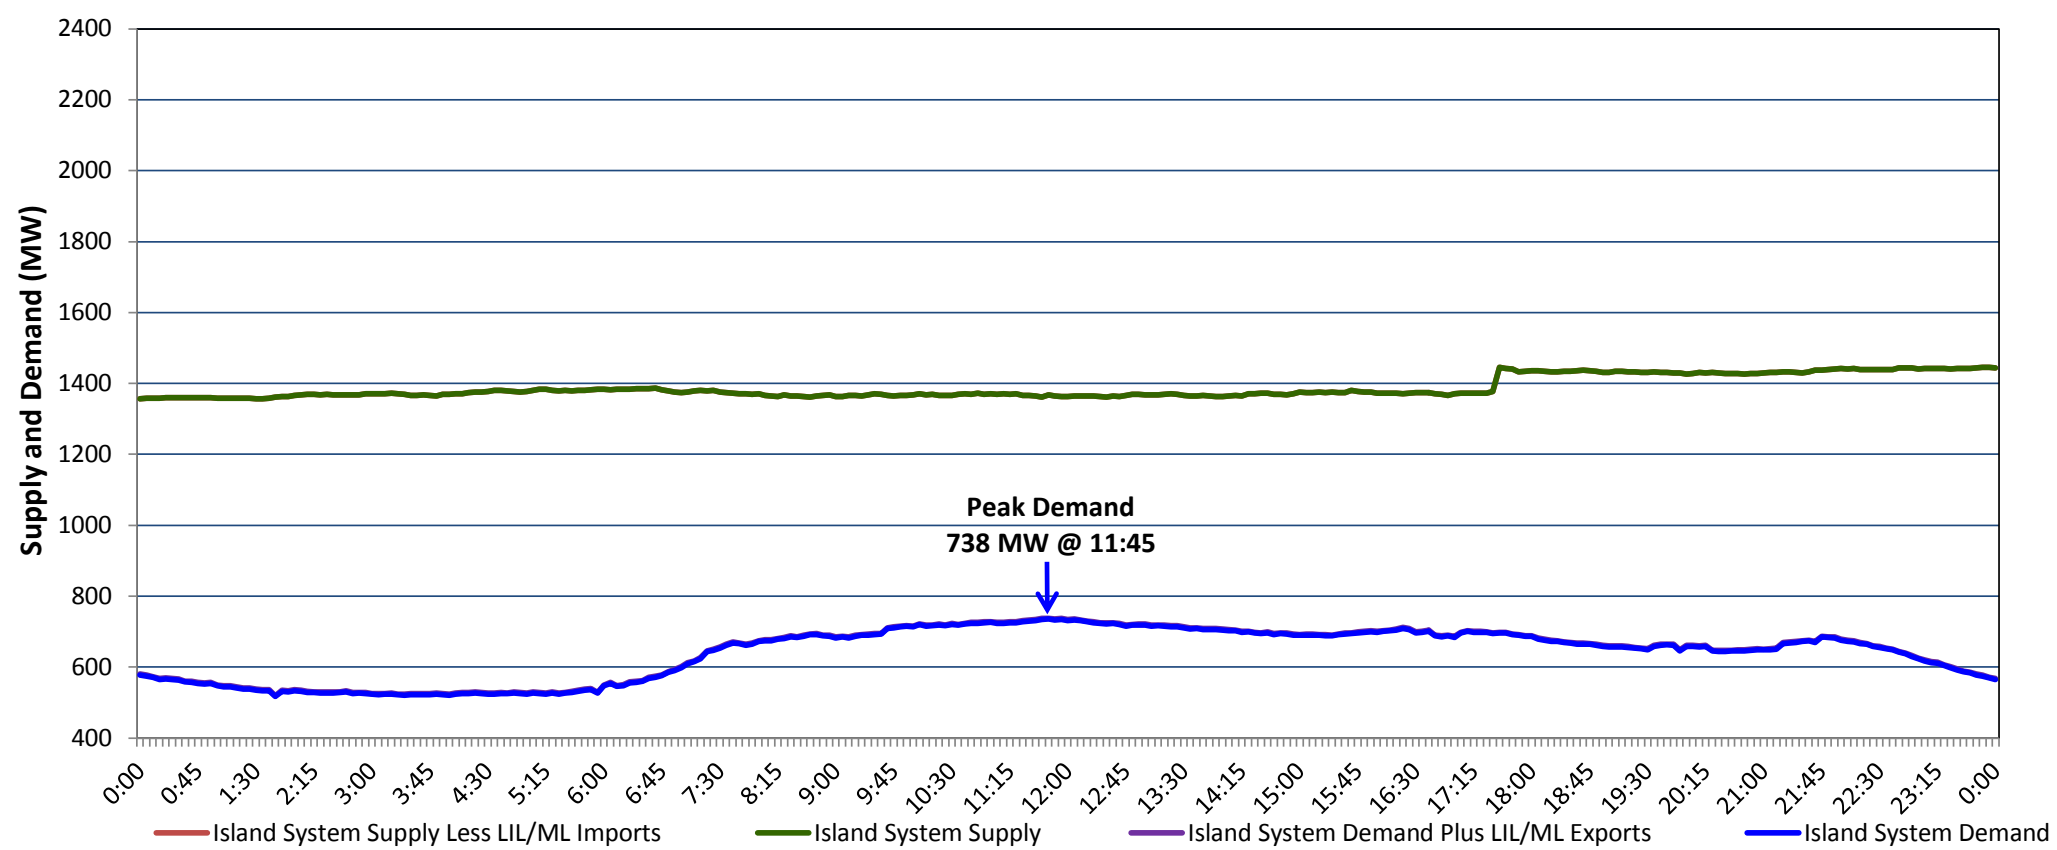

**Supply Notes For June 21, 2021**

- 1,2
- A As of 0805 hours, April 09, 2021, Holyrood Unit 3 unavailable due to planned outage (150 MW).
  - B As of 0804 hours, May 26, 2021, Holyrood Unit 1 unavailable due to planned outage (170 MW).
  - C As of 0613 hours, June 11, 2021, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
  - D As of 1208 hours, June 11, 2021, Holyrood Unit 2 available but not operating (170 MW).
  - E At 1734 hours, June 21, 2021, Cat Arm Unit 1 available (67 MW).

**Section 2  
Island Interconnected Supply and Demand**

| Tue, Jun 22, 2021                            | Island System Outlook <sup>3</sup> |     |    | Seven-Day Forecast       | Temperature (°C) |         | Island System Daily Peak Demand (MW) |                       |
|--|------------------------------------|-----|----|--------------------------|------------------|---------|--------------------------------------|-----------------------|
|  |                                    |     |    |                          | Morning          | Evening | Forecast <sup>8</sup>                | Adjusted <sup>7</sup> |
| Available Island System Supply: <sup>5</sup> | 1,310                              | MW  |    | Tuesday, June 22, 2021   | 18               | 20      | 745                                  | 745                   |
| NLH Island Generation: <sup>4</sup>          | 975                                | MW  |    | Wednesday, June 23, 2021 | 16               | 20      | 730                                  | 730                   |
| NLH Island Power Purchases: <sup>6</sup>     | 105                                | MW  |    | Thursday, June 24, 2021  | 17               | 11      | 745                                  | 745                   |
| Other Island Generation:                     | 230                                | MW  |    | Friday, June 25, 2021    | 14               | 14      | 765                                  | 765                   |
| ML/LIL Imports:                              | -                                  | MW  |    | Saturday, June 26, 2021  | 15               | 17      | 750                                  | 750                   |
| Current St. John's Temperature & Windchill:  | 18 °C                              | N/A | °C | Sunday, June 27, 2021    | 14               | 17      | 750                                  | 750                   |
| 7-Day Island Peak Demand Forecast:           | 765                                | MW  |    | Monday, June 28, 2021    | 19               | 19      | 700                                  | 700                   |

**Supply Notes For June 22, 2021**

- 3
- F At 0710 hours, June 22, 2021, Hinds Lake Unit unavailable due to planned outage (75 MW).
  - G At 0745 hours, June 22, 2021, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
  8. Hydro is experiencing issues with its forecasting system for days 3-7. Data presented for days 3-7 is generated by Hydro's development forecast system.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

|                   |  |       |        |
|-------------------|--|-------|--------|
| Mon, Jun 21, 2021 | Actual Island Peak Demand <sup>8</sup> | 11:45 | 738 MW |
| Tue, Jun 22, 2021 | Forecast Island Peak Demand            |       | 745 MW |

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).