


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, September 13, 2021

### Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Sunday, September 12, 2021

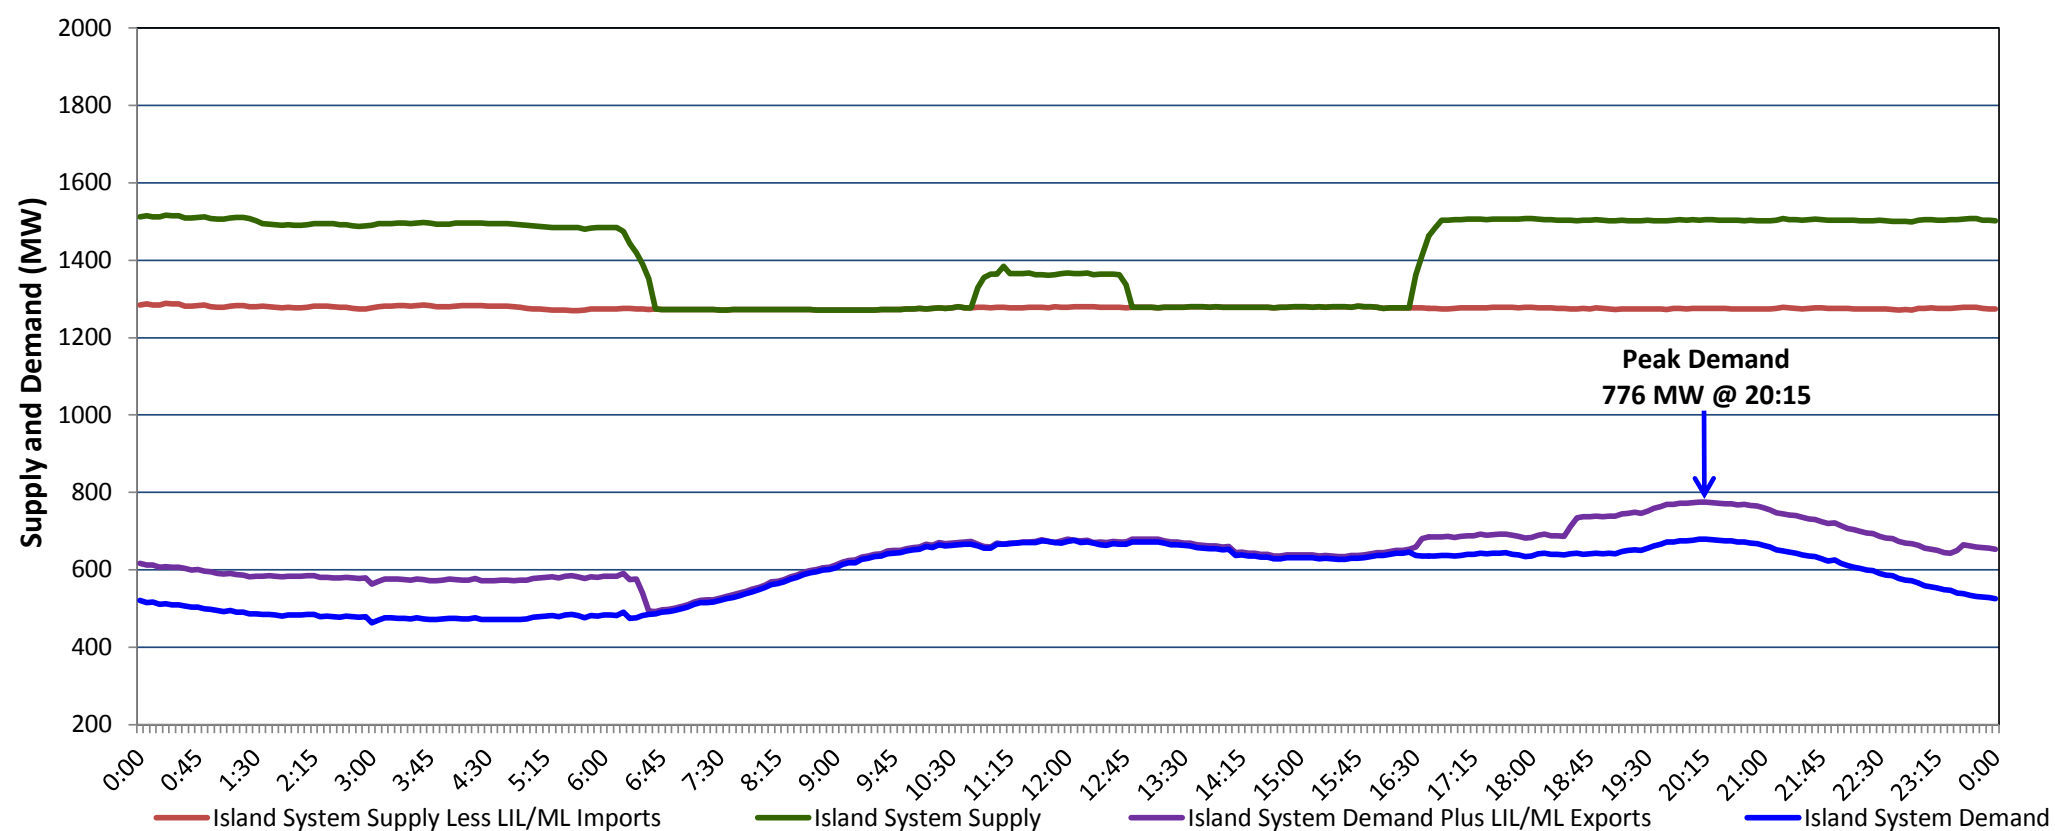

#### Supply Notes For September 12, 2021

- 1,2
- A As of 0804 hours, May 26, 2021, Holyrood Unit 1 unavailable due to planned outage (170 MW).
  - B As of 0850 hours, July 25, 2021, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
  - C As of 1051 hours, July 25, 2021, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
  - D As of 1052 hours, August 01, 2021, Upper Salmon Unit unavailable due to planned outage (84 MW).
  - E As of 1500 hours, August 12, 2021, Holyrood Unit 2 unavailable due to planned outage (170 MW).
  - F As of 1006 hours, September 11, 2021, Holyrood Unit 3 unavailable (150 MW).

### Section 2 Island Interconnected Supply and Demand

Mon, Sep 13, 2021	Island System Outlook <sup>3</sup>			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,285	MW		Monday, September 13, 2021	16	16	830	830
NLH Island Generation: <sup>4,8</sup>	965	MW		Tuesday, September 14, 2021	14	11	755	755
NLH Island Power Purchases: <sup>6</sup>	100	MW		Wednesday, September 15, 2021	8	10	775	775
Other Island Generation:	220	MW		Thursday, September 16, 2021	14	16	750	750
ML/LIL Imports:	-	MW		Friday, September 17, 2021	12	13	725	725
Current St. John's Temperature & Windchill:	15 °C	N/A	°C	Saturday, September 18, 2021	14	16	695	695
7-Day Island Peak Demand Forecast:	830	MW		Sunday, September 19, 2021	16	14	710	710

#### Supply Notes For September 13, 2021

- 3
- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  - As of 0800 Hours.
  - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  - Gross output from all Island sources (including Note 4).
  - NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  - Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
  - Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Sun, Sep 12, 2021	Actual Island Peak Demand <sup>8</sup>	20:15	776 MW
Mon, Sep 13, 2021	Forecast Island Peak Demand		830 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).