


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, December 13, 2021

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Sunday, December 12, 2021

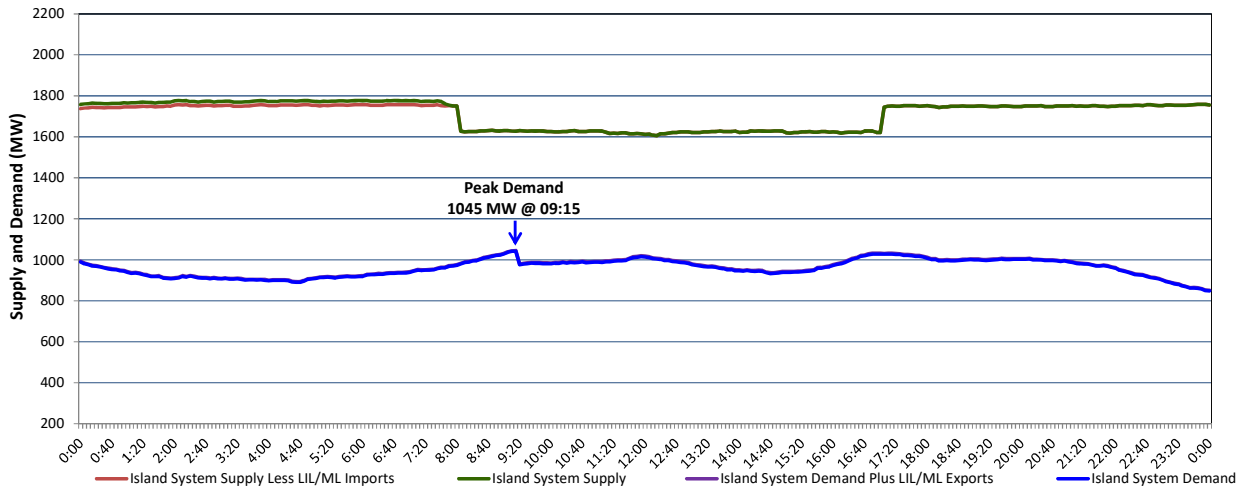

Supply Notes For December 12, 2021

1,2

- A As of 0850 hours, July 25, 2021, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- B As of 0830 hours, November 12, 2021, Holyrood Unit 2 unavailable (170 MW).
- C As of 0756 hours, December 11, 2021, Holyrood Unit 1 available at 160 MW (170 MW).
- D At 0734 hours, December 12, 2021, Holyrood Unit 3 available at 140 MW (150 MW).
- E At 0801 hours, December 12, 2021, Holyrood Gas Turbine unavailable due to planned outage (123.5 MW).
- F At 1702 hours, December 12, 2021, Holyrood Gas Turbine available (123.5 MW).

Section 2 Island Interconnected Supply and Demand

Mon, Dec 13, 2021	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,770 MW	Monday, December 13, 2021	2	2	1,310	1,207
NLH Island Generation: ^{4,8}	1,425 MW	Tuesday, December 14, 2021	2	-2	1,405	1,301
NLH Island Power Purchases: ⁶	125 MW	Wednesday, December 15, 2021	-5	-5	1,485	1,380
Other Island Generation:	220 MW	Thursday, December 16, 2021	-6	-7	1,430	1,325
ML/LIL Imports:	-	Friday, December 17, 2021	0	3	1,320	1,217
Current St. John's Temperature & Windchill:	2 N/A °C	Saturday, December 18, 2021	-3	-2	1,405	1,301
7-Day Island Peak Demand Forecast:	1,485 MW	Sunday, December 19, 2021	-3	-6	1,480	1,375

Supply Notes For December 13, 2021

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Sun, Dec 12, 2021	Actual Island Peak Demand ⁹	9:15	1,045 MW
Mon, Dec 13, 2021	Forecast Island Peak Demand		1,310 MW

- Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).