


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Tuesday, October 11, 2022

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Monday, October 10, 2022

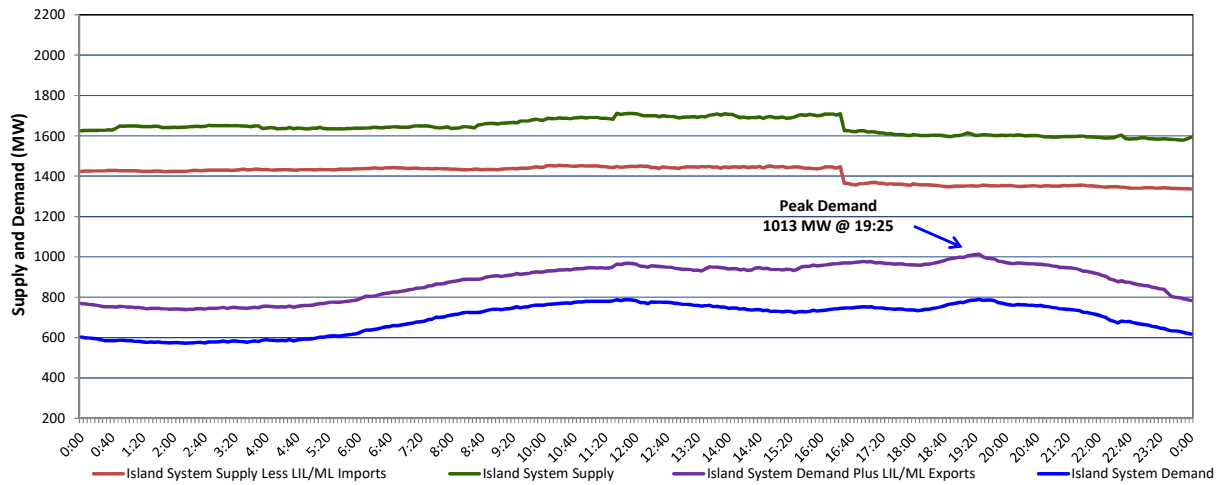

Supply Notes For October 10, 2022

1,2

- A As of 0800 hours, July 31, 2022, Holyrood Unit 2 unavailable due to planned outage 150 MW (170 MW).
- B As of 1040 hours, August 27, 2022, Holyrood Unit 3 available but not operating (150 MW).
- C As of 1304 hours, September 26, 2022, Hinds Lake Unit available at 65 MW (75 MW).
- D As of 1033 hours, September 27, 2022, Stephenville Gas Turbine unavailable (50 MW).
- E As of 1633 hours, September 29, 2022, Holyrood Unit 1 available but not operating 90 MW (170 MW).
- F As of 1135 hours, October 05, 2022, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
- G **At 1628 hours, October 10, 2022, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).**

Section 2 Island Interconnected Supply and Demand

Tue, Oct 11, 2022	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,578 MW	Tuesday, October 11, 2022	7	8	1,120	1,120
NLH Island Generation: ^{4,8}	990 MW	Wednesday, October 12, 2022	10	9	835	835
NLH Island Power Purchases: ⁶	95 MW	Thursday, October 13, 2022	8	9	875	875
Other Island Generation:	225 MW	Friday, October 14, 2022	8	10	855	855
ML/LIL Imports:	268 MW	Saturday, October 15, 2022	10	10	760	760
Current St. John's Temperature & Windchill:	4 N/A °C	Sunday, October 16, 2022	11	10	790	790
7-Day Island Peak Demand Forecast:	1,120 MW	Monday, October 17, 2022	10	11	850	850

Supply Notes For October 11, 2022

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Mon, Oct 10, 2022	Actual Island Peak Demand ⁹	19:25	1,013 MW
Tue, Oct 11, 2022	Forecast Island Peak Demand		1,120 MW

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).