
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Tuesday, September 05, 2023

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Sunday, September 03, 2023

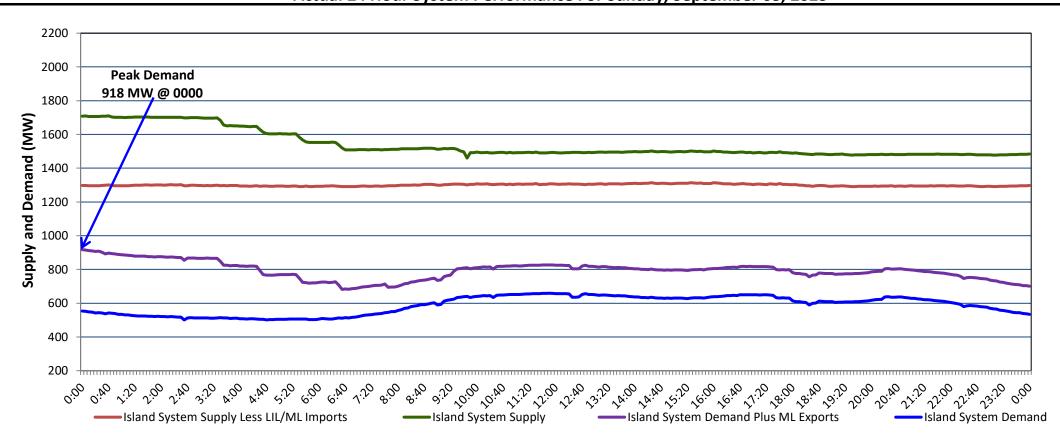

Supply Notes For September 03, 2023

1,2

- As of 0701 hours, March 06, 2023, Upper Salmon Unit unavailable (84 MW).
- As of 0800 hours, May 21, 2023, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- As of 0903 hours, June 29, 2023, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- As of 0800 hours, July 09, 2023, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- E As of 2059 hours, July 13, 2023, Stephenville Gas Turbine unavailable (50 MW).
- As of 2238 hours, July 25, 2023, Bay d'Espoir Unit 6 unavailable (76.5 MW).
- G As of 0933 hours, August 15, 2023, Holyrood Unit 3 unavailable due to planned outage (150 MW).

Section 2

Island Interconnected Supply and Demand

Mon, Sep 04, 2023	04, 2023 Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1	,448	MW	Monday, September 4, 2023	17	16	880	880
NLH Island Generation: ^{4,8}		990	MW	Tuesday, September 5, 2023	17	18	845	845
NLH Island Power Purchases: ⁶		80	MW	Wednesday, September 6, 2023	14	13	715	715
Other Island Generation:		190	MW	Thursday, September 7, 2023	16	16	740	740
ML/LIL Imports:		188	MW	Friday, September 8, 2023	17	12	750	750
Current St. John's Temperature & Windchill:	15 °C	N/A	°C	Saturday, September 9, 2023	11	11	745	745
7-Day Island Peak Demand Forecast:		880	MW	Sunday, September 10, 2023	12	18	740	740

Supply Notes For September 04, 2023

Notes

- 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
- 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
- 3. As of 0800 Hours.
- 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
- 5. Gross output from all Island sources (including Note 4).
- 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
- 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
- 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Sun, Sep 03, 2023	Actual Island Peak Demand ⁹	0:00	918 MW				
Mon, Sep 04, 2023	Forecast Island Peak Demand		880 MW				

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).